


CONFIDENTIAL

| DATE | REV | RECORD | DR |
|-------|-----|-----------|----|
| 8/21 | A | SUBMITTAL | JK |
| 10/22 | B | SUBMITTAL | JK |

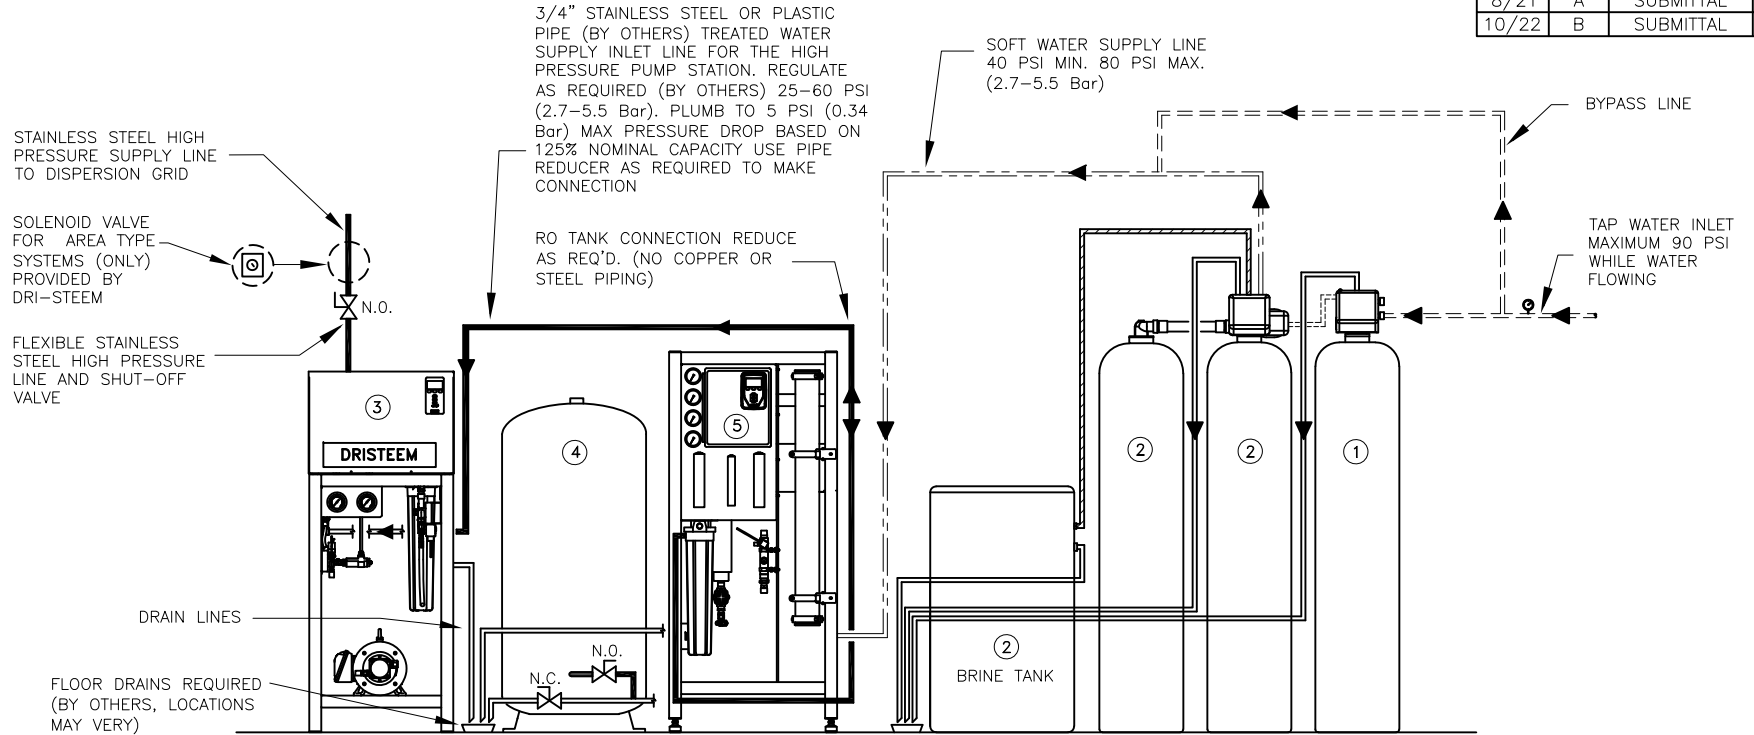

LEGEND

- = RAW WATER
- ==== = SOFT WATER
- ===== = DRAIN/WASTE
- = RO PERMEATE
- = BRINE
- = DECHLORINATED

NOTES:

- ⚠ WATER TREATMENT COMPONENT PLACEMENT IS FLEXIBLE. ALL WATER PRETREATMENT PIPING (BEFORE RO SKID CAN BE COPPER) AND FITTINGS ARE BY CONTRACTOR SEE PIPING SCHEMATIC DIAGRAM FOR REQUIREMENTS, FITTINGS, VALVES AND COMPONENTS. PERMEATE (AFTER THE RO SKID) MUST BE STAINLESS STEEL OR PLASTIC TUBING. CONCENTRATE (DRAIN) LINE FROM RO SKID CAN BE PLASTIC OR COPPER
- ⚠ REFER TO DETAIL REPORT FOR CONNECTION SIZE & PIPE.

| | |
|-----------------------------|---|
| ① DECHLORINATOR | ② DUPLEX WATER SOFTENER SINGLE VALVE AND BRINE TANK |
| ③ HIGH PRESSURE PUMPSTATION | ④ RO TANK |
| | ⑤ RO SYSTEM SKID [PUMP & MEMBRANES] |

| | | |
|--|---|----------------------|
| | HIGH-PRESSURE SYSTEM GENERIC MECHANICAL PIPING | |
| | MAT'L: | |
| | SCALE: 1:32 | P/N |
| | DRAWN BY: JK | GENERIC SUBMITTAL |
| | DATE: 8/4/21 | |