CONFIDENTIAL

DATE	REV	RECORD	DR
8/21	A	SUBMITTAL	JK

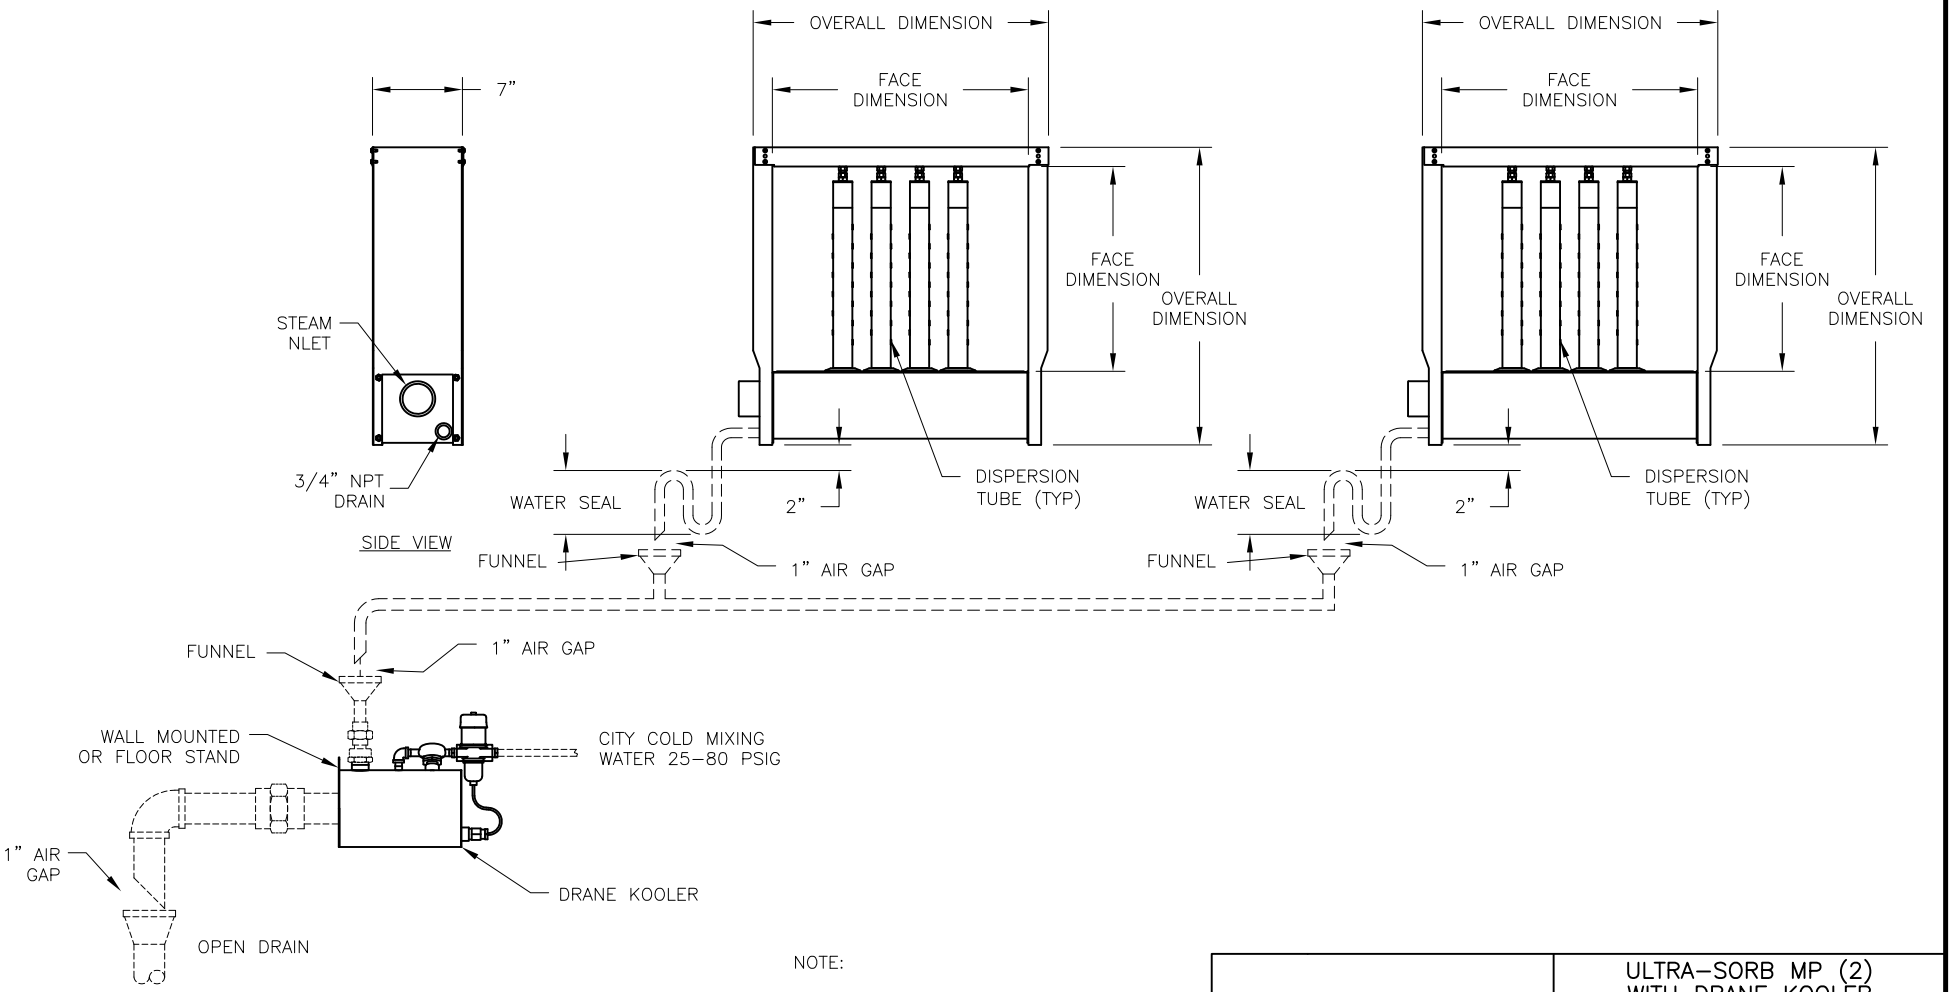

NOTE:

VERIFY THAT MAXIMUM FLOW OF HOT WATER INTO DRANE–KOOLER DOES NOT EXCEED 6 USGPM (22.7 L/M).

driSteem™

ULTRA–SORB MP (2) WITH DRANE KOOLER

MAT'L:

SCALE: 1:15

DRAWN BY: JK

DATE: 8/4/21

P/N

GENERIC SUBMITTAL