


CONFIDENTIAL

DATE	REV	RECORD	DR
1/20	A	SUBMITTAL	JK

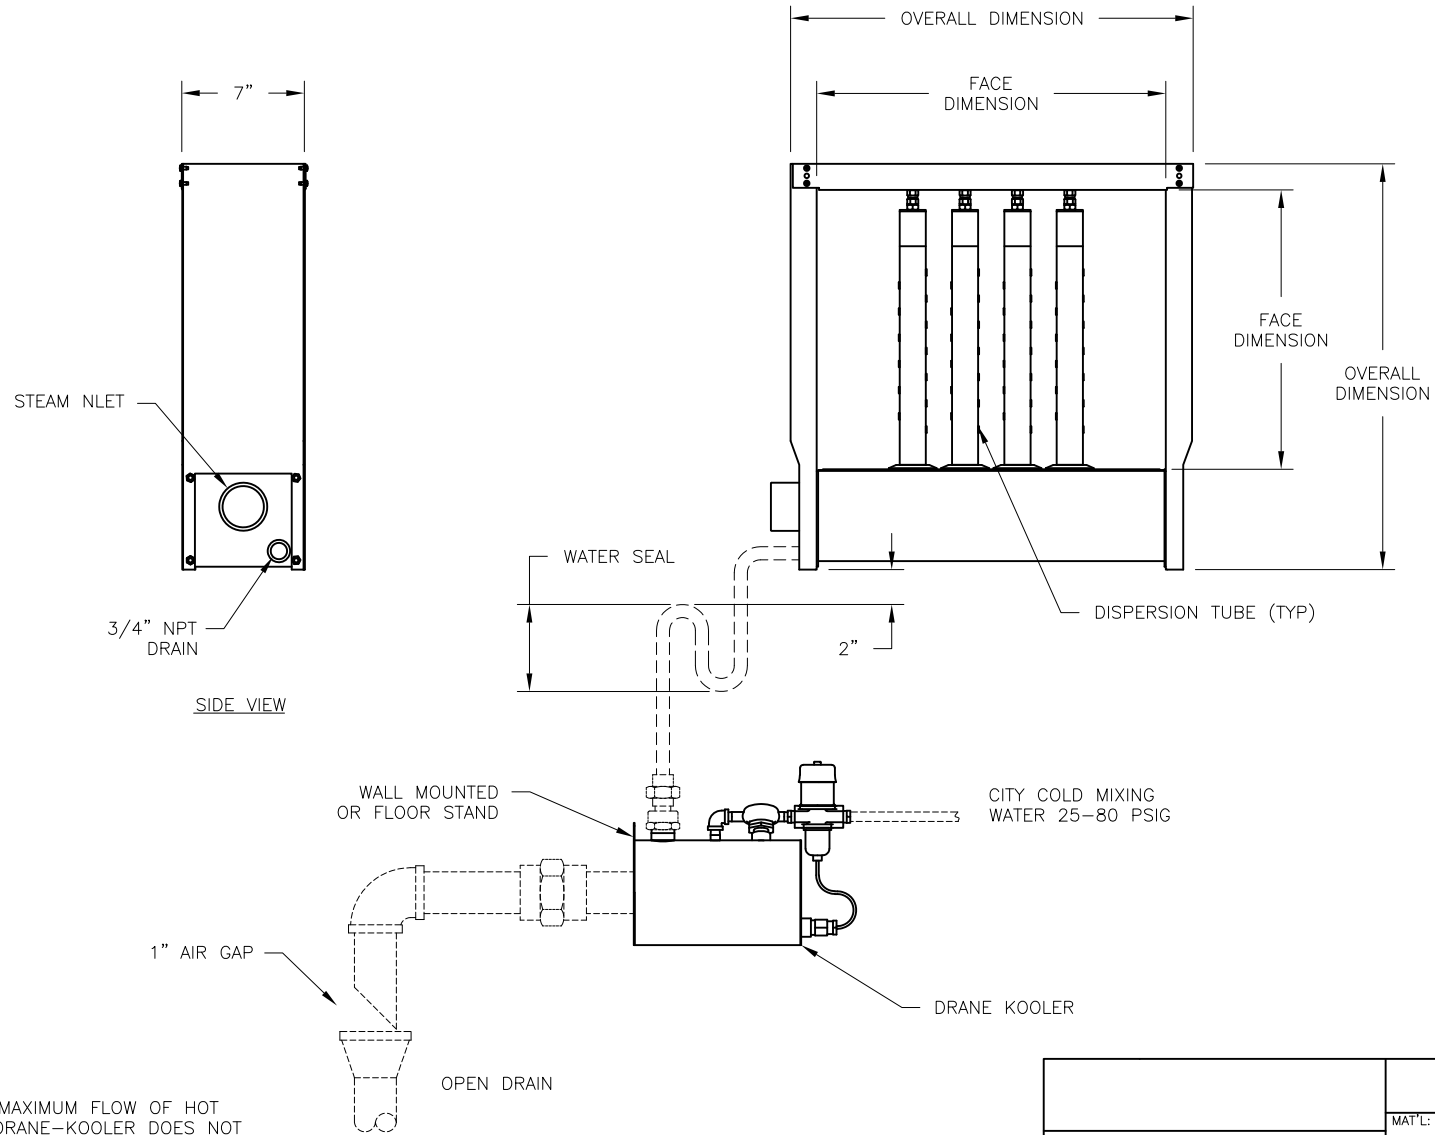

NOTE:  
 VERIFY THAT MAXIMUM FLOW OF HOT  
 WATER INTO DRANE-KOOLER DOES NOT  
 EXCEED 6 USGPM (22.7 L/M).

		ULTRA-SORB MP WITH DRANE KOOLER	
		MAT'L:	P/N
SCALE:	1:11	DM-16750	
DRAWN BY:	JK		
DATE:	1/9/20		