


CONFIDENTIAL

DATE	REV	RECORD	DR
8/24	A	SUBMITTAL	JK

STEAM HOSE OR TUBING.
METAL TUBING MUST
BE GROUNDED.
INSULATE TUBING TO
REDUCE STEAM LOSS.

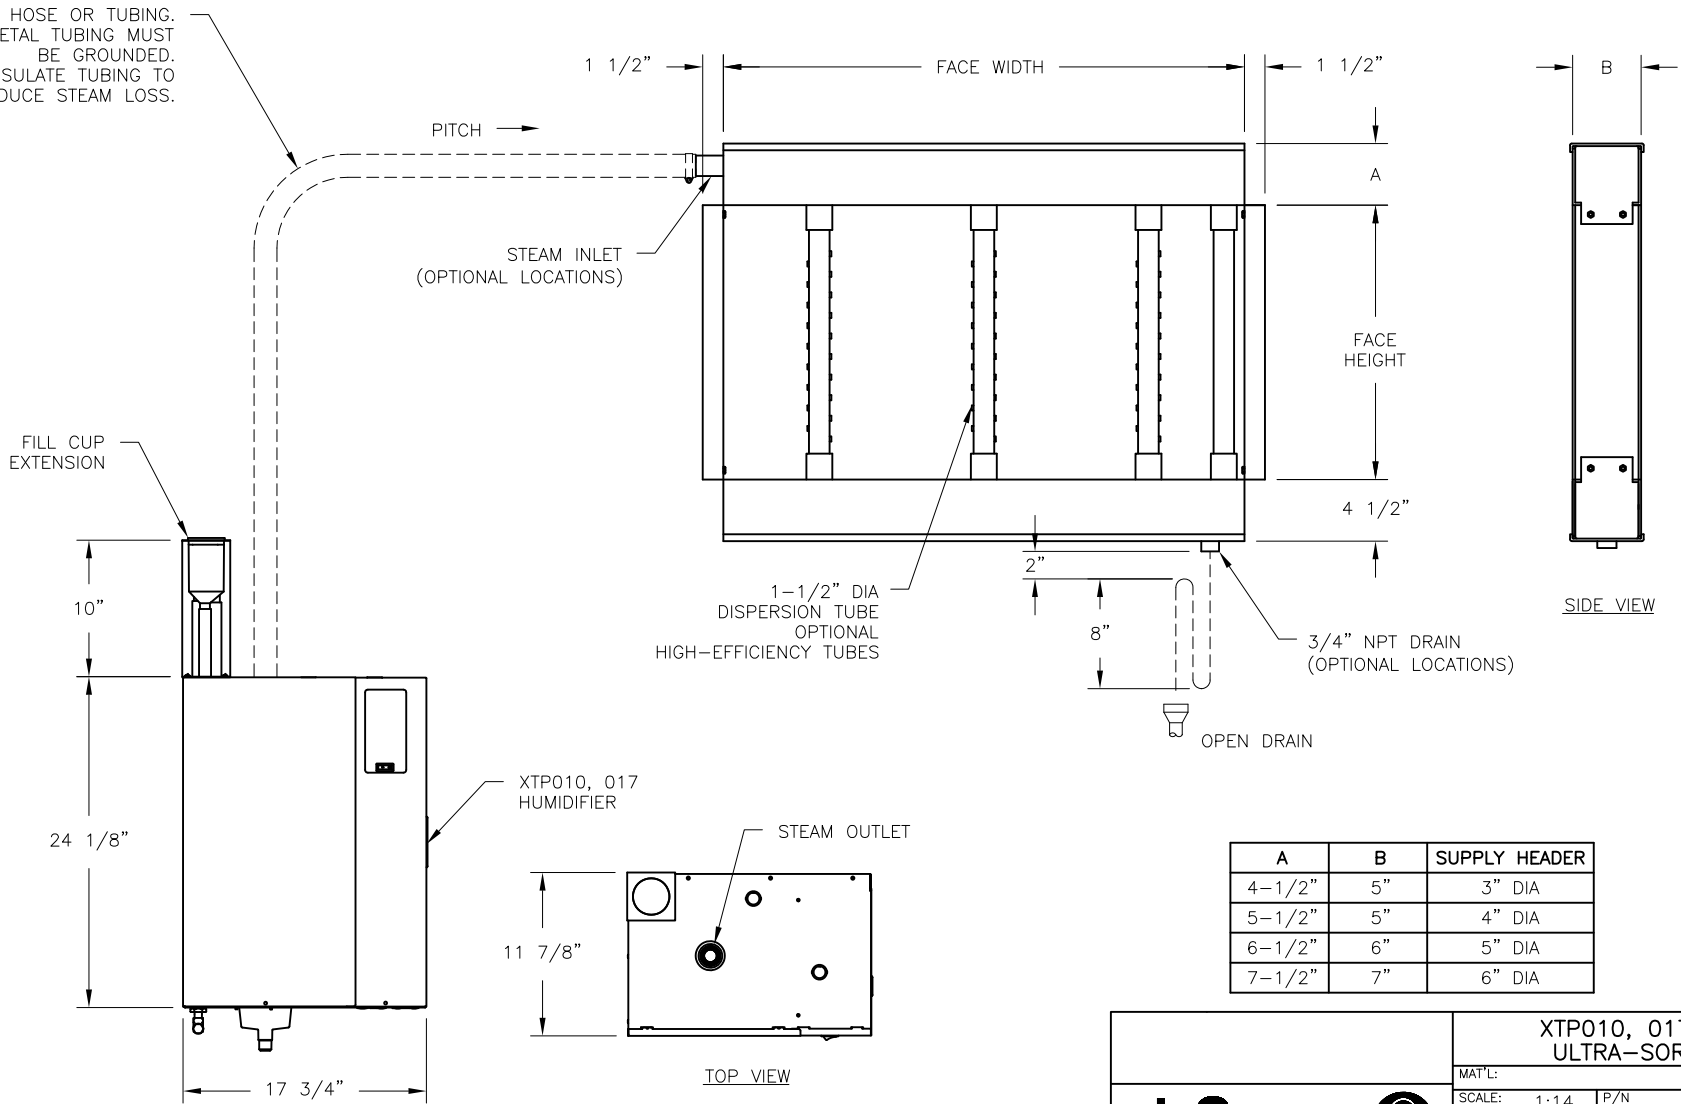

A	B	SUPPLY HEADER
4-1/2"	5"	3" DIA
5-1/2"	5"	4" DIA
6-1/2"	6"	5" DIA
7-1/2"	7"	6" DIA

		XTP010, 017 WITH ULTRA-SORB LV	
		MAT'L:	
SCALE: 1:14	P/N	GENERIC SUBMITTAL	
DRAWN BY: JK			
DATE: 8/29/24			