


CONFIDENTIAL

DATE	REV	RECORD	DR
8/24	A	SUBMITTAL	JK

STEAM HOSE OR TUBING.  
METAL TUBING MUST  
BE GROUNDED.  
INSULATE TUBING TO  
REDUCE STEAM LOSS

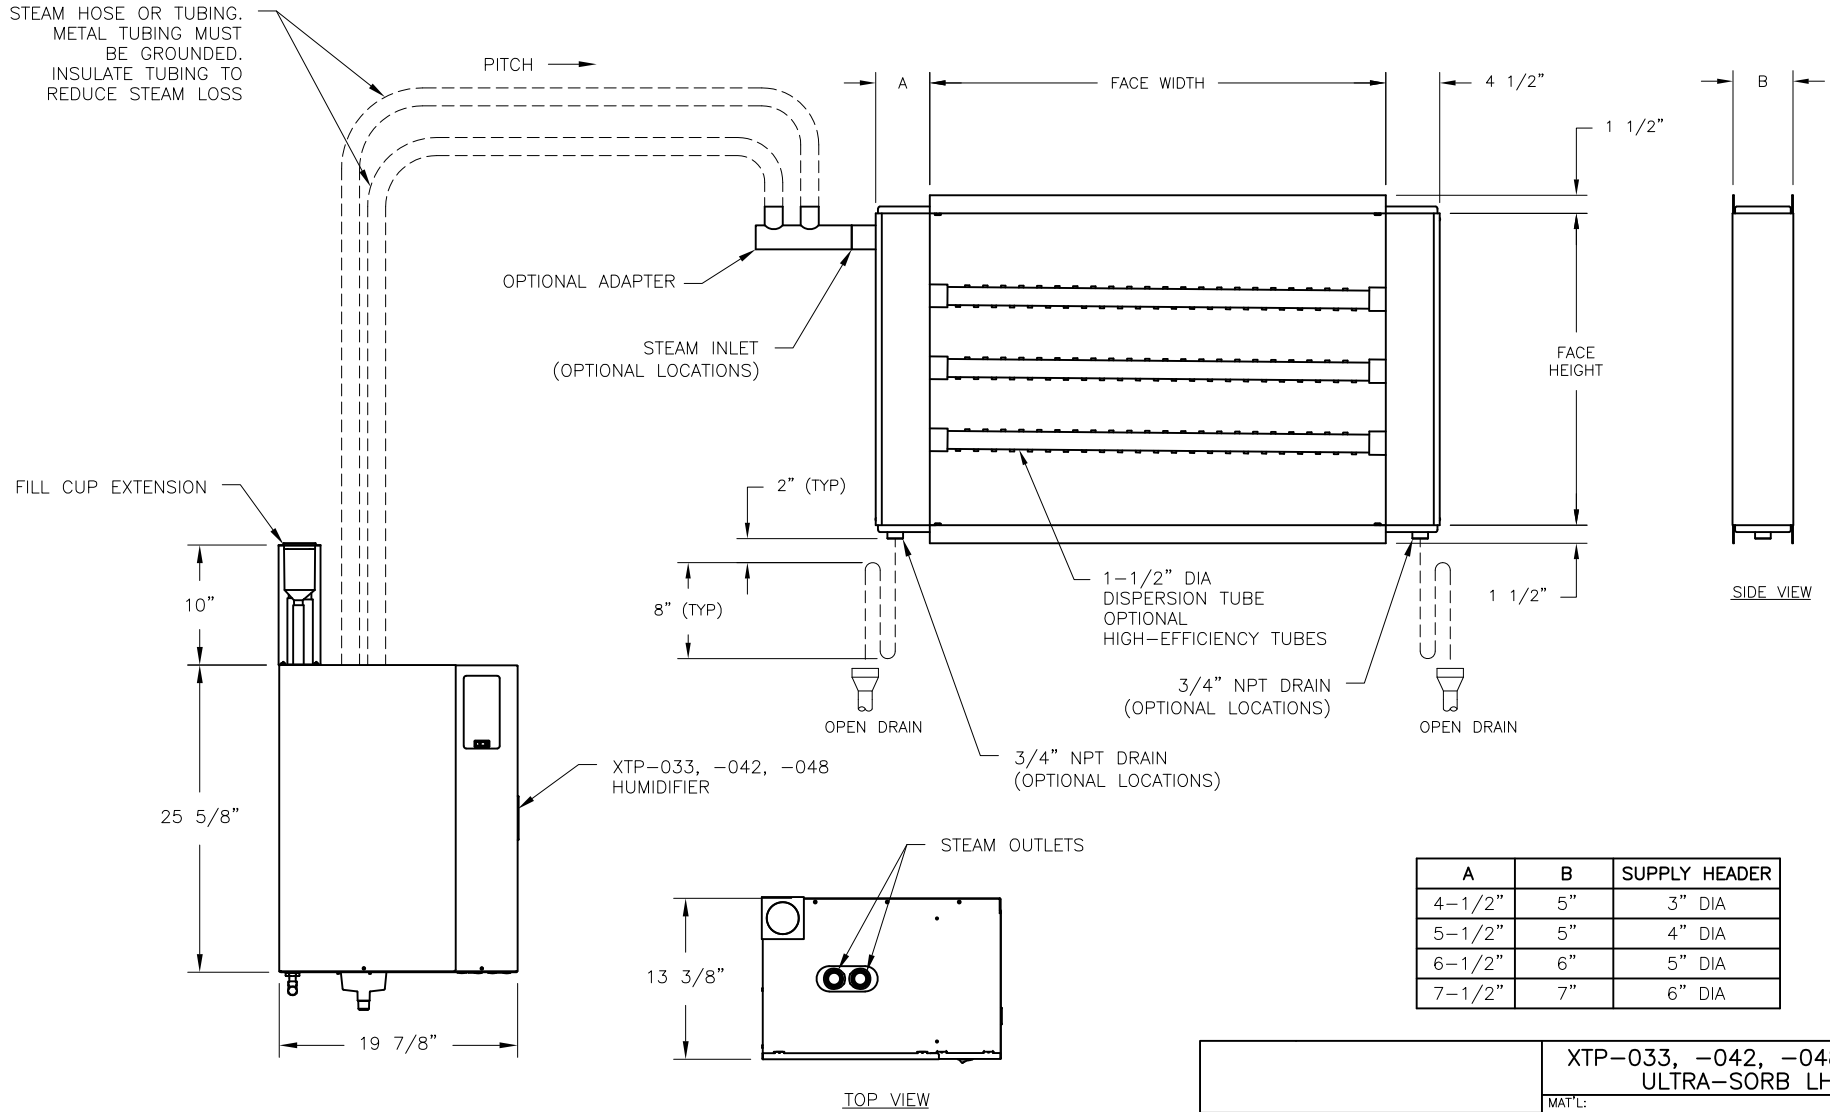

		XTP-033, -042, -048 WITH ULTRA-SORB LH	
		MAT'L:	
SCALE: 1:16	P/N	GENERIC SUBMITTAL	
DRAWN BY: JK			
DATE: 8/27/24			