



CONFIDENTIAL

DATE	REV	RECORD	DR
4/13	B	E.C.# 6053	JK

230 VOLT AC PRIMARY
 CLASS 2 TRANSFORMER,
 75 VA (BY DRI-STEEM, #408700-002)

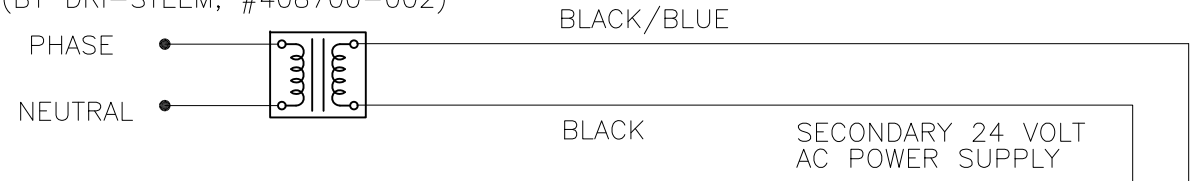


JCI HC-6406S-2005
 HUMIDISTAT (ROOM)
 OR
 JCI HC-6310-5
 HUMIDISTAT (DUCT)

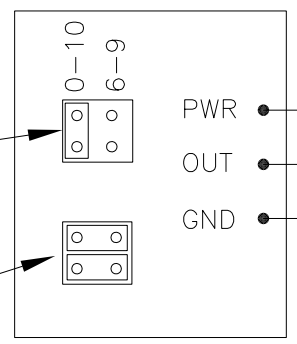


JUMPER SET ON
 0-10 VDC OUTPUT

JUMPERS SET ON
 RA (REVERSE ACTING)

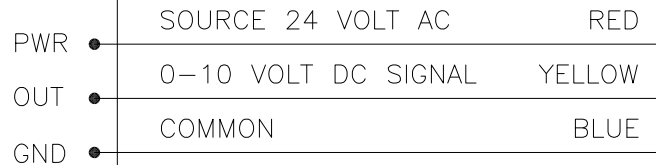

PNEUMATIC CONTROL
 AIR SUPPLY BY OTHERS
 21 KPA-90 KPA




CP8511-024
 SELECT 0-10 VDC INPUT
 SELECT DIRECT ACTING

PNEUMATIC FAN AIR
 MAX 690 KPA 34 M³/HR
 SUPPLIED BY OTHERS

PNEUMATIC STEAM
 VALVE 55-90 KPA

AREA TYPE
 STEAM HUMIDIFIER

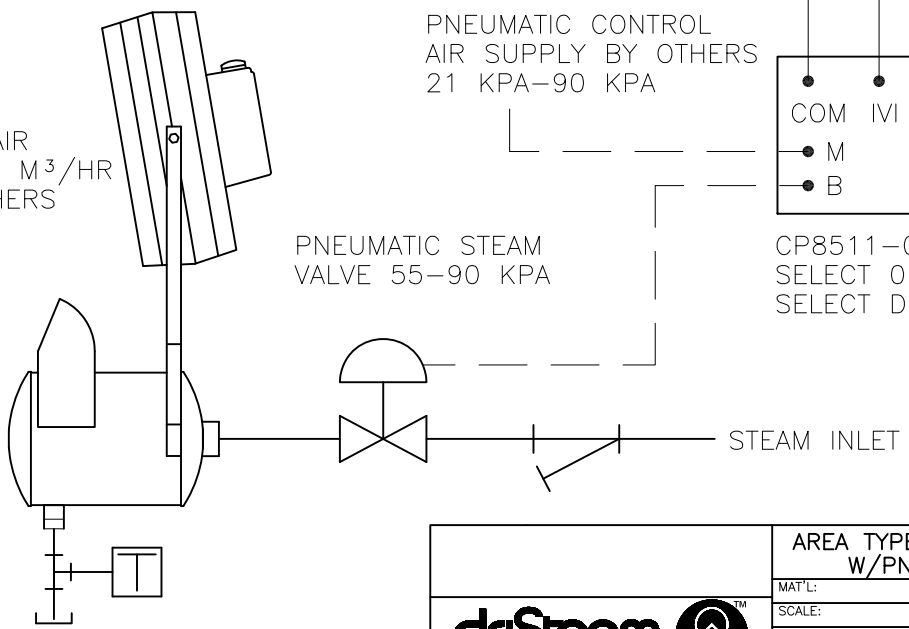

		AREA TYPE STEAM HUMIDIFIER W/PNEUMATIC VALVE	
		MAT'L:	
SCALE:		P/N	VLV-53
DRAWN BY:	JK		
DATE:	12/18/98		