
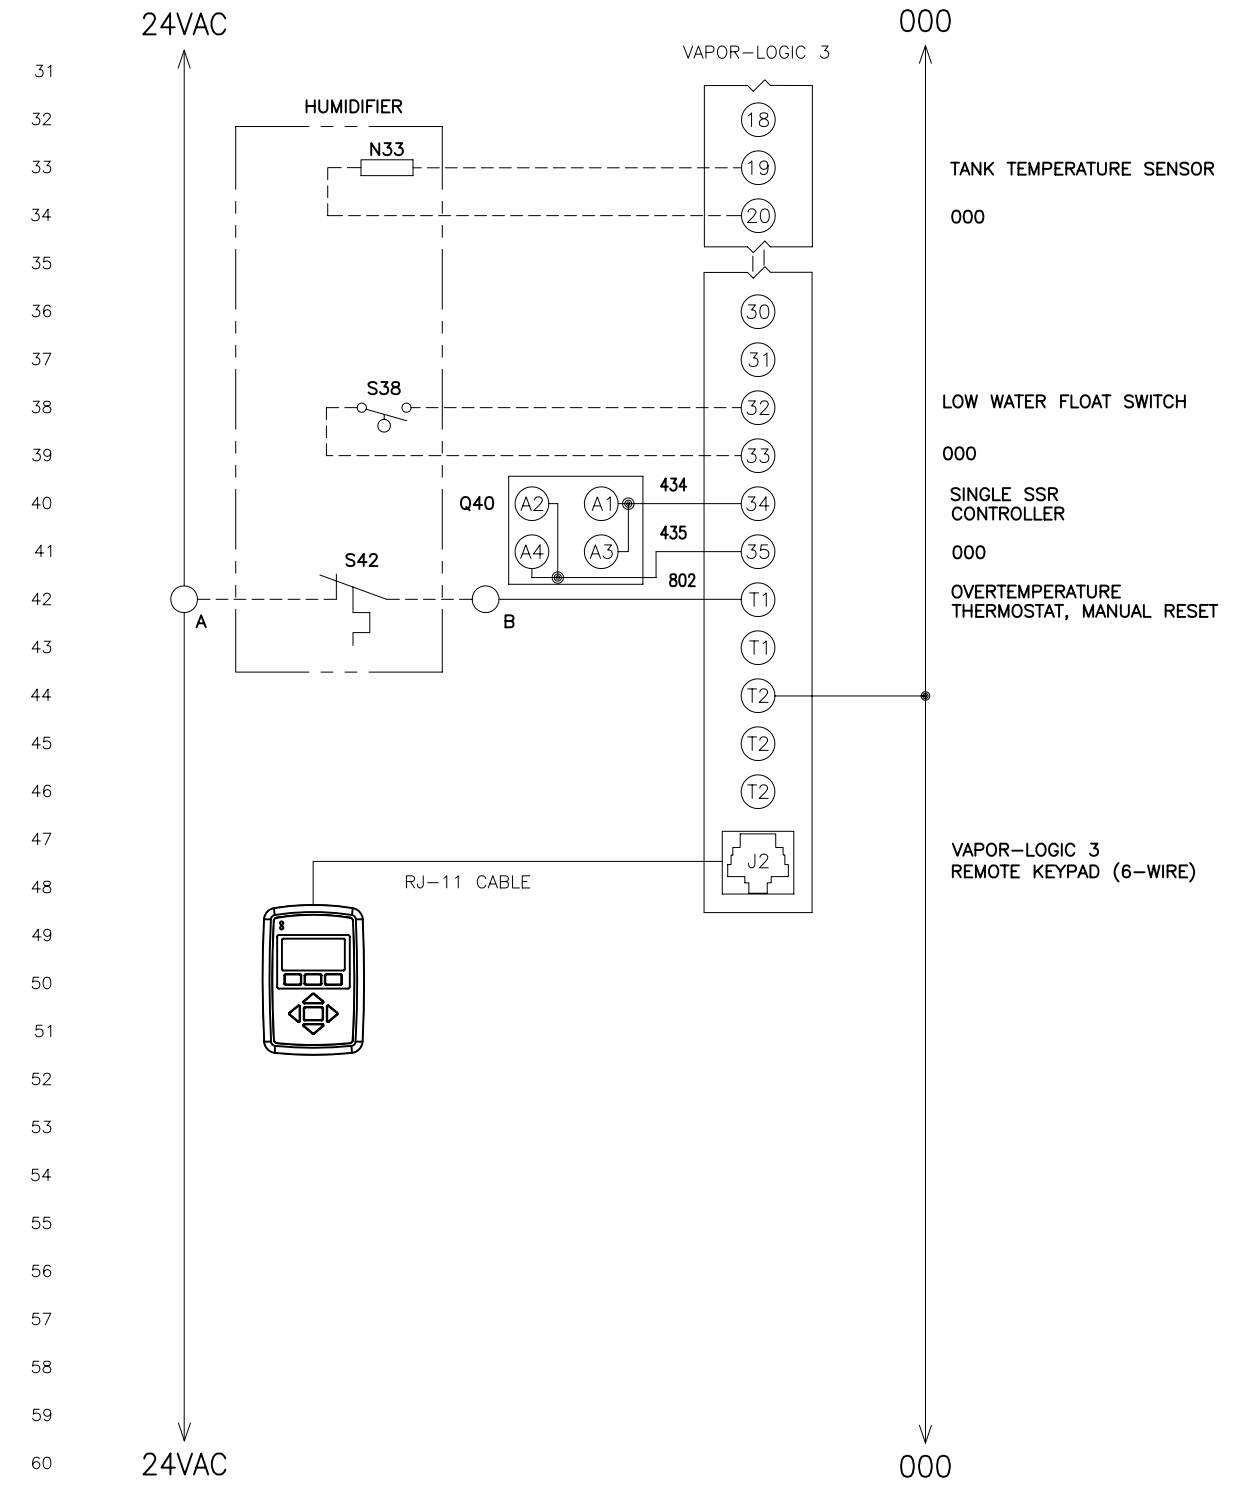


CRUV™ DI CE EVAPORATIVE HUMIDIFIER
FACTORY WIRING DIAGRAM W/ VL3®

DATE	REV	RECORD	DR
4/03	E	E.C. # 3848	JK
12/04	F	E.C. # 4194	JK
2/07	G	E.C. # 4504	JK

THIS SYSTEM IS CONFIGURED FOR CONTROL ARRANGEMENT

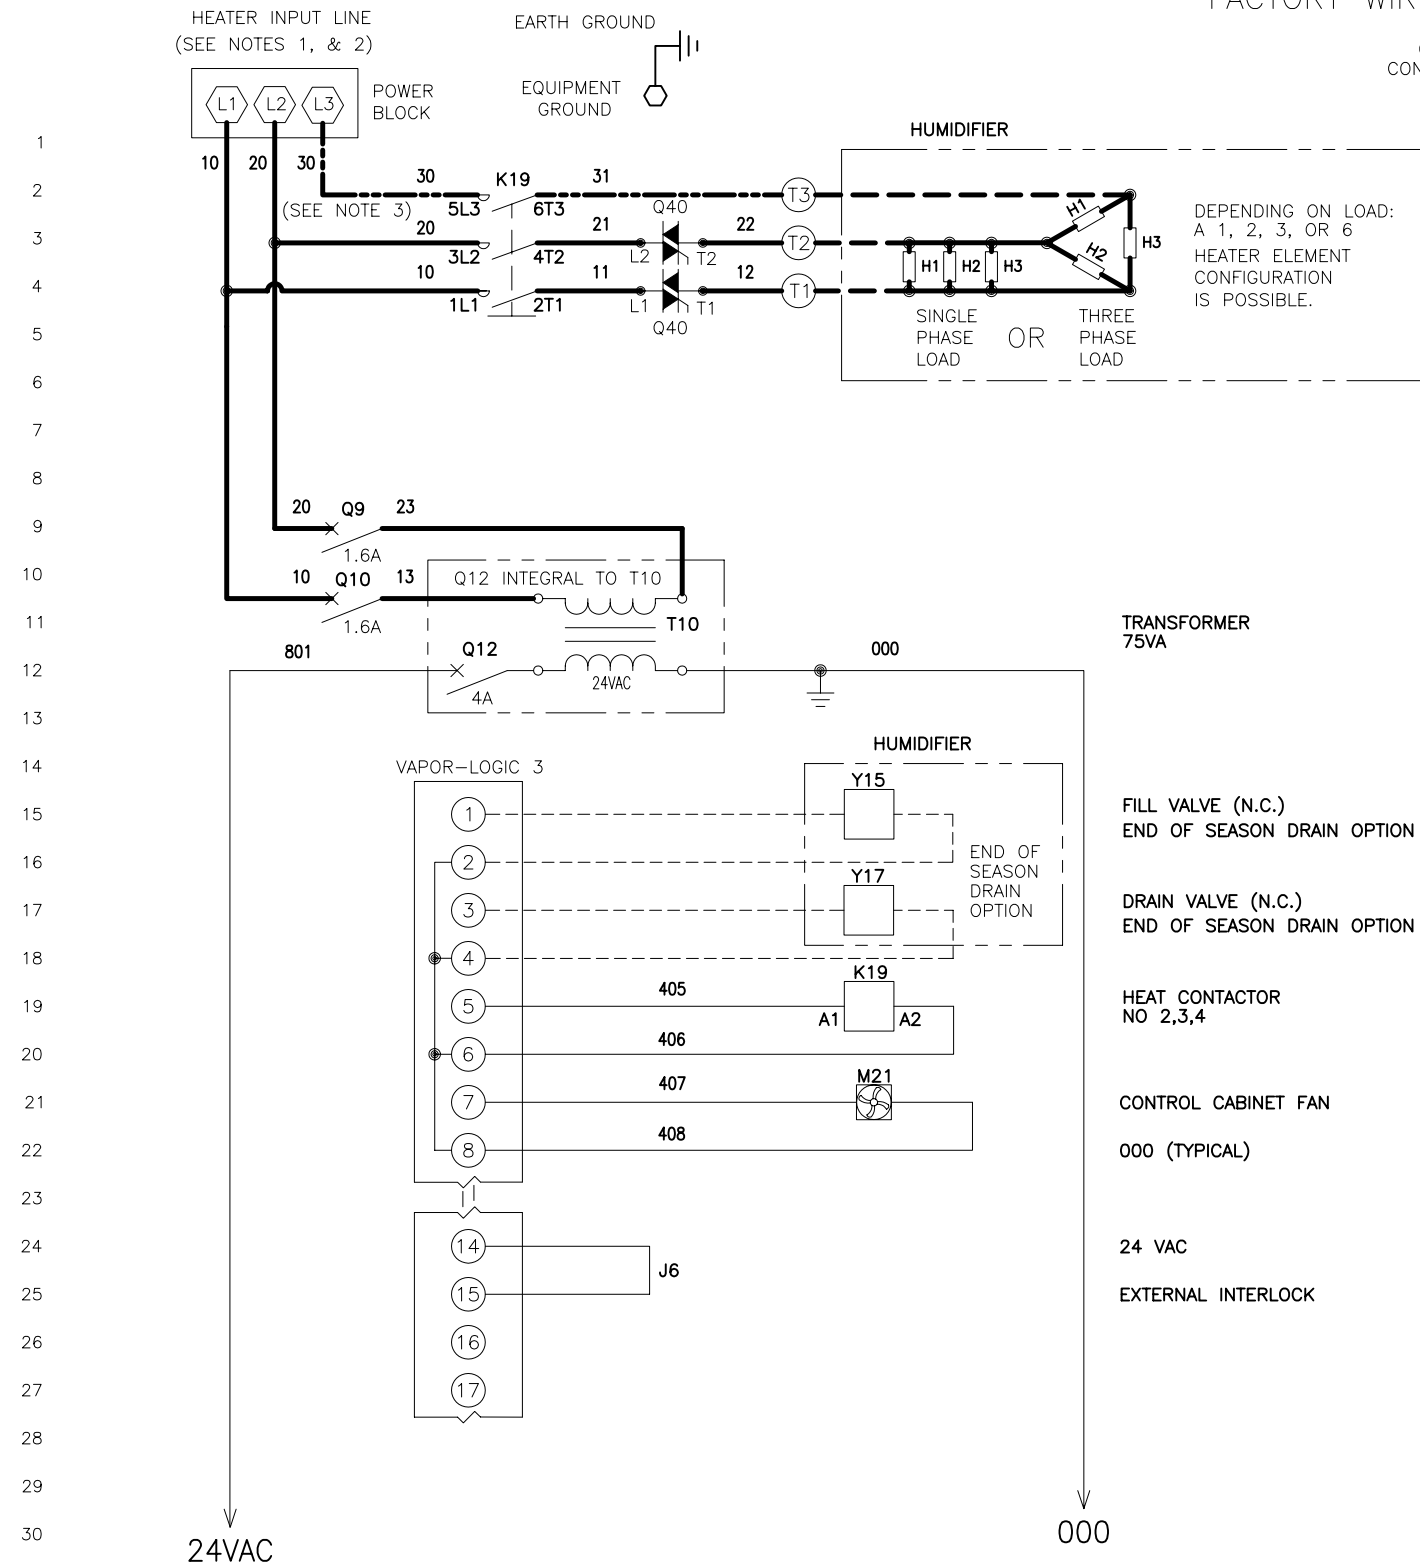

NOTES:
1. INPUT LINE _____ VOLTS _____ PHASE, FOR HEATER(S) CIRCUIT: OPERATES ON 50/60 HERTZ.

2. FOR WIRING SIZING, HEATER CIRCUIT LINE AMPS: L1 _____ L2 _____ L3 _____
RECOMMENDED LINE FUSING _____ AMPS. POWER BLOCK TERMINAL TORQUE _____ in-lbs|N-m
CONTACTOR TERMINAL TORQUE _____ in-lbs|N-m
VL3 CONTROL BOARD TORQUE _____ in-lbs|N-m

3. FOR THREE PHASE SYSTEM, THE THREE PHASE LOAD IS USED AND THIS WIRE IS FACTORY INSTALLED.

LEGEND

POWER WIRING	K RELAY/CONTACTOR	Y SOLENOID
CONTROL CIRCUIT WIRING	T TRANSFORMER	N SENSOR
	Q CIRCUIT BREAKER	J JUMPER
FIELD WIRING	S SWITCH	E WATER PROBE
	H HEATER	M MOTOR/FAN

PROGRAM CODE: _____ MODEL: _____ ORDER NO: _____

BREAK TO EXTERNAL CONNECTIONS DIAGRAM

CR-CE-VL3-5

DRISTEEM

CRUV, DI WATER SINGLE SSR CE DIAGRAM

SCALE: _____ P/N CR-CE-VL3-5

DRAWN BY: THB

DATE: 10/7/99