
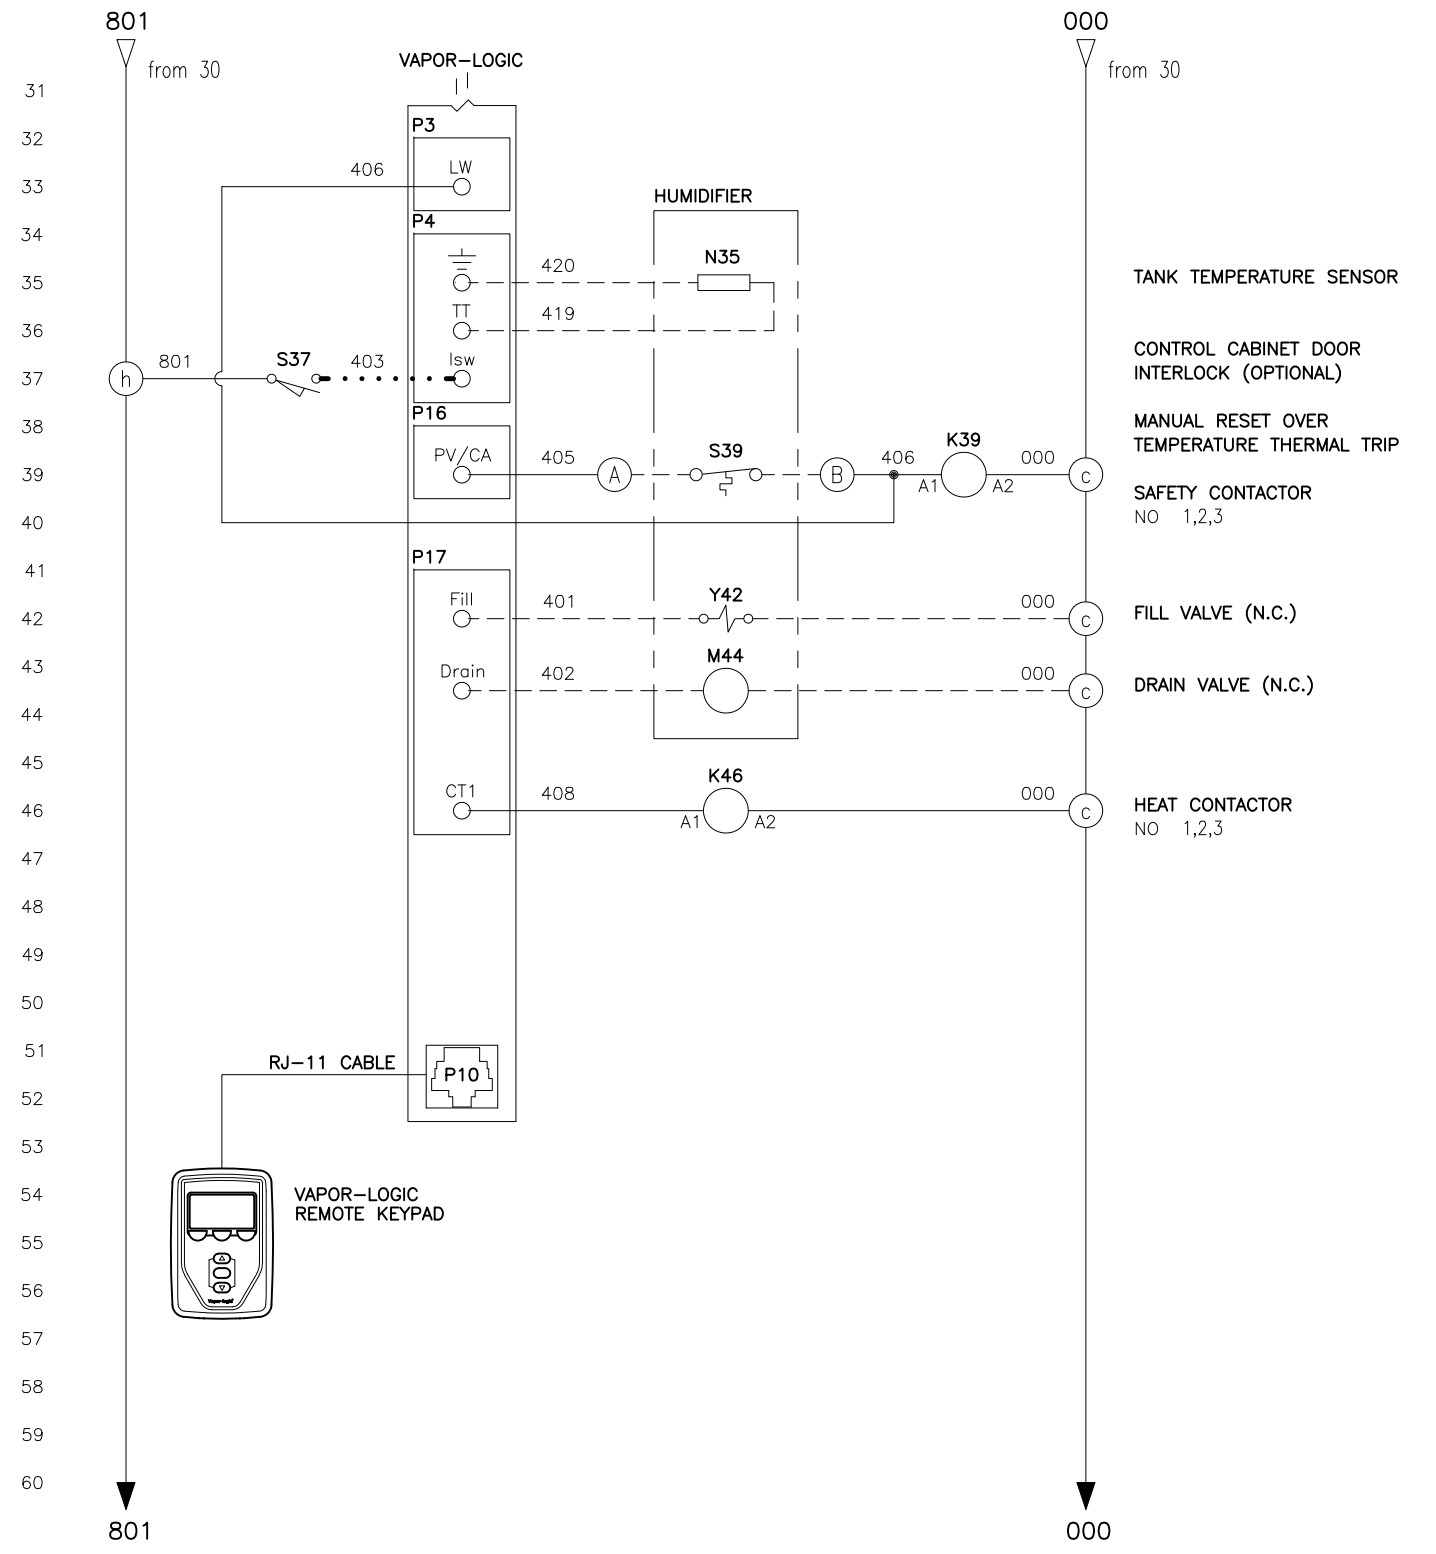


CRUV™ EVAPORATIVE HUMIDIFIER FACTORY WIRING DIAGRAM WITH VAPOR-LOGIC

DATE	REV	RECORD	DR
5/15	A	E.C.# 6396	JK
4/17	B	E.C.# 6551	JK
4/20	C	E.C.# 6969	JK

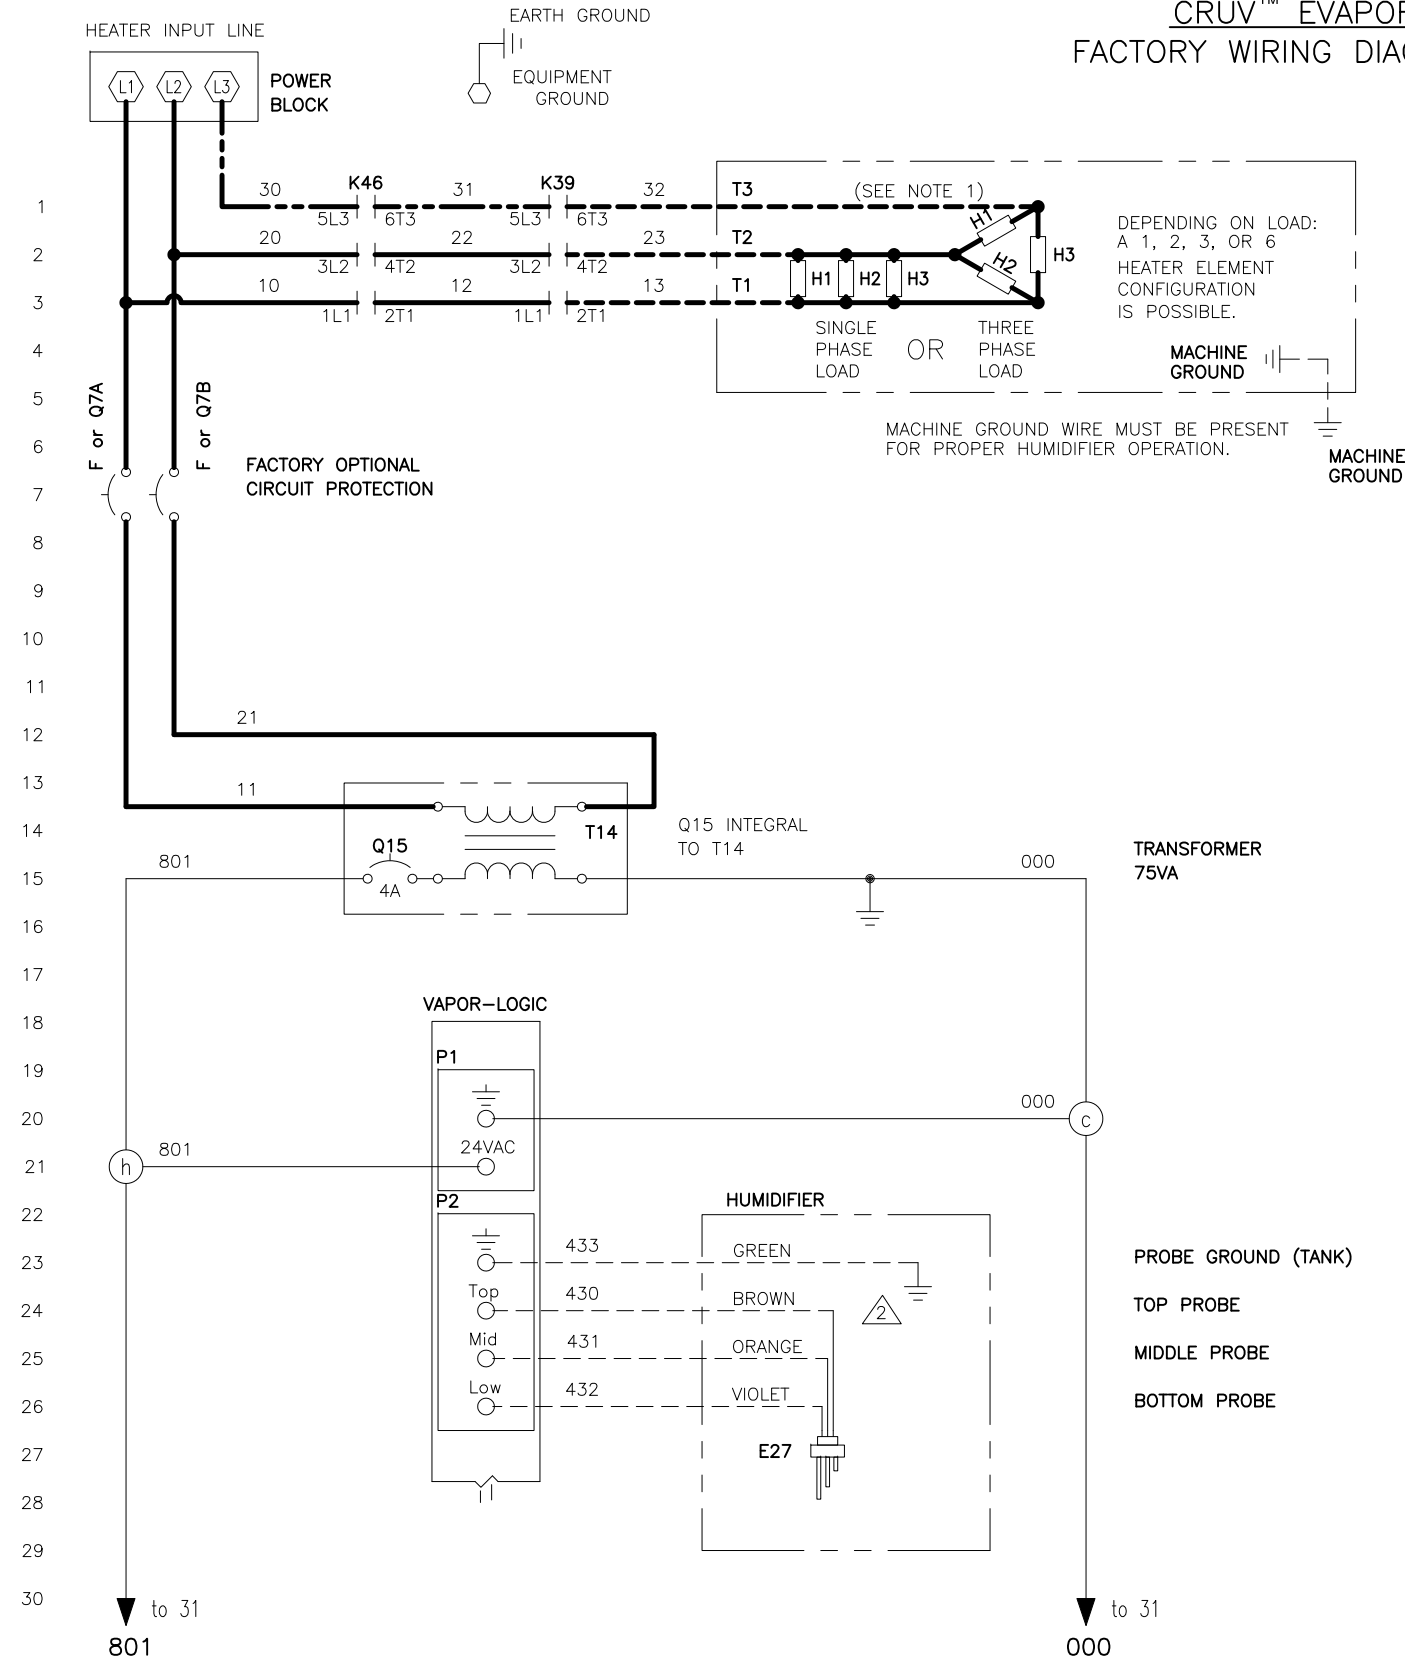

- NOTES:
- FOR THREE PHASE SYSTEM, THE THREE PHASE LOAD IS USED AND THIS WIRE IS FACTORY INSTALLED.
 - WATER LEVEL PROBE GROUND MUST BE CONNECTED TO TANK FOR PROPER HUMIDIFIER OPERATION.
 - REFER TO CRUV ELECTRICAL DATA SHEET.

POWER WIRING	LEGEND	
CONTROL CIRCUIT WIRING	K RELAY/CONTACTOR	Y SOLENOID
FIELD WIRING	T TRANSFORMER	N SENSOR
OPTIONAL FACTORY	Q CIRCUIT BREAKER	J JUMPER
OPTIONAL FIELD	S SWITCH	E WATER PROBE
	H HEATER	M MOTOR/FAN
	F FUSE	

BREAK TO EXTERNAL CONNECTIONS DIAGRAM

	CRUV, STANDARD WATER DIAGRAM	
	MAT'L:	
	SCALE:	P/N
	DRAWN BY: JK	CR-VL-1
DATE: 5/18/15		