
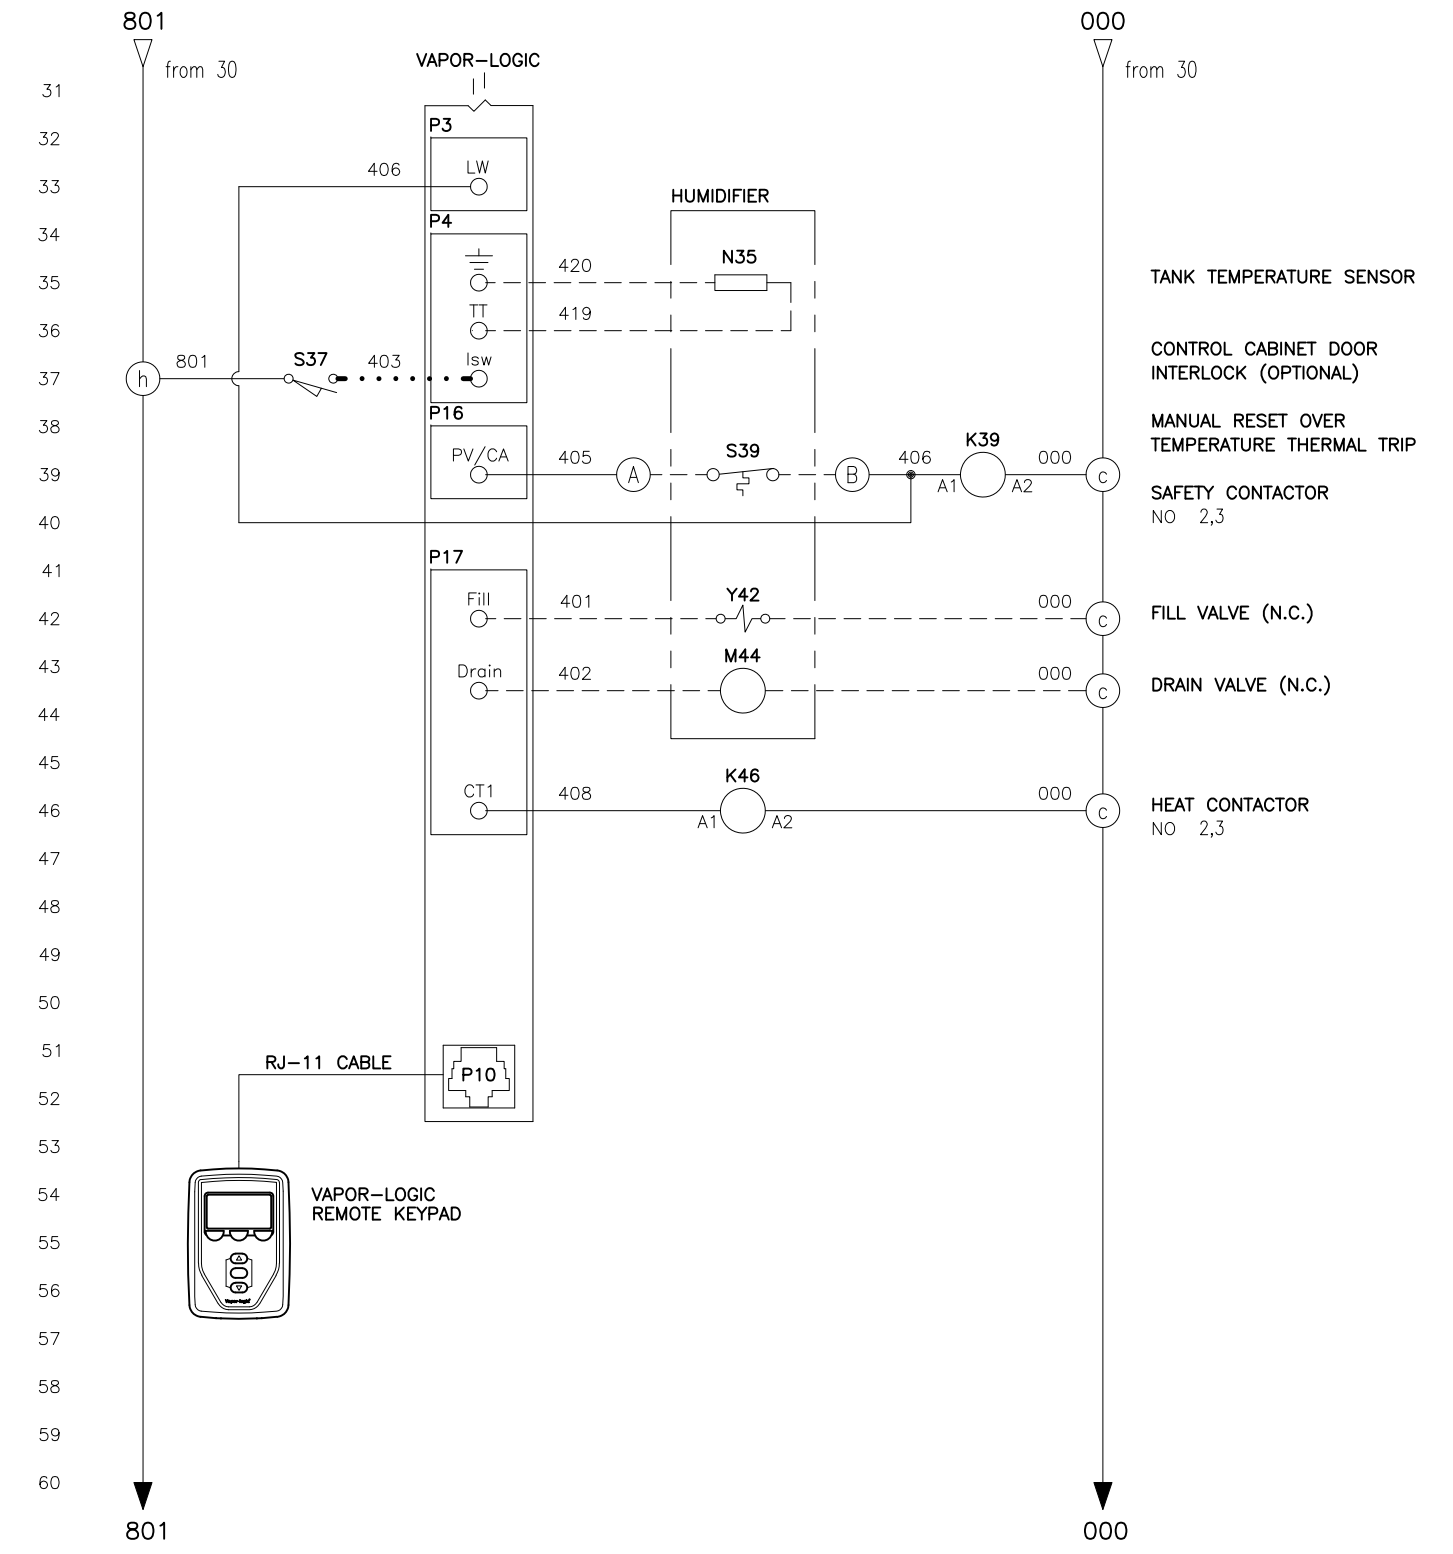


CRUV™ EVAPORATIVE HUMIDIFIER FACTORY WIRING DIAGRAM WITH VAPOR-LOGIC

DATE	REV	RECORD	DR
5/15	A	E.C.# 6396	JK
4/17	B	E.C.# 6551	JK
4/21	C	E.C.# 6969	JK

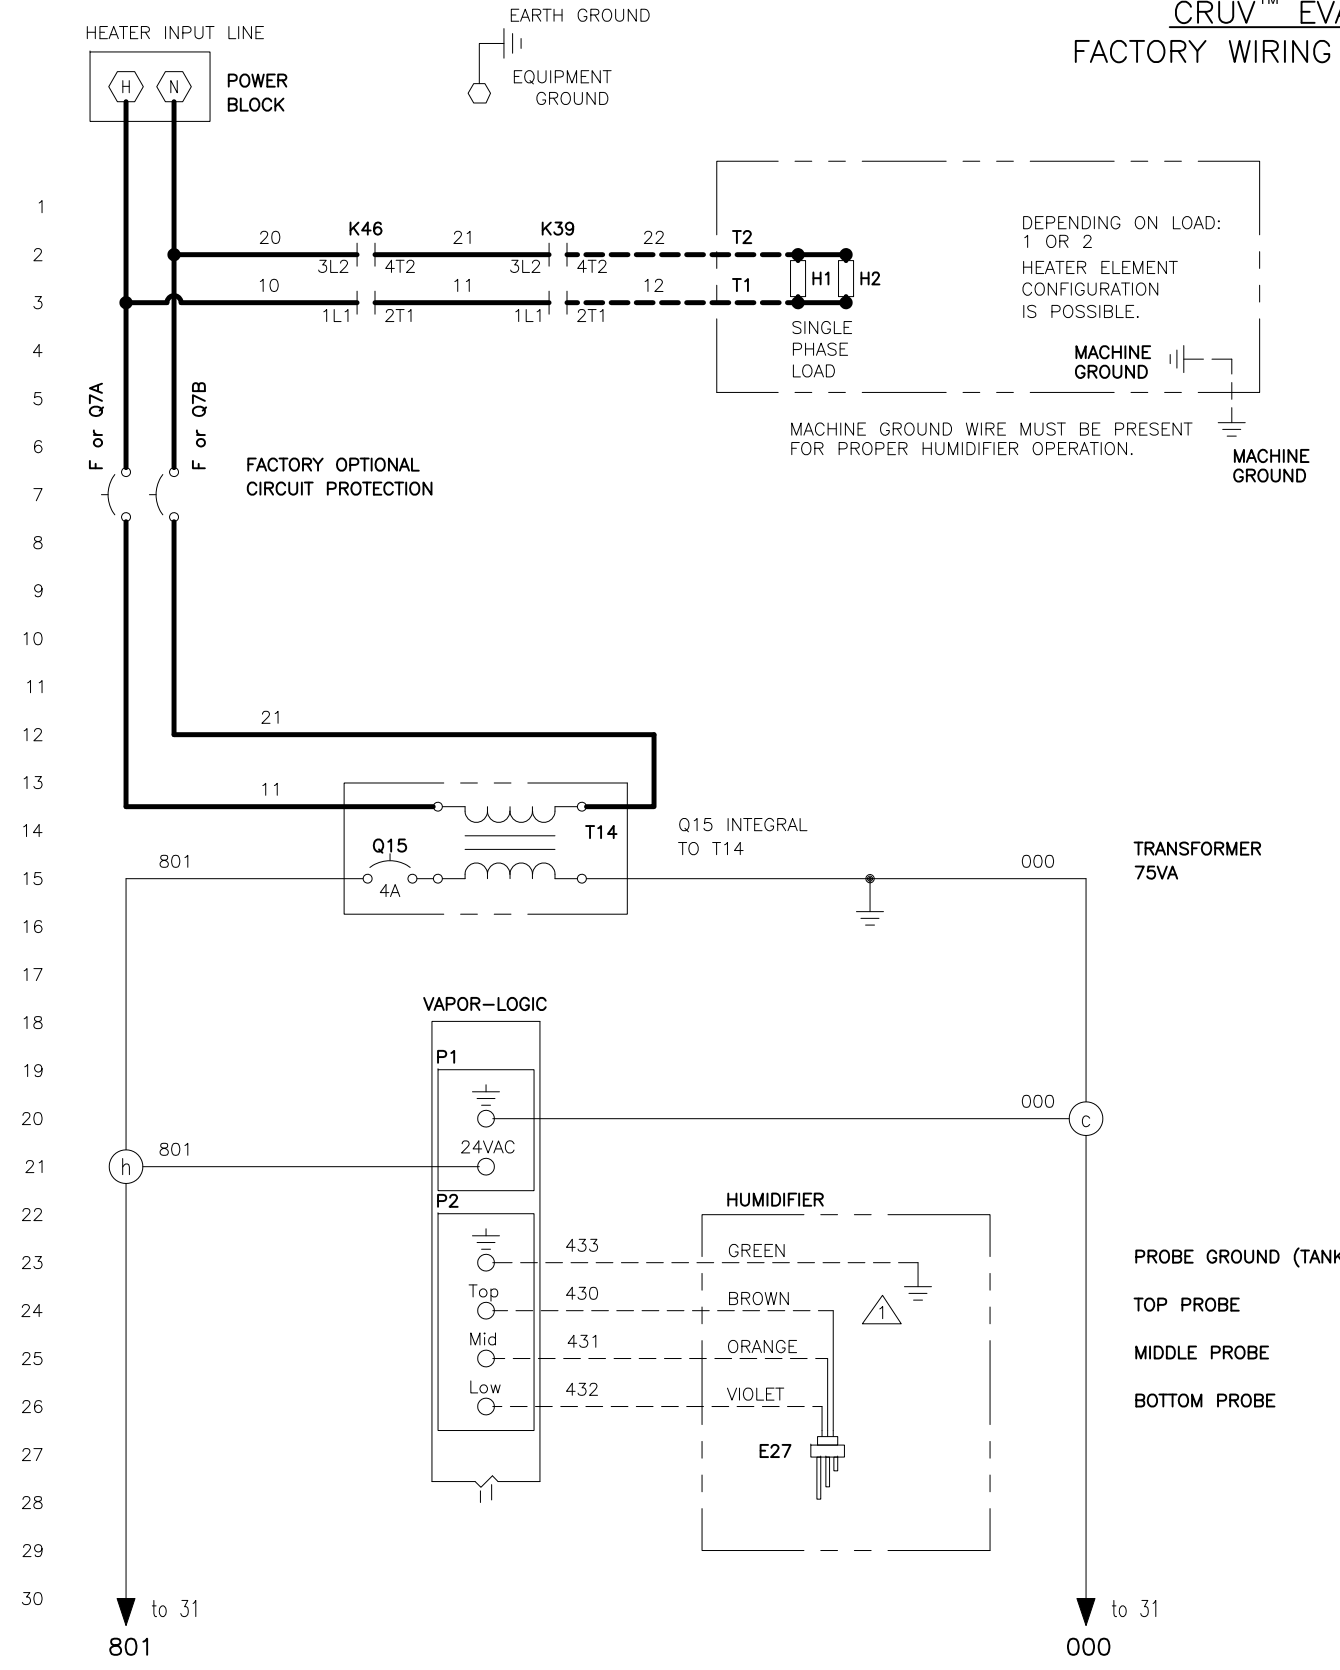

NOTES:
 1. WATER LEVEL PROBE GROUND MUST BE CONNECTED TO TANK FOR PROPER HUMIDIFIER OPERATION.
 2. REFER TO CRUV ELECTRICAL DATA SHEET.

- POWER WIRING**
CONTROL CIRCUIT WIRING
FIELD WIRING
OPTIONAL FACTORY
OPTIONAL FIELD
- LEGEND**
- | | | | |
|---|-----------------|---|-------------|
| K | RELAY/CONTACTOR | Y | SOLENOID |
| T | TRANSFORMER | N | SENSOR |
| Q | CIRCUIT BREAKER | J | JUMPER |
| S | SWITCH | E | WATER PROBE |
| H | HEATER | M | MOTOR/FAN |
| F | FUSE | | |

BREAK TO EXTERNAL CONNECTIONS DIAGRAM

CRUV, STANDARD WATER 120 VOLT DIAGRAM	
MAT'L:	
SCALE:	P/N
DRAWN BY: JK	CR-VL-11
DATE: 5/18/15	