


CRUV™ EVAPORATIVE HUMIDIFIER FACTORY WIRING DIAGRAM WITH VAPOR-LOGIC

DATE	REV	RECORD	DR
5/15	A	E.C.# 6396	JK
4/17	B	E.C.# 6551	JK
4/21	C	E.C.# 6969	JK

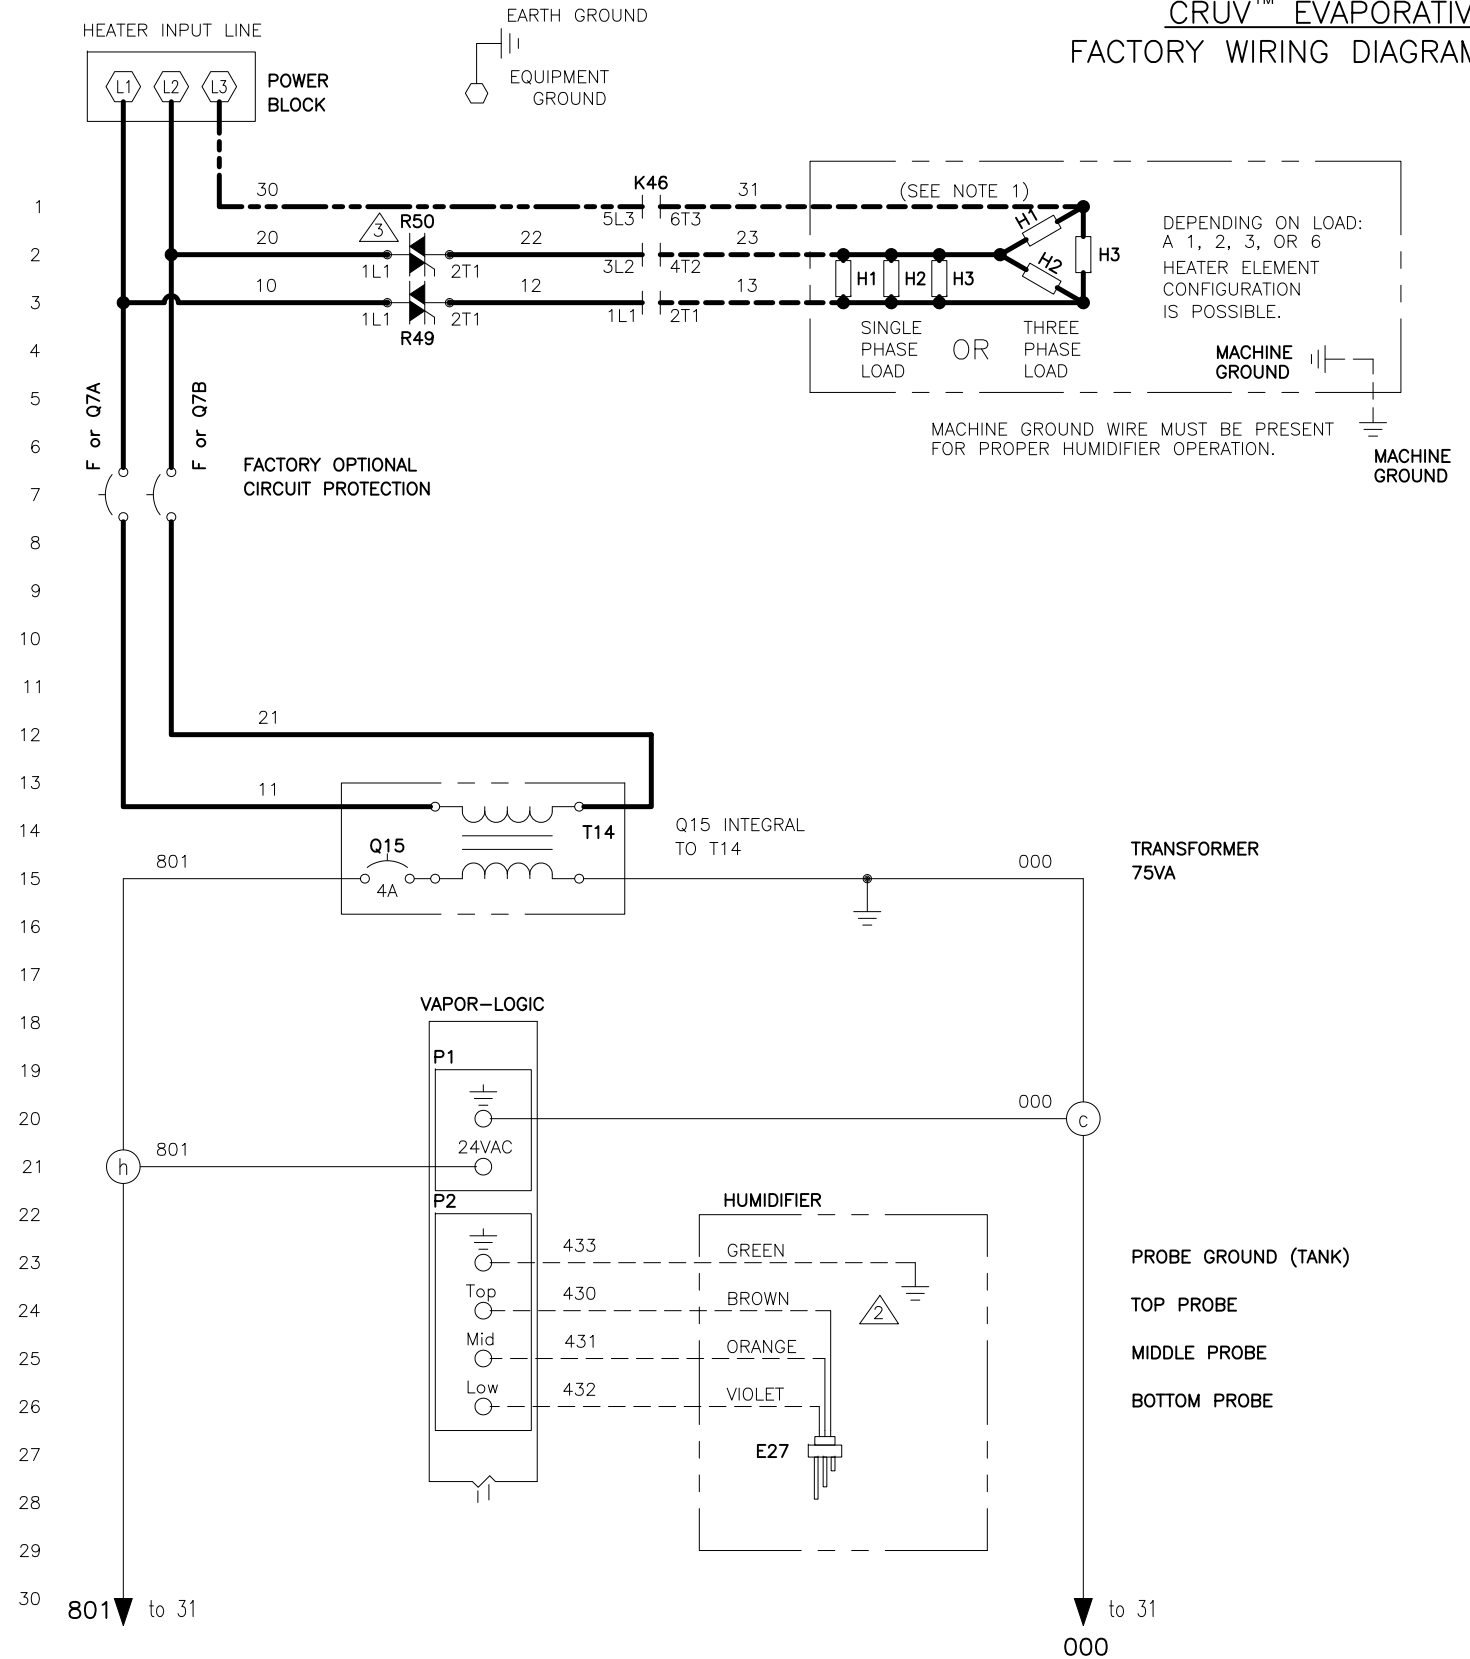


- NOTES:
- FOR THREE PHASE SYSTEM, THE THREE PHASE LOAD IS USED AND THIS WIRE IS FACTORY INSTALLED.
 - WATER LEVEL PROBE GROUND MUST BE CONNECTED TO TANK FOR PROPER HUMIDIFIER OPERATION.
 - ONLY USED ON THREE PHASE POWER.
 - REFER TO CRUV ELECTRICAL DATA SHEET.

POWER WIRING
CONTROL CIRCUIT WIRING
FIELD WIRING
OPTIONAL FACTORY
OPTIONAL FIELD

LEGEND

K RELAY/CONTACTOR	Y SOLENOID
T TRANSFORMER	N SENSOR
Q CIRCUIT BREAKER	J JUMPER
S SWITCH	E WATER PROBE
H HEATER	M MOTOR/FAN
F FUSE	R SOLID STATE RELAY

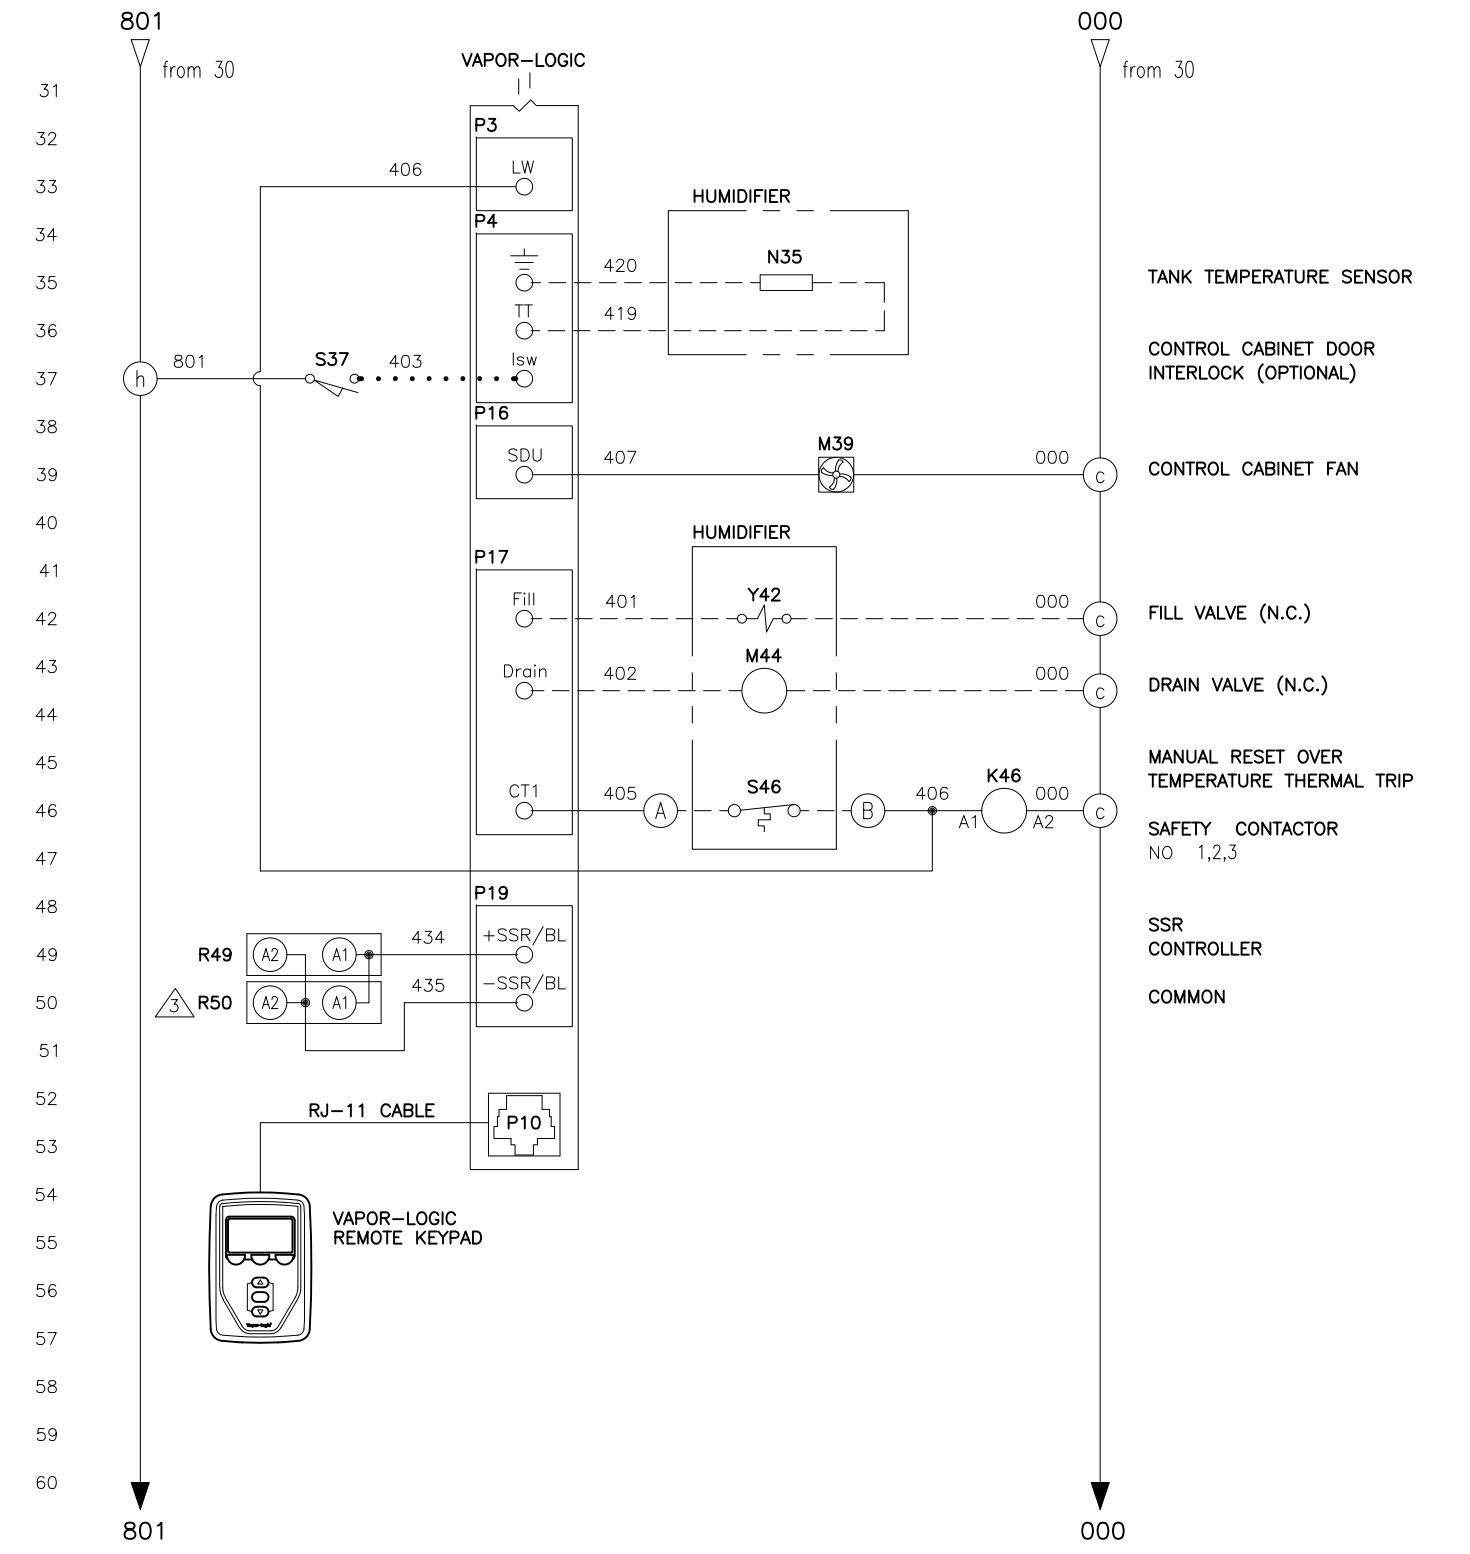

BREAK TO EXTERNAL CONNECTIONS DIAGRAM

	CRUV, STANDARD WATER, SSR WIRING DIAGRAM	
	MAT'L:	
	SCALE:	P/N
	DRAWN BY: JK	CR-VL-15
		DATE: 5/18/15