
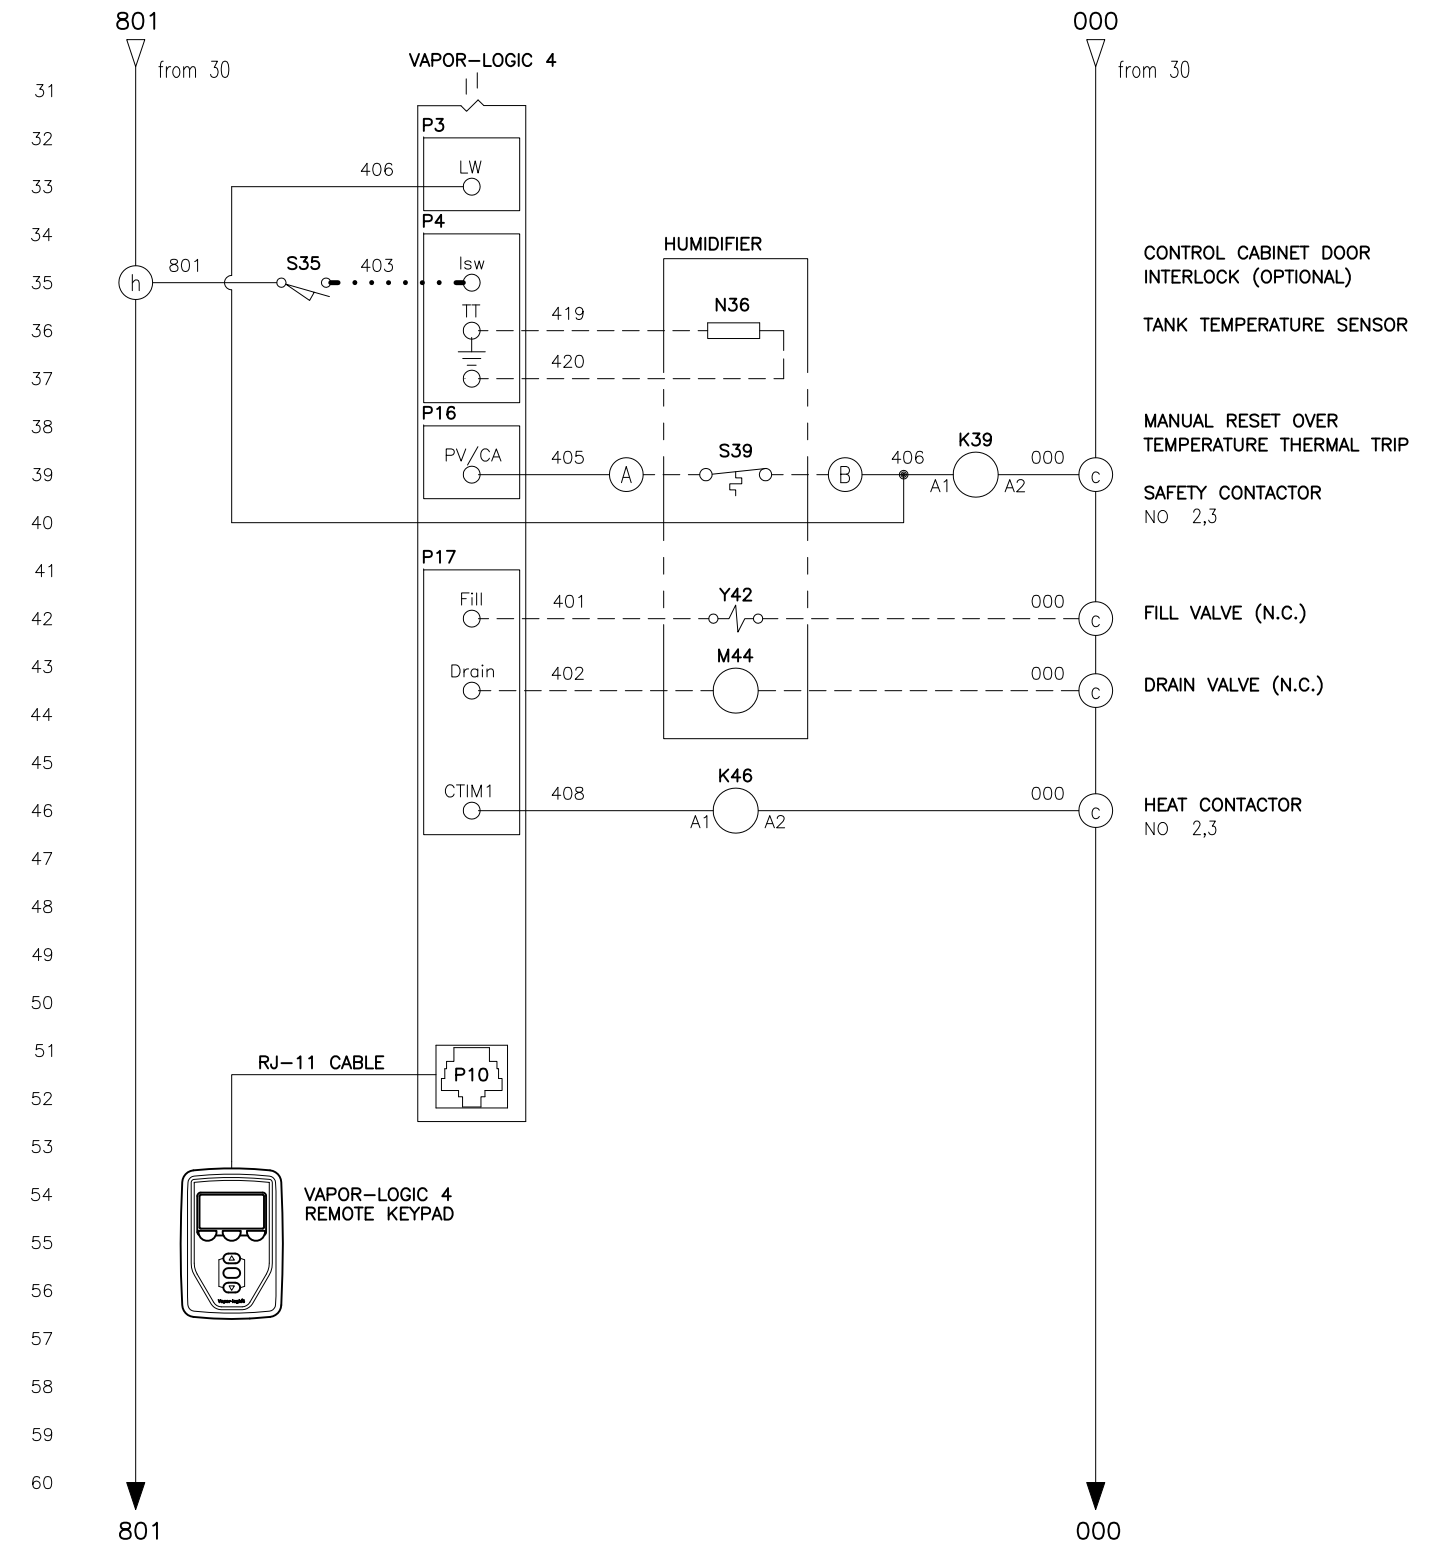


CRUV™ EVAPORATIVE HUMIDIFIER FACTORY WIRING DIAGRAM WITH VAPOR-LOGIC 4

DATE	REV	RECORD	DR
5/10	A	E.C.# 5005	JK
2/11	B	E.C.# 5316	JK
5/11	C	E.C.# 5803	JK

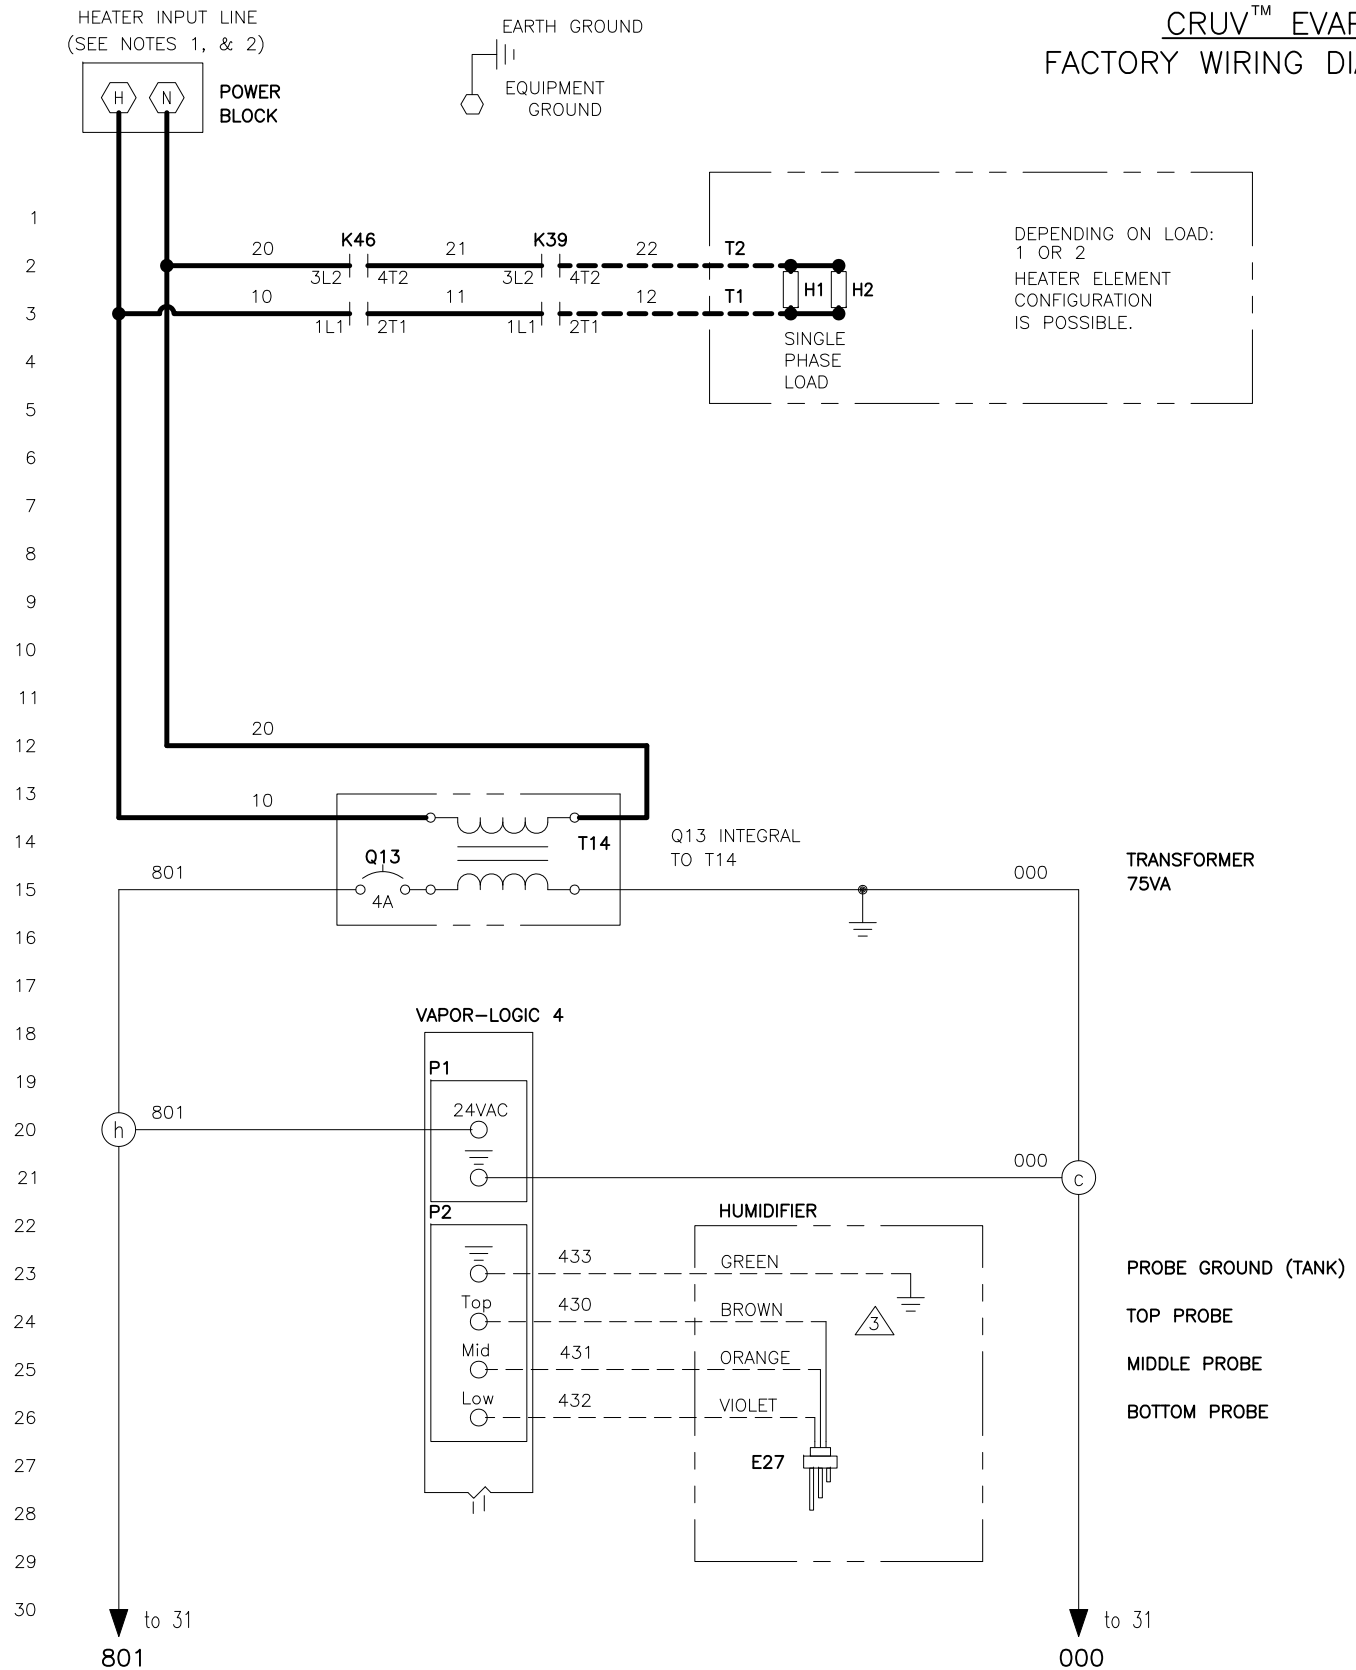

NOTES:
1. INPUT LINE 120 VOLTS 1 PHASE, FOR HEATER(S) CIRCUIT: OPERATES ON 50/60 HERTZ.

2. FOR WIRING SIZING, HEATER CIRCUIT LINE AMPS: N _____
RECOMMENDED LINE FUSING _____ AMPS. POWER BLOCK TERMINAL TORQUE _____ in-lbs|N-m
CONTACTOR TERMINAL TORQUE _____ in-lbs|N-m
VL4 CONTROL BOARD TORQUE _____ in-lbs|N-m

⚠ WATER LEVEL PROBE GROUND MUST BE CONNECTED TO TANK FOR PROPER HUMIDIFIER OPERATION.

POWER WIRING
CONTROL CIRCUIT WIRING
FIELD WIRING
OPTIONAL FACTORY
OPTIONAL FIELD

LEGEND

- | | | | |
|---|-----------------|---|-------------|
| K | RELAY/CONTACTOR | Y | SOLENOID |
| T | TRANSFORMER | N | SENSOR |
| Q | CIRCUIT BREAKER | J | JUMPER |
| S | SWITCH | E | WATER PROBE |
| H | HEATER | M | MOTOR/FAN |
| F | FUSE | | |

⚡ BREAK TO EXTERNAL CONNECTIONS DIAGRAM

MODEL: _____ ORDER NO: _____

DRISTEEM		DOMESTIC CRUV, STANDARD 120 VOLT WATER DIAGRAM	
SCALE: _____		P/N _____	
DRAWN BY: KROG		CR-VL4-11	
DATE: 5/7/10			