
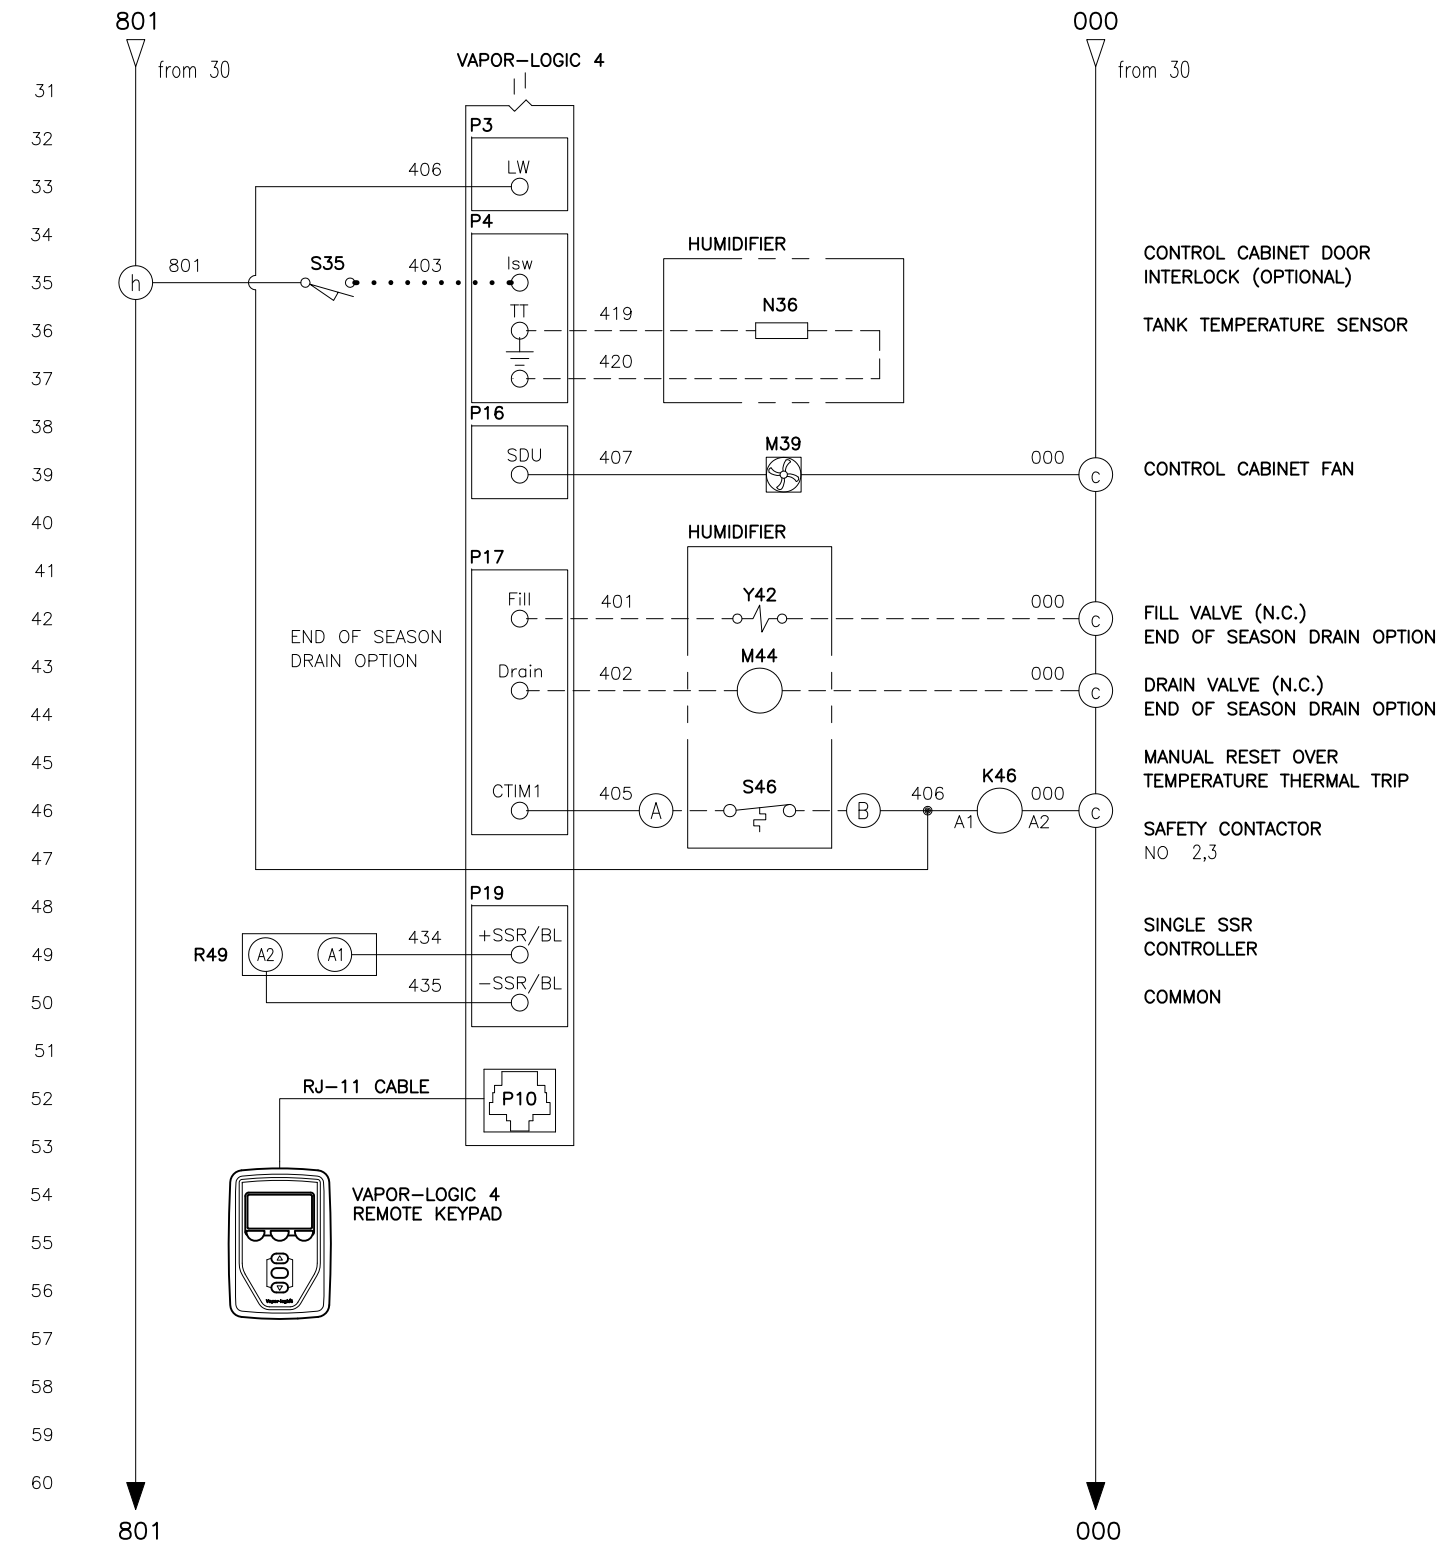


# CRUV™ DI EVAPORATIVE HUMIDIFIER FACTORY WIRING DIAGRAM WITH VAPOR-LOGIC 4

DATE	REV	RECORD	DR
5/10	A	E.C.# 5005	JK
5/12	B	E.C.# 5803	JK

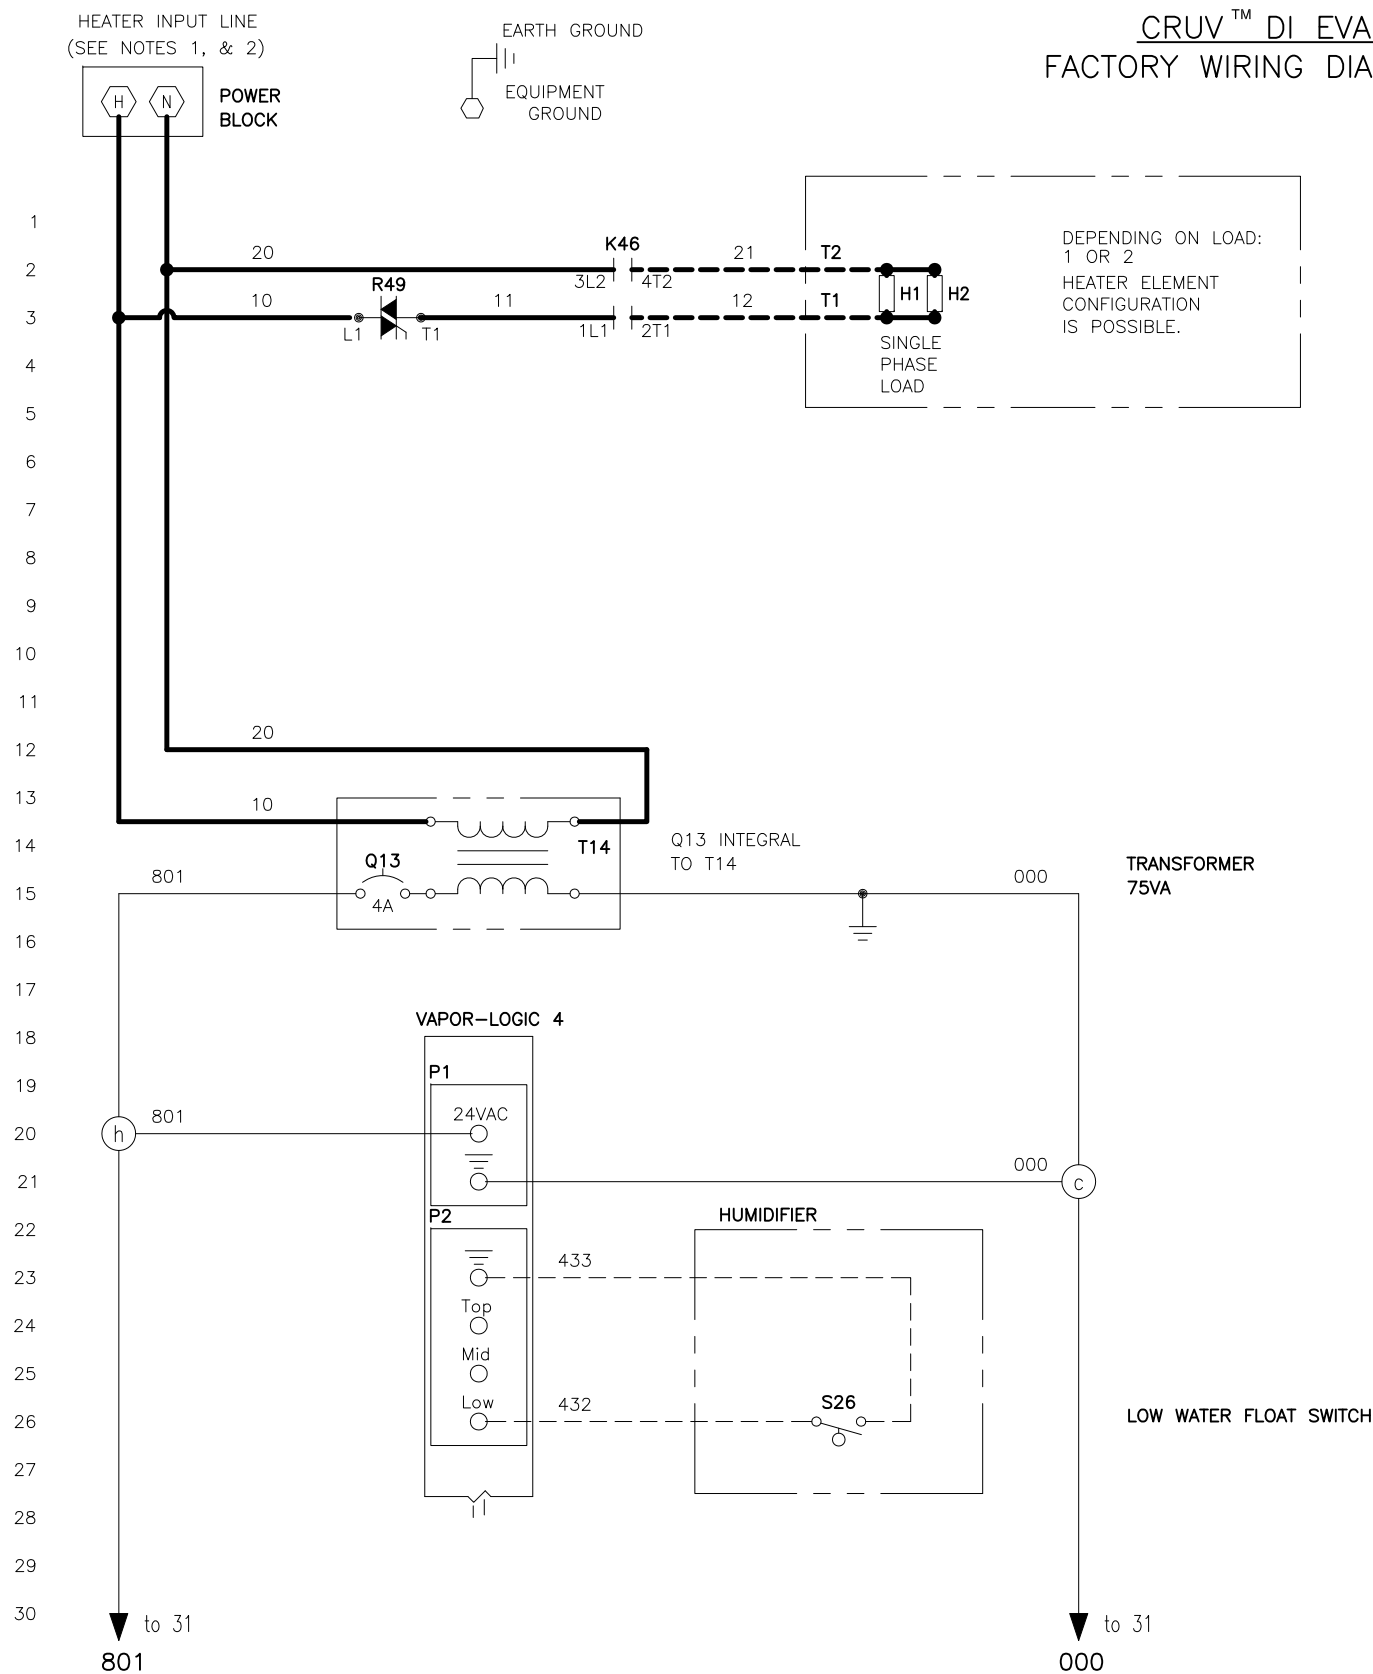

NOTES:  
1. INPUT LINE 120 VOLTS 1 PHASE, FOR HEATER(S) CIRCUIT: OPERATES ON 50/60 HERTZ.


2. FOR WIRING SIZING, HEATER CIRCUIT LINE AMPS: N \_\_\_\_\_  
RECOMMENDED LINE FUSING \_\_\_\_\_ AMPS. POWER BLOCK TERMINAL TORQUE \_\_\_\_\_ in-lbs|N-m

3. WATER LEVEL PROBE GROUND MUST BE CONNECTED TO TANK FOR PROPER HUMIDIFIER OPERATION.

**POWER WIRING**  
CONTROL CIRCUIT WIRING  
FIELD WIRING  
OPTIONAL FACTORY  
OPTIONAL FIELD

**LEGEND**

- |                   |                     |
|-------------------|---------------------|
| K RELAY/CONTACTOR | Y SOLENOID          |
| T TRANSFORMER     | N SENSOR            |
| Q CIRCUIT BREAKER | J JUMPER            |
| S SWITCH          | E WATER PROBE       |
| H HEATER          | M MOTOR/FAN         |
| F FUSE            | R SOLID STATE RELAY |



MODEL: \_\_\_\_\_ ORDER NO: \_\_\_\_\_

<b>DOMESTIC CRUV, DI WATER, SINGLE SSR 120 VOLT WIRING DIAGRAM</b>	
MAT'L:	P/N
SCALE:	CR-VL4-14
DRAWN BY: KROG	DATE: 5/7/10

