
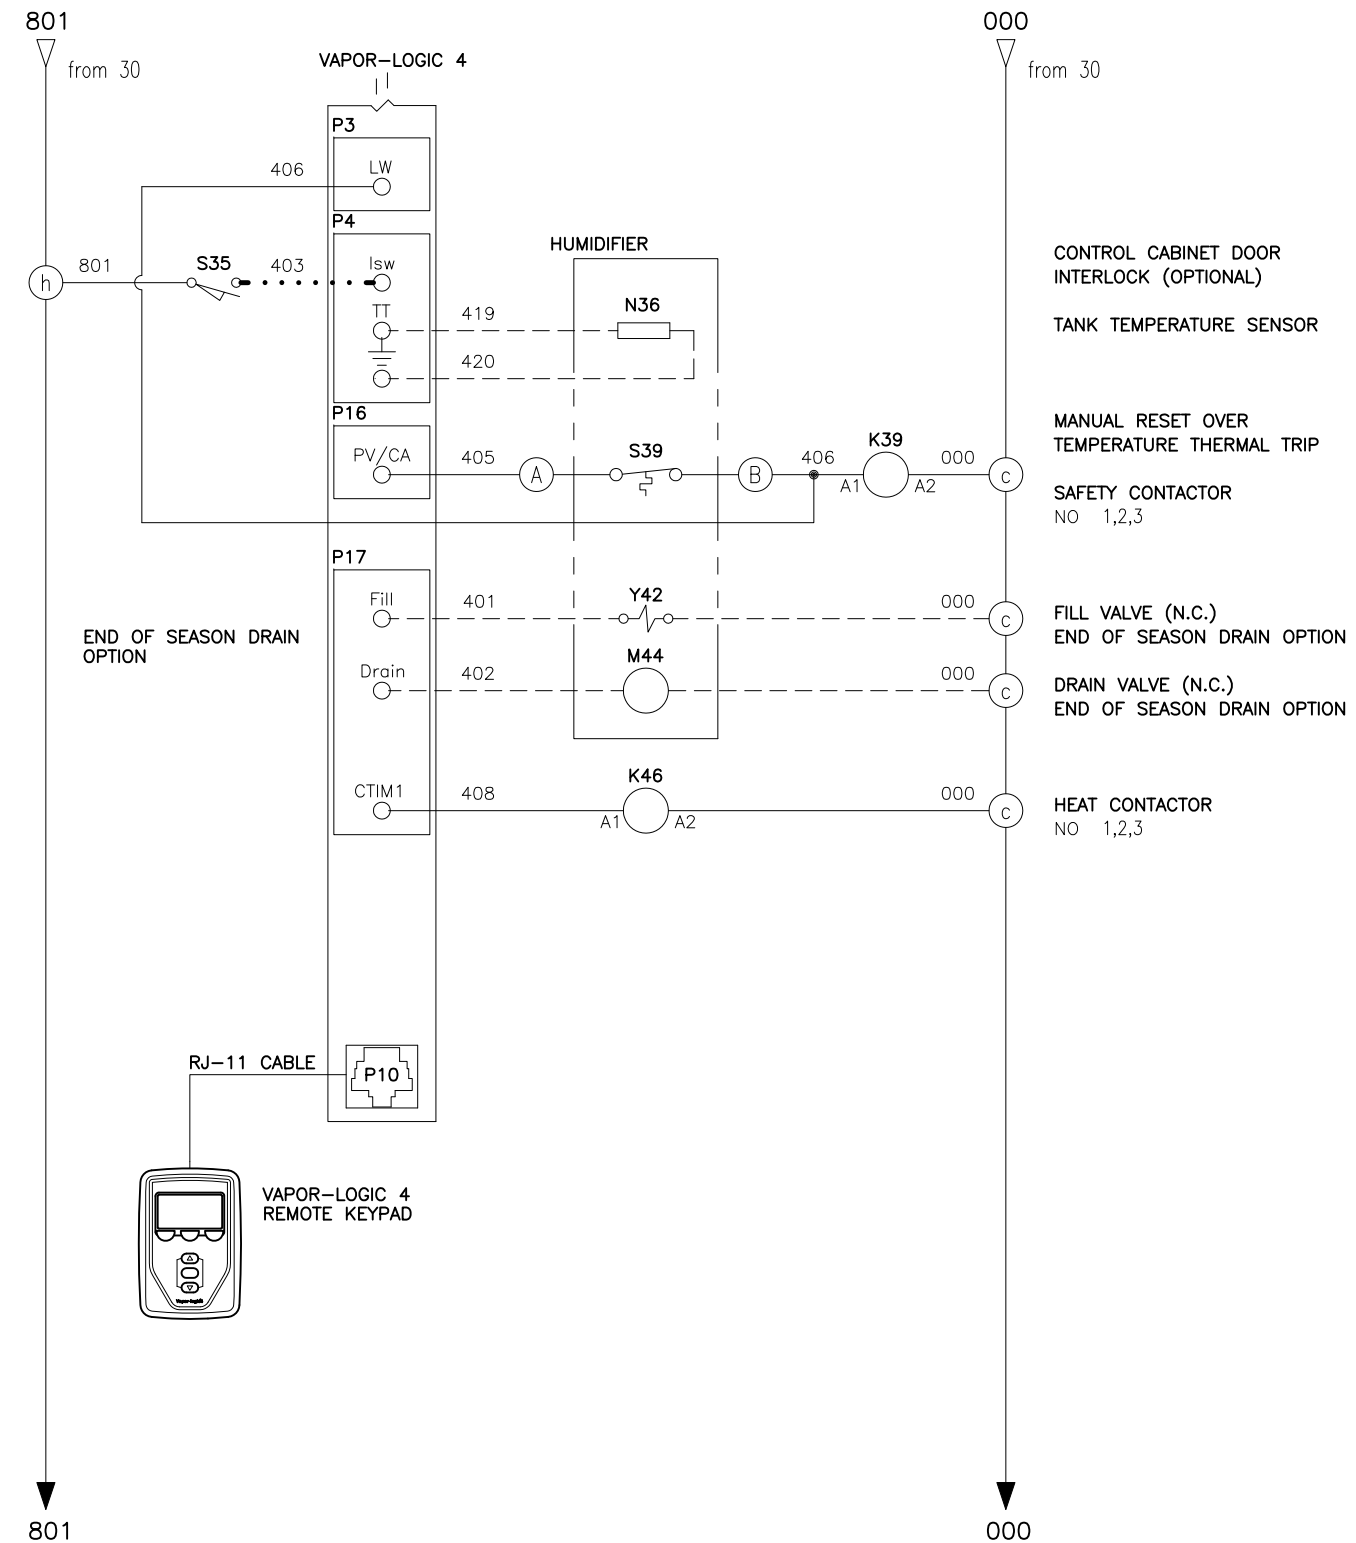


**CRUV™ DI EVAPORATIVE HUMIDIFIER
FACTORY WIRING DIAGRAM WITH VAPOR-LOGIC 4**

DATE	REV	RECORD	DR
5/10	A	E.C.# 5005	JK
5/12	B	E.C.# 5803	JK
9/12	C	E.C.# 5898	JK

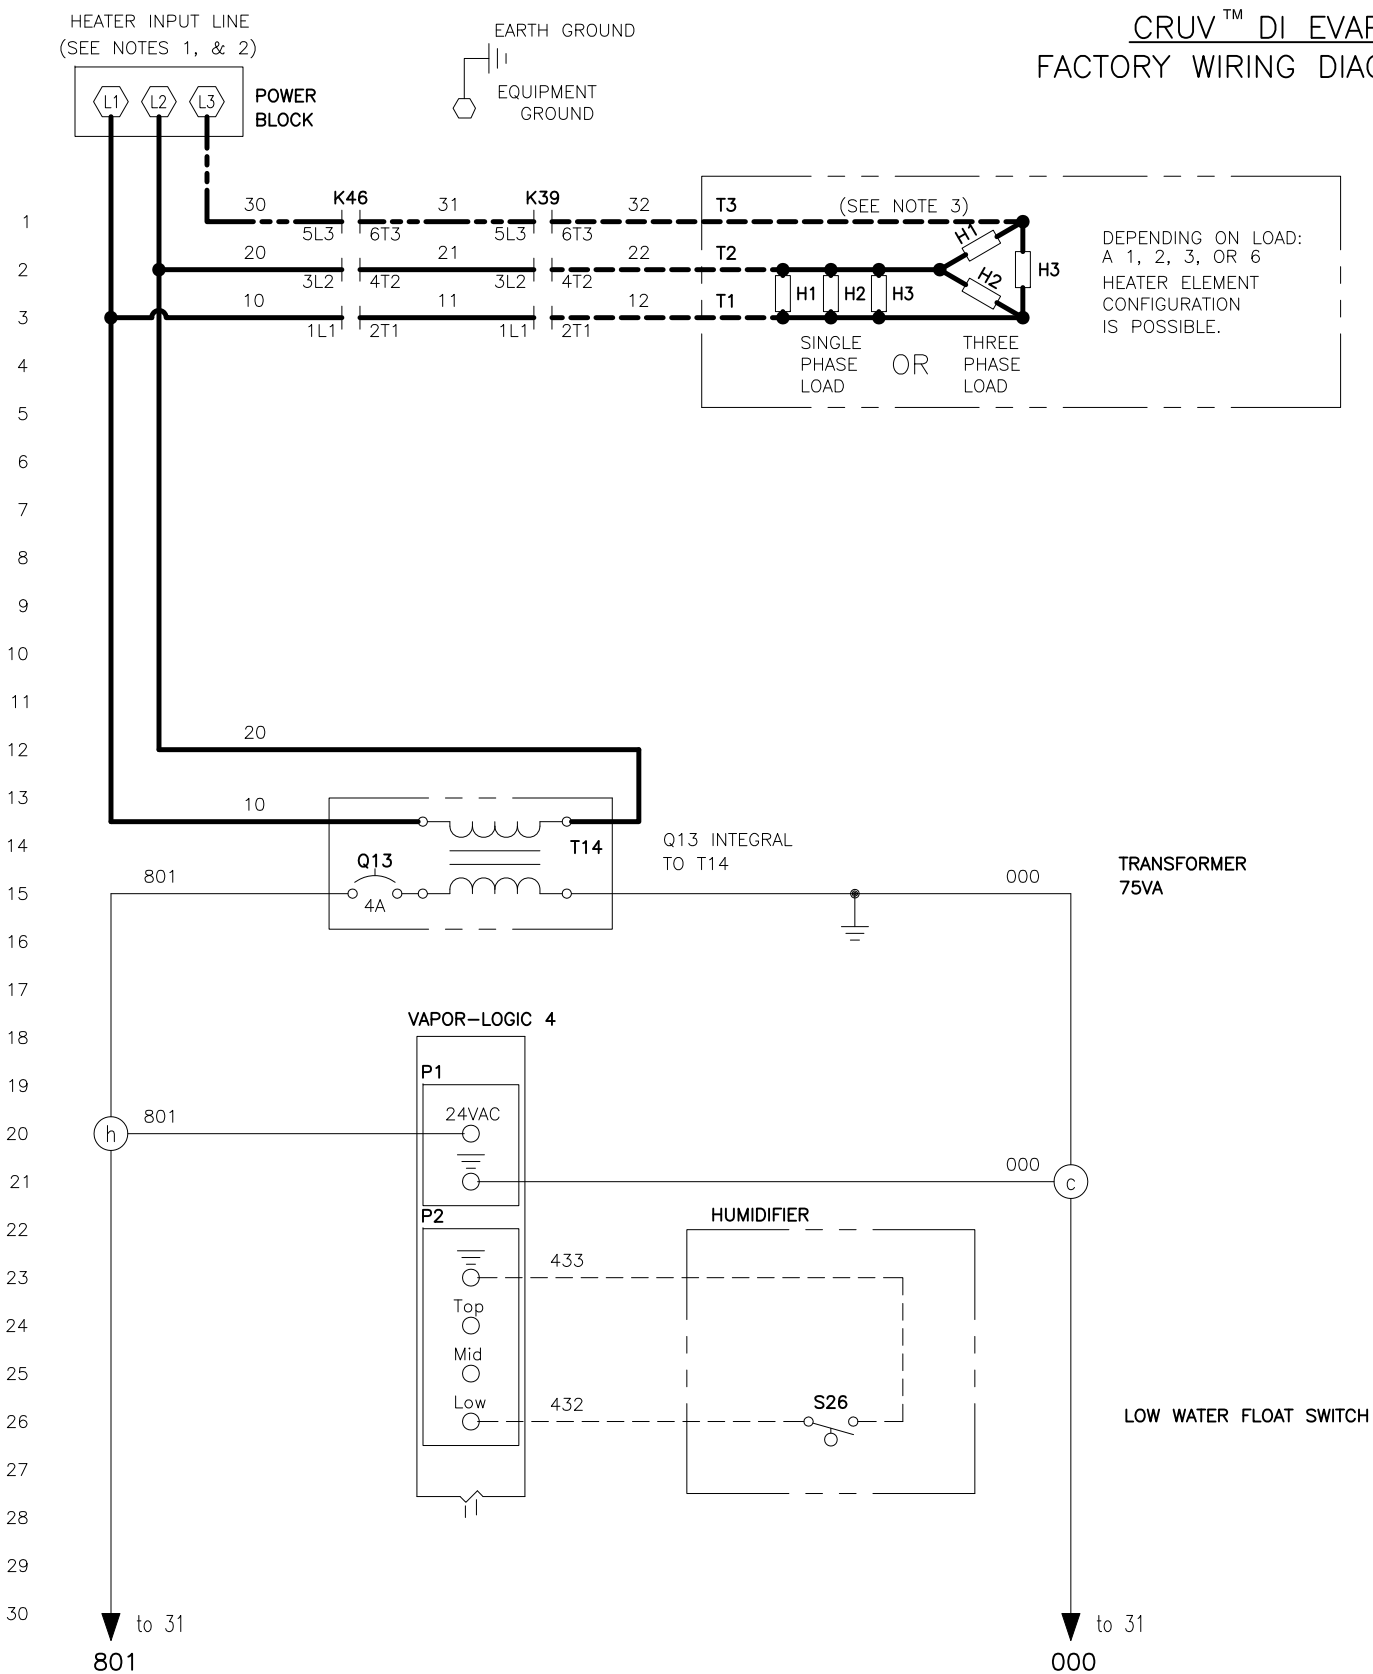

- NOTES:
- INPUT LINE _____ VOLTS _____ PHASE, FOR HEATER(S) CIRCUIT: OPERATES ON 50/60 HERTZ.
 - FOR WIRING SIZING, HEATER CIRCUIT LINE AMPS: L1 _____ L2 _____ L3 _____
RECOMMENDED LINE FUSING _____ AMPS. POWER BLOCK TERMINAL TORQUE _____ in-lbs|N-m
CONTACTOR TERMINAL TORQUE _____ in-lbs|N-m
VL4 CONTROL BOARD TORQUE _____ in-lbs|N-m
 - FOR THREE PHASE SYSTEM, THE THREE PHASE LOAD IS USED AND THIS WIRE IS FACTORY INSTALLED.

POWER WIRING
CONTROL CIRCUIT WIRING
FIELD WIRING
OPTIONAL FACTORY
OPTIONAL FIELD

LEGEND

K	RELAY/CONTACTOR	Y	SOLENOID
T	TRANSFORMER	N	SENSOR
Q	CIRCUIT BREAKER	J	JUMPER
S	SWITCH	E	WATER PROBE
H	HEATER	M	MOTOR/FAN
F	FUSE		

BREAK TO EXTERNAL CONNECTIONS DIAGRAM

MODEL: _____ ORDER NO: _____

DRISTEEM	DOMESTIC CRUV, DI WATER DIAGRAM	
	MAT'L:	P/N
	SCALE:	CR-VL4-2
DATE: 5/6/10	DRAWN BY: KROG	