
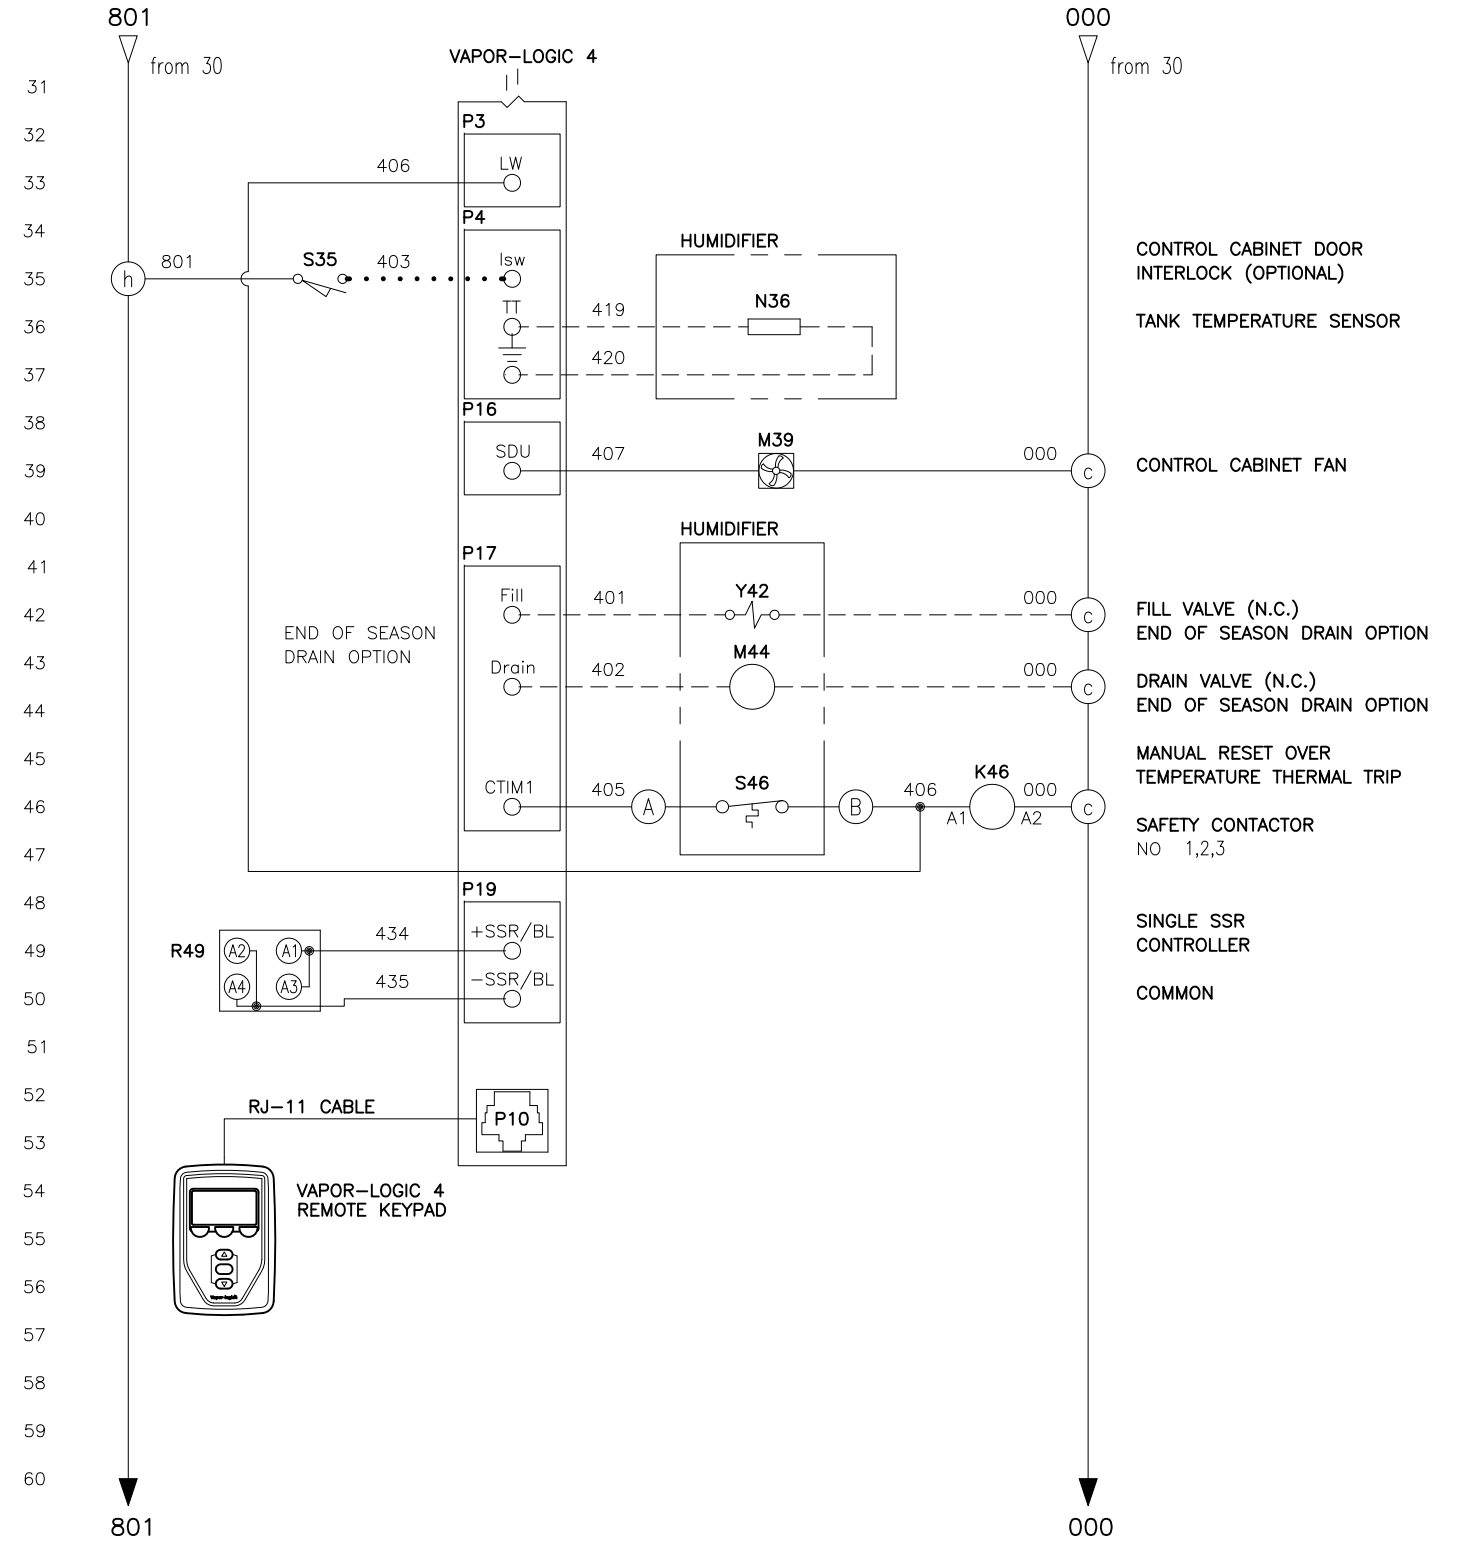


**CRUV™ DI EVAPORATIVE HUMIDIFIER  
FACTORY WIRING DIAGRAM WITH VAPOR-LOGIC 4**

DATE	REV	RECORD	DR
5/10	A	E.C.# 5005	JK
5/12	B	E.C.# 5803	JK

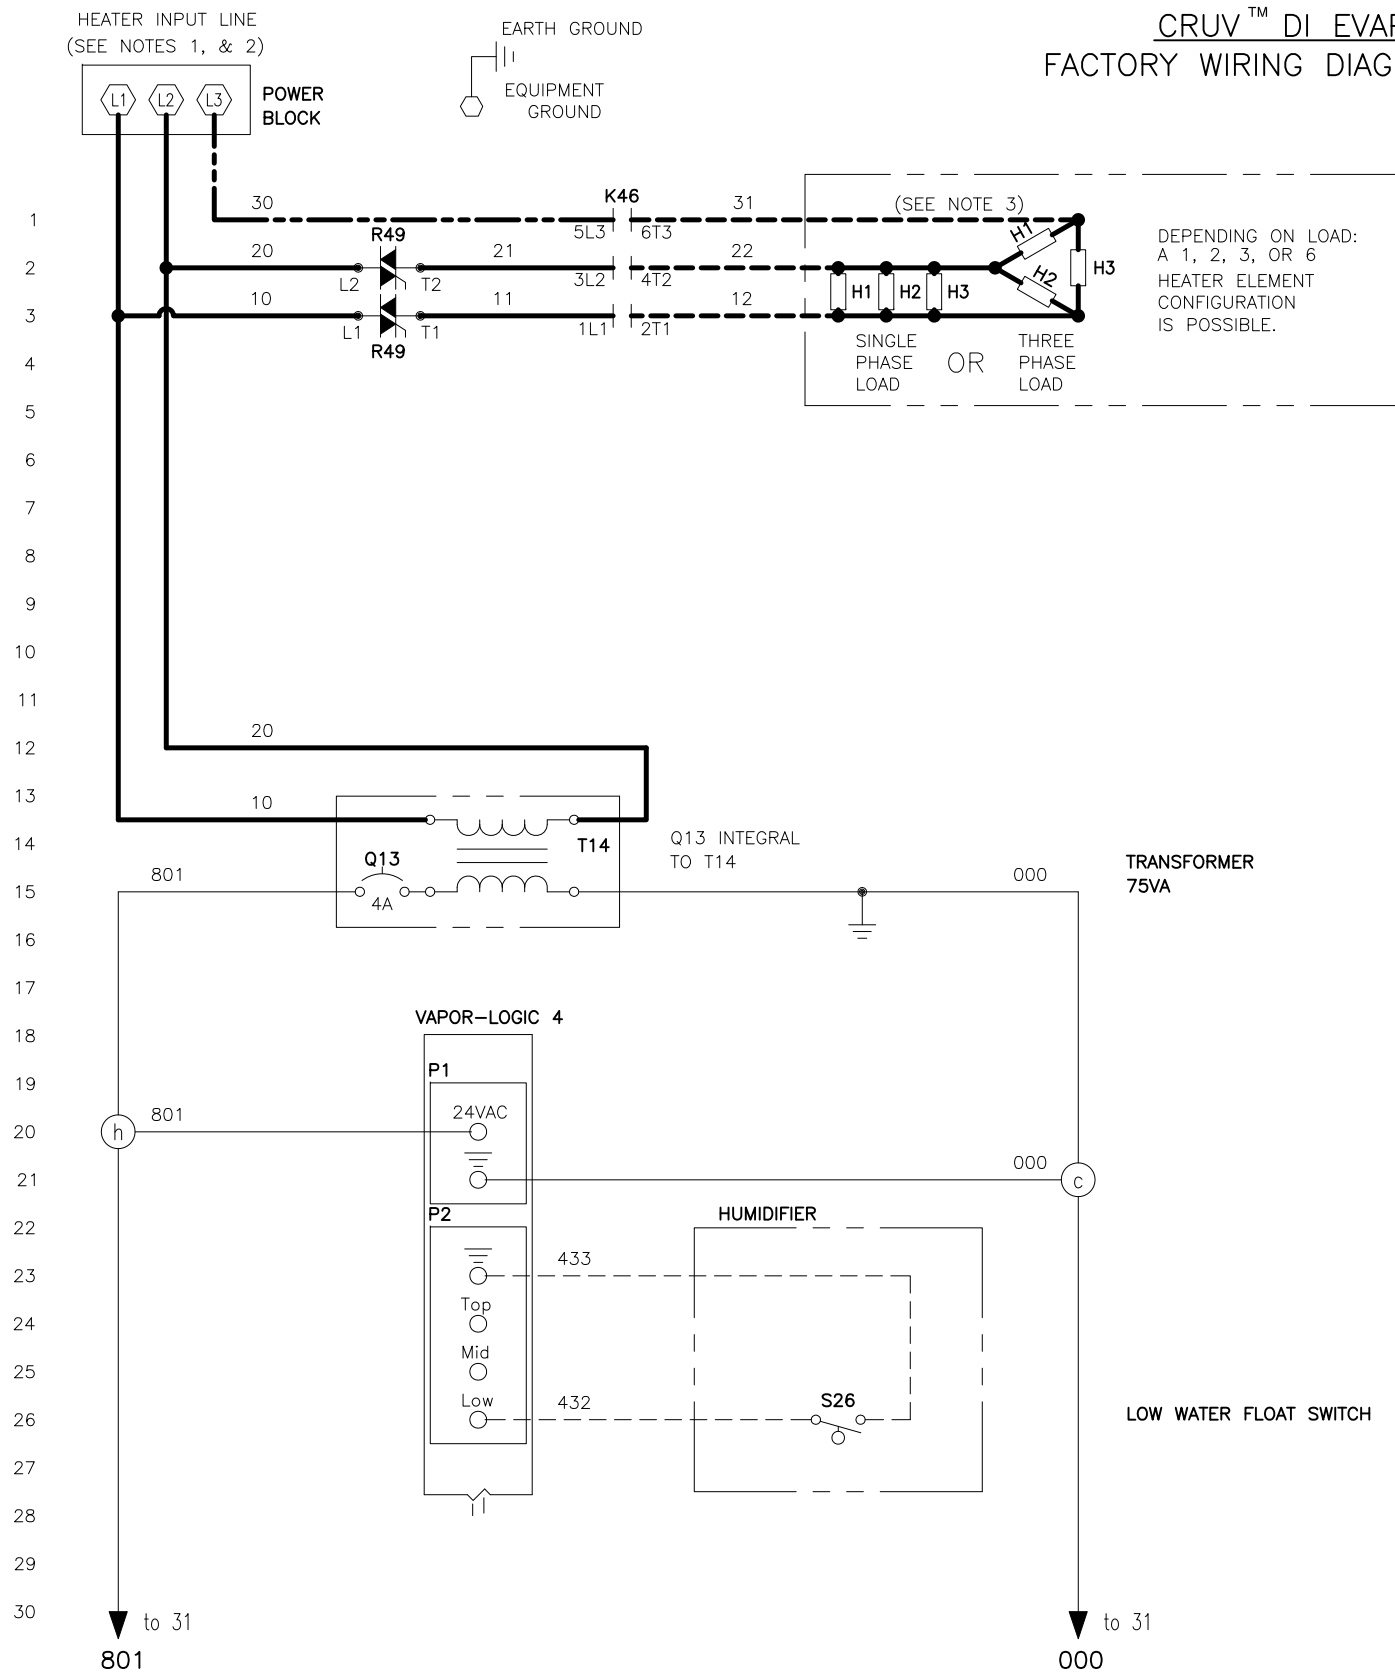

**NOTES:**

- INPUT LINE \_\_\_\_\_ VOLTS \_\_\_\_\_ PHASE, FOR HEATER(S) CIRCUIT: OPERATES ON 50/60 HERTZ.
- FOR WIRING SIZING, HEATER CIRCUIT LINE AMPS: L1 \_\_\_\_\_ L2 \_\_\_\_\_ L3 \_\_\_\_\_  
RECOMMENDED LINE FUSING \_\_\_\_\_ AMPS. POWER BLOCK TERMINAL TORQUE \_\_\_\_\_ in-lbs|N-m  
CONTACTOR TERMINAL TORQUE \_\_\_\_\_ in-lbs|N-m  
VL4 CONTROL BOARD TORQUE \_\_\_\_\_ in-lbs|N-m
- FOR THREE PHASE SYSTEM, THE THREE PHASE LOAD IS USED AND THIS WIRE IS FACTORY INSTALLED.

**POWER WIRING**  
CONTROL CIRCUIT WIRING  
FIELD WIRING  
OPTIONAL FACTORY  
OPTIONAL FIELD

**LEGEND**  
K RELAY/CONTACTOR  
N SENSOR  
Q CIRCUIT BREAKER  
S SWITCH  
H HEATER  
F FUSE  
Y SOLENOID  
J JUMPER  
E WATER PROBE  
M MOTOR/FAN  
R SOLID STATE RELAY

BREAK TO EXTERNAL CONNECTIONS DIAGRAM

MODEL: \_\_\_\_\_ ORDER NO: \_\_\_\_\_

<b>DRISTEEM</b>		DOMESTIC CRUV, DI WATER, SINGLE SSR WIRING DIAGRAM (LESS THAN OR EQUAL TO 480V.)	
SCALE: _____		P/N _____	
DRAWN BY: KROG		CR-VL4-5	
DATE: 5/6/10			