
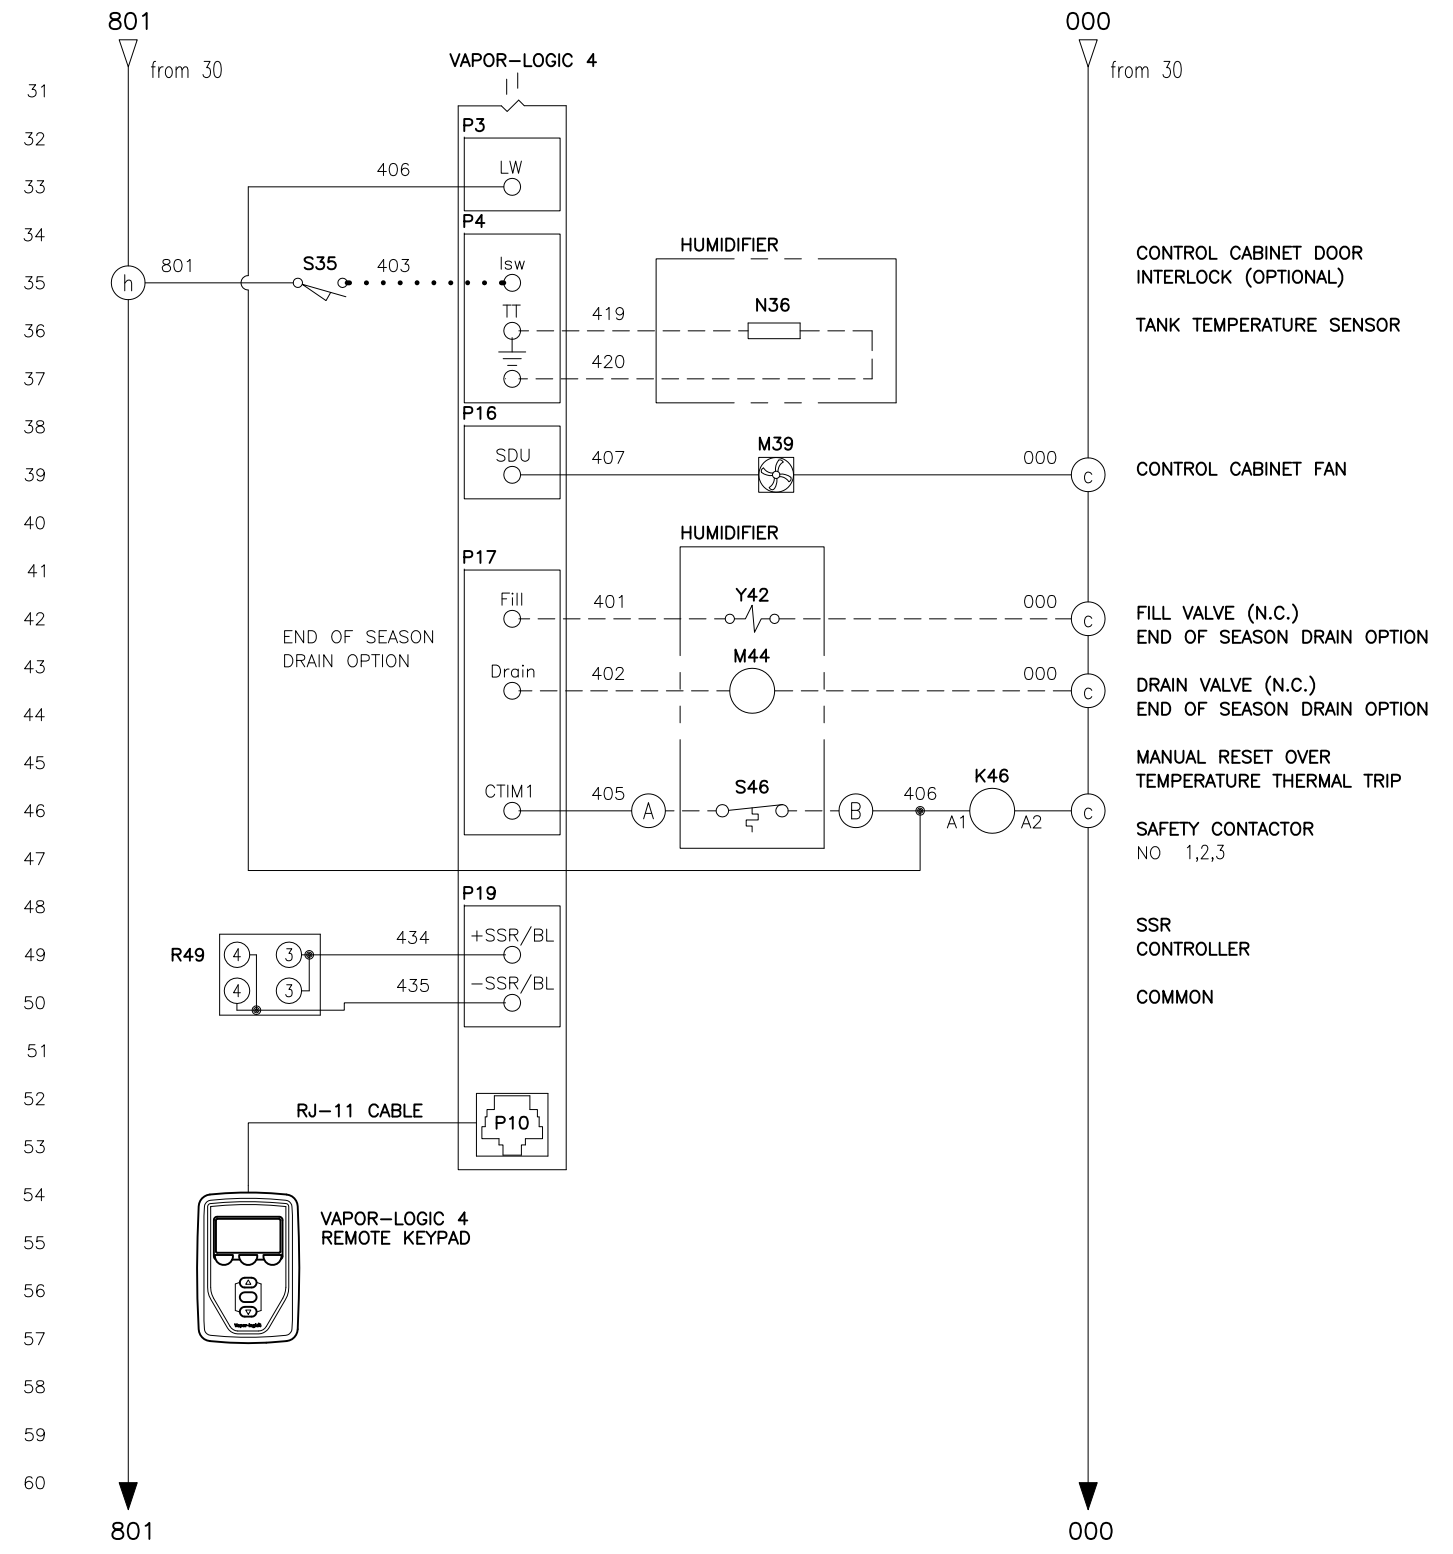


**CRUV™ DI EVAPORATIVE HUMIDIFIER
FACTORY WIRING DIAGRAM WITH VAPOR-LOGIC 4**


DATE	REV	RECORD	DR
5/10	A	E.C.# 5005	JK
5/12	B	E.C.# 5803	JK

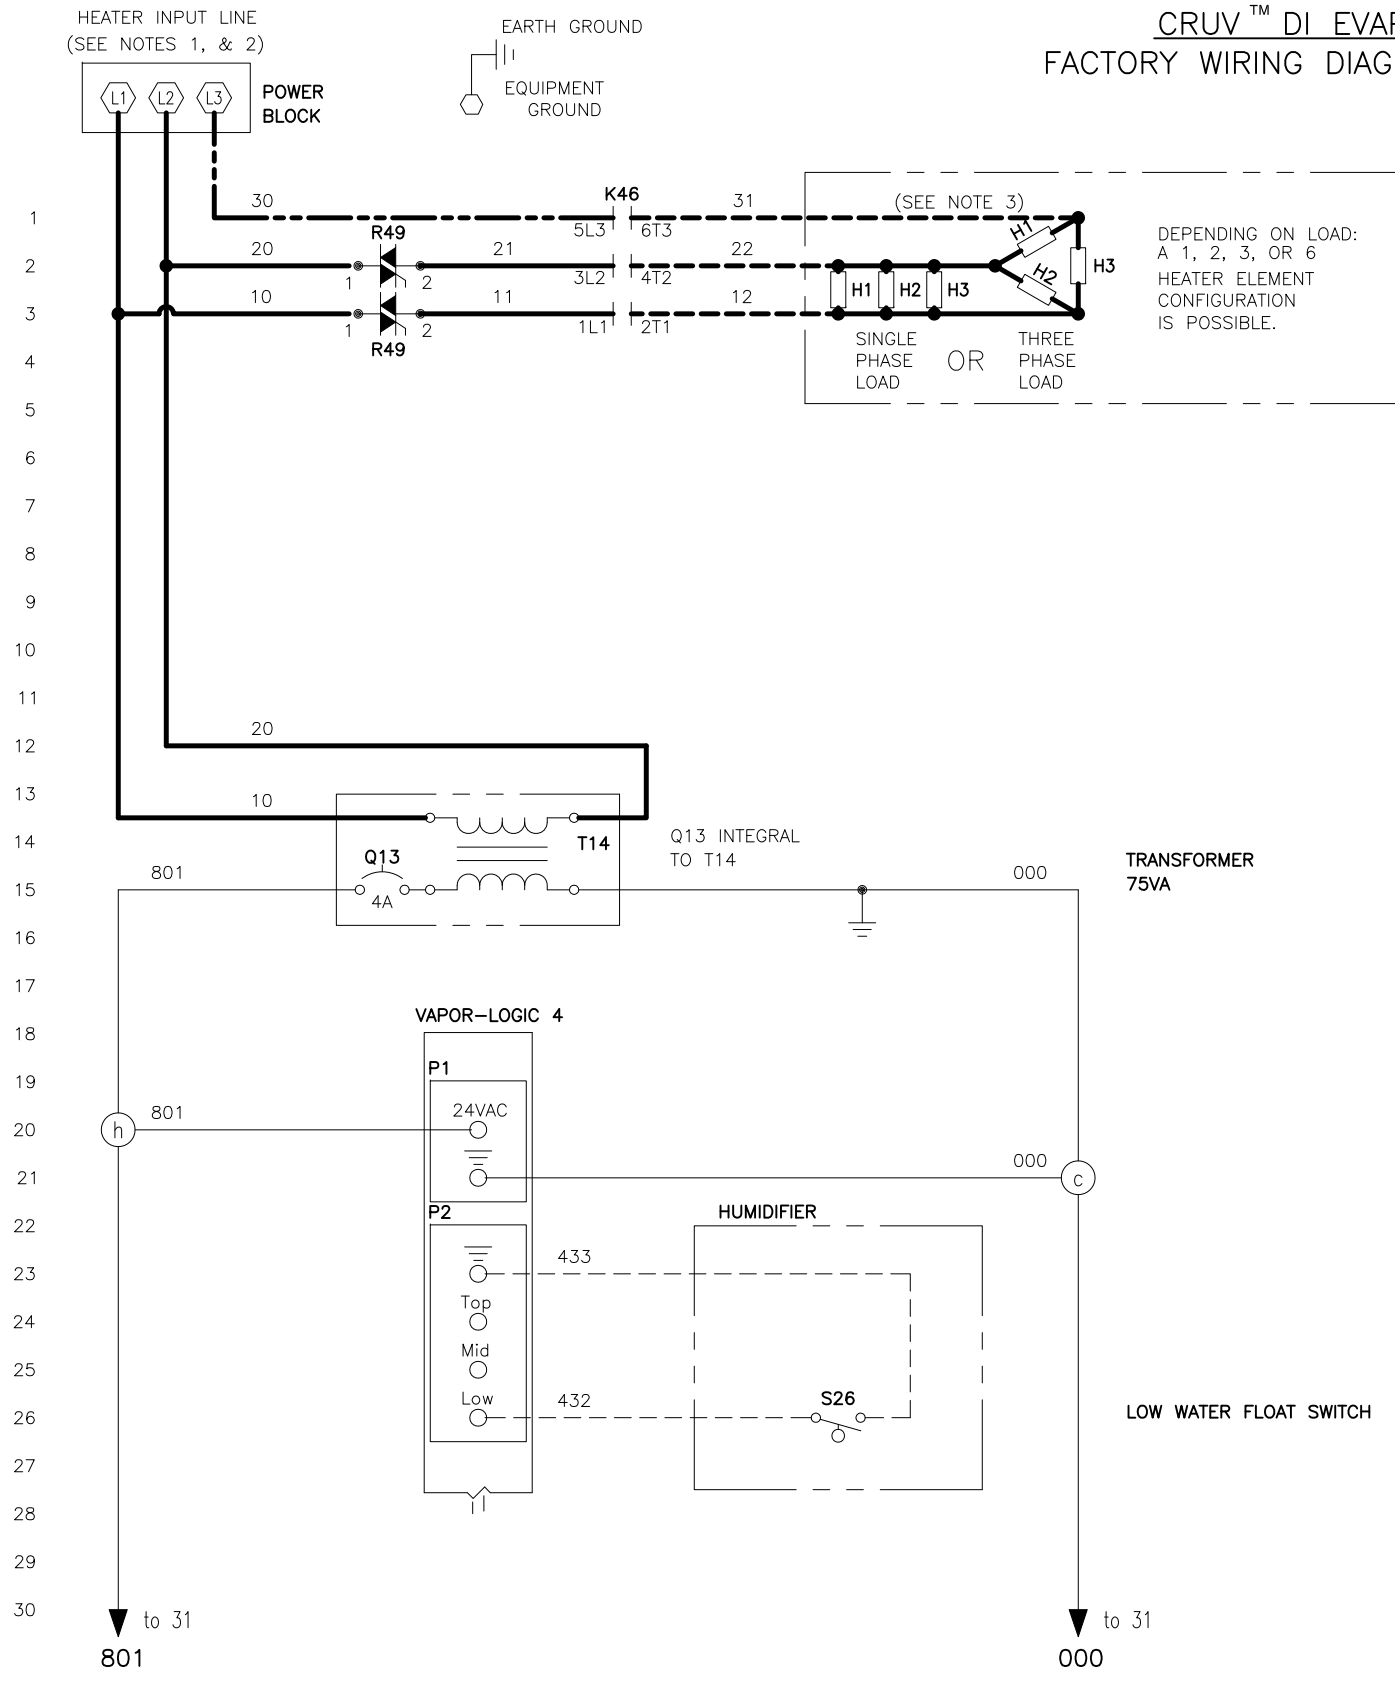

- NOTES:
1. INPUT LINE _____ VOLTS _____ PHASE, FOR HEATER(S) CIRCUIT: OPERATES ON 50/60 HERTZ.
 2. FOR WIRING SIZING, HEATER CIRCUIT LINE AMPS: L1 _____ L2 _____ L3 _____
RECOMMENDED LINE FUSING _____ AMPS. POWER BLOCK TERMINAL TORQUE _____ in-lbs|N-m
CONTACTOR TERMINAL TORQUE _____ in-lbs|N-m
VL4 CONTROL BOARD TORQUE _____ in-lbs|N-m
 3. FOR THREE PHASE SYSTEM, THE THREE PHASE LOAD IS USED AND THIS WIRE IS FACTORY INSTALLED.

- POWER WIRING**
CONTROL CIRCUIT WIRING
FIELD WIRING
OPTIONAL FACTORY
OPTIONAL FIELD

- LEGEND**
- | | | | |
|---|-----------------|---|-------------------|
| K | RELAY/CONTACTOR | Y | SOLENOID |
| T | TRANSFORMER | N | SENSOR |
| Q | CIRCUIT BREAKER | J | JUMPER |
| S | SWITCH | E | WATER PROBE |
| H | HEATER | M | MOTOR/FAN |
| F | FUSE | R | SOLID STATE RELAY |



MODEL: _____ ORDER NO: _____

DRISTEEM	DOMESTIC CRUV, DI WATER, 600V SSR DIAGRAM	
	MAT'L:	P/N
	SCALE:	CR-VL4-8
	DRAWN BY: KROG	DATE: 5/7/10