
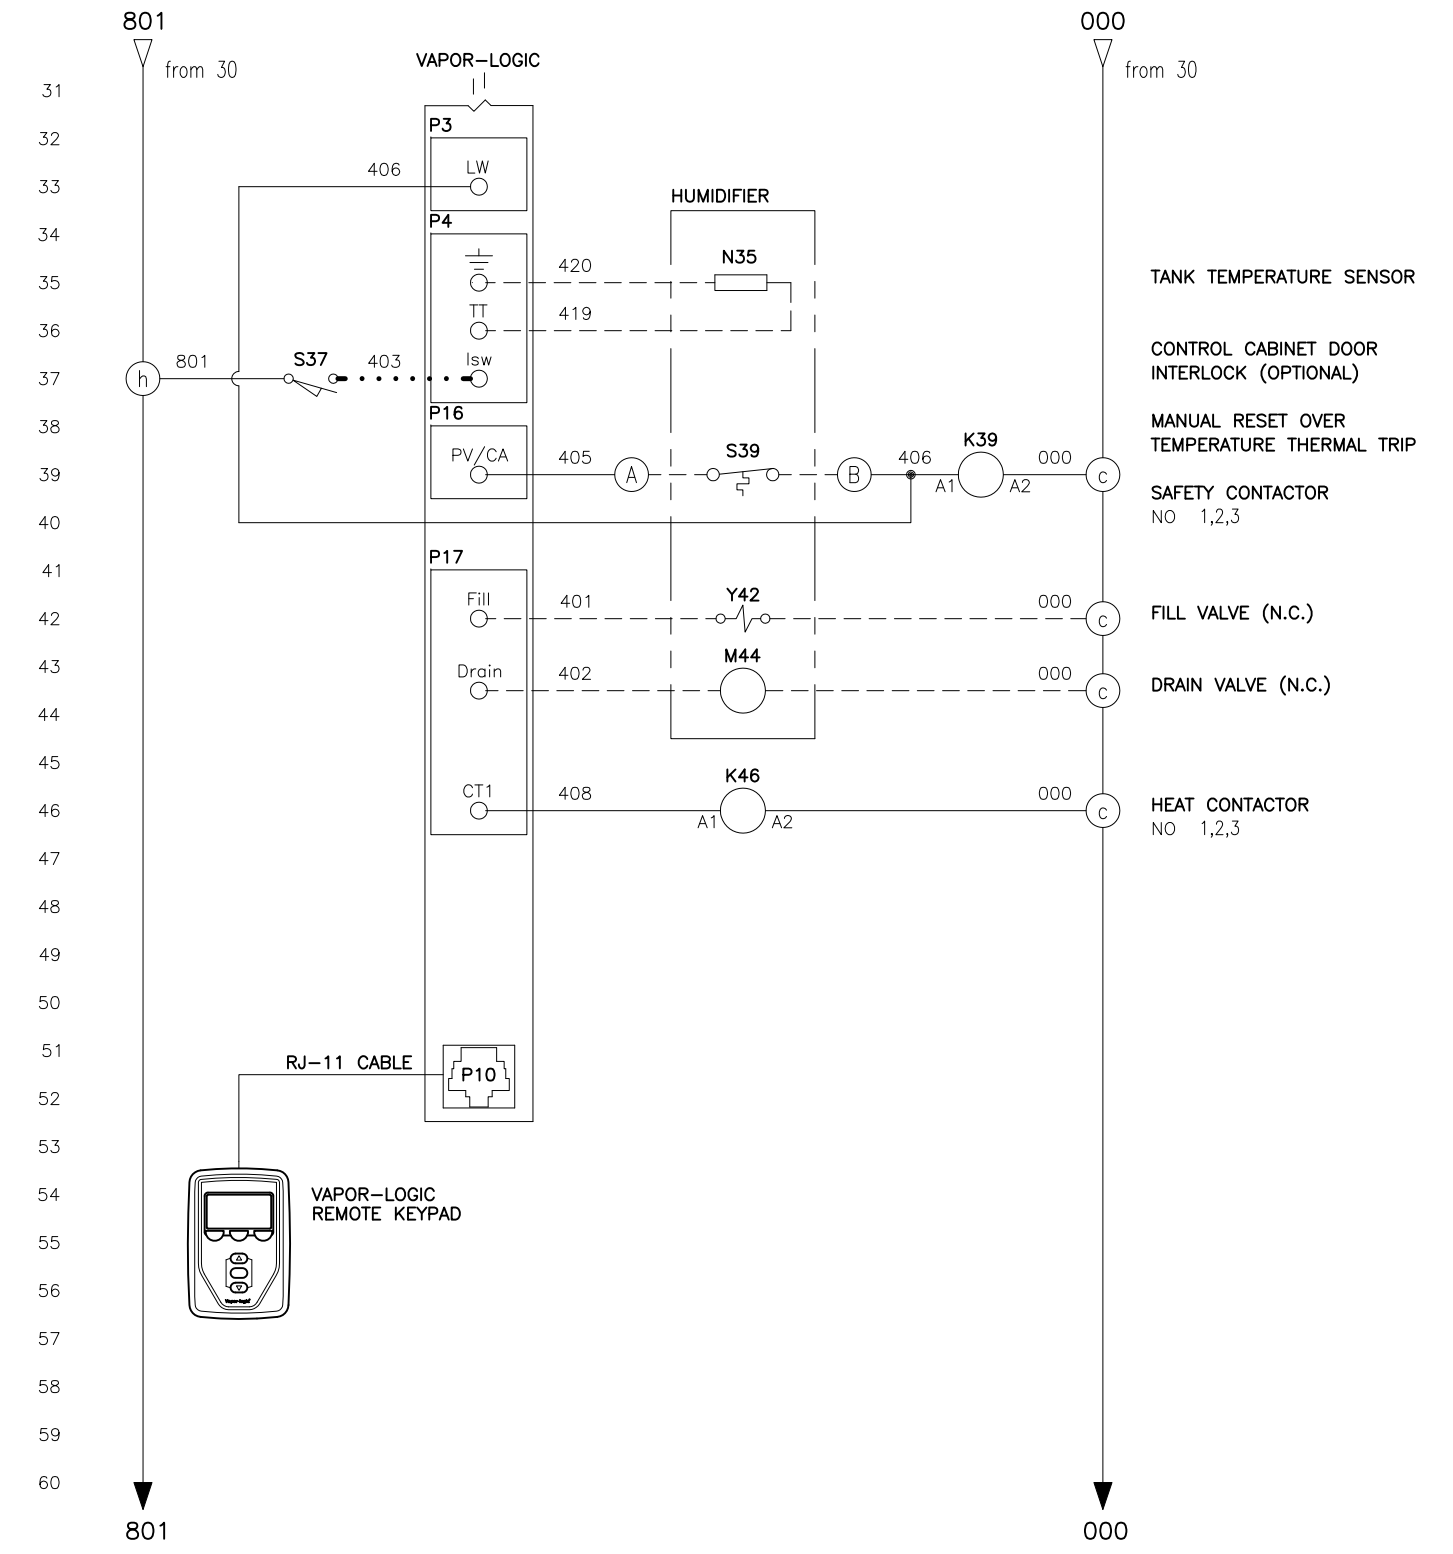


CRUV™ EVAPORATIVE HUMIDIFIER FACTORY WIRING DIAGRAM WITH VAPOR-LOGIC

DATE	REV	RECORD	DR
3/13	B	E.C.# 6053	JK
11/13	C	E.C.# 6179	JK
3/14	D	E.C.# 6238	JK

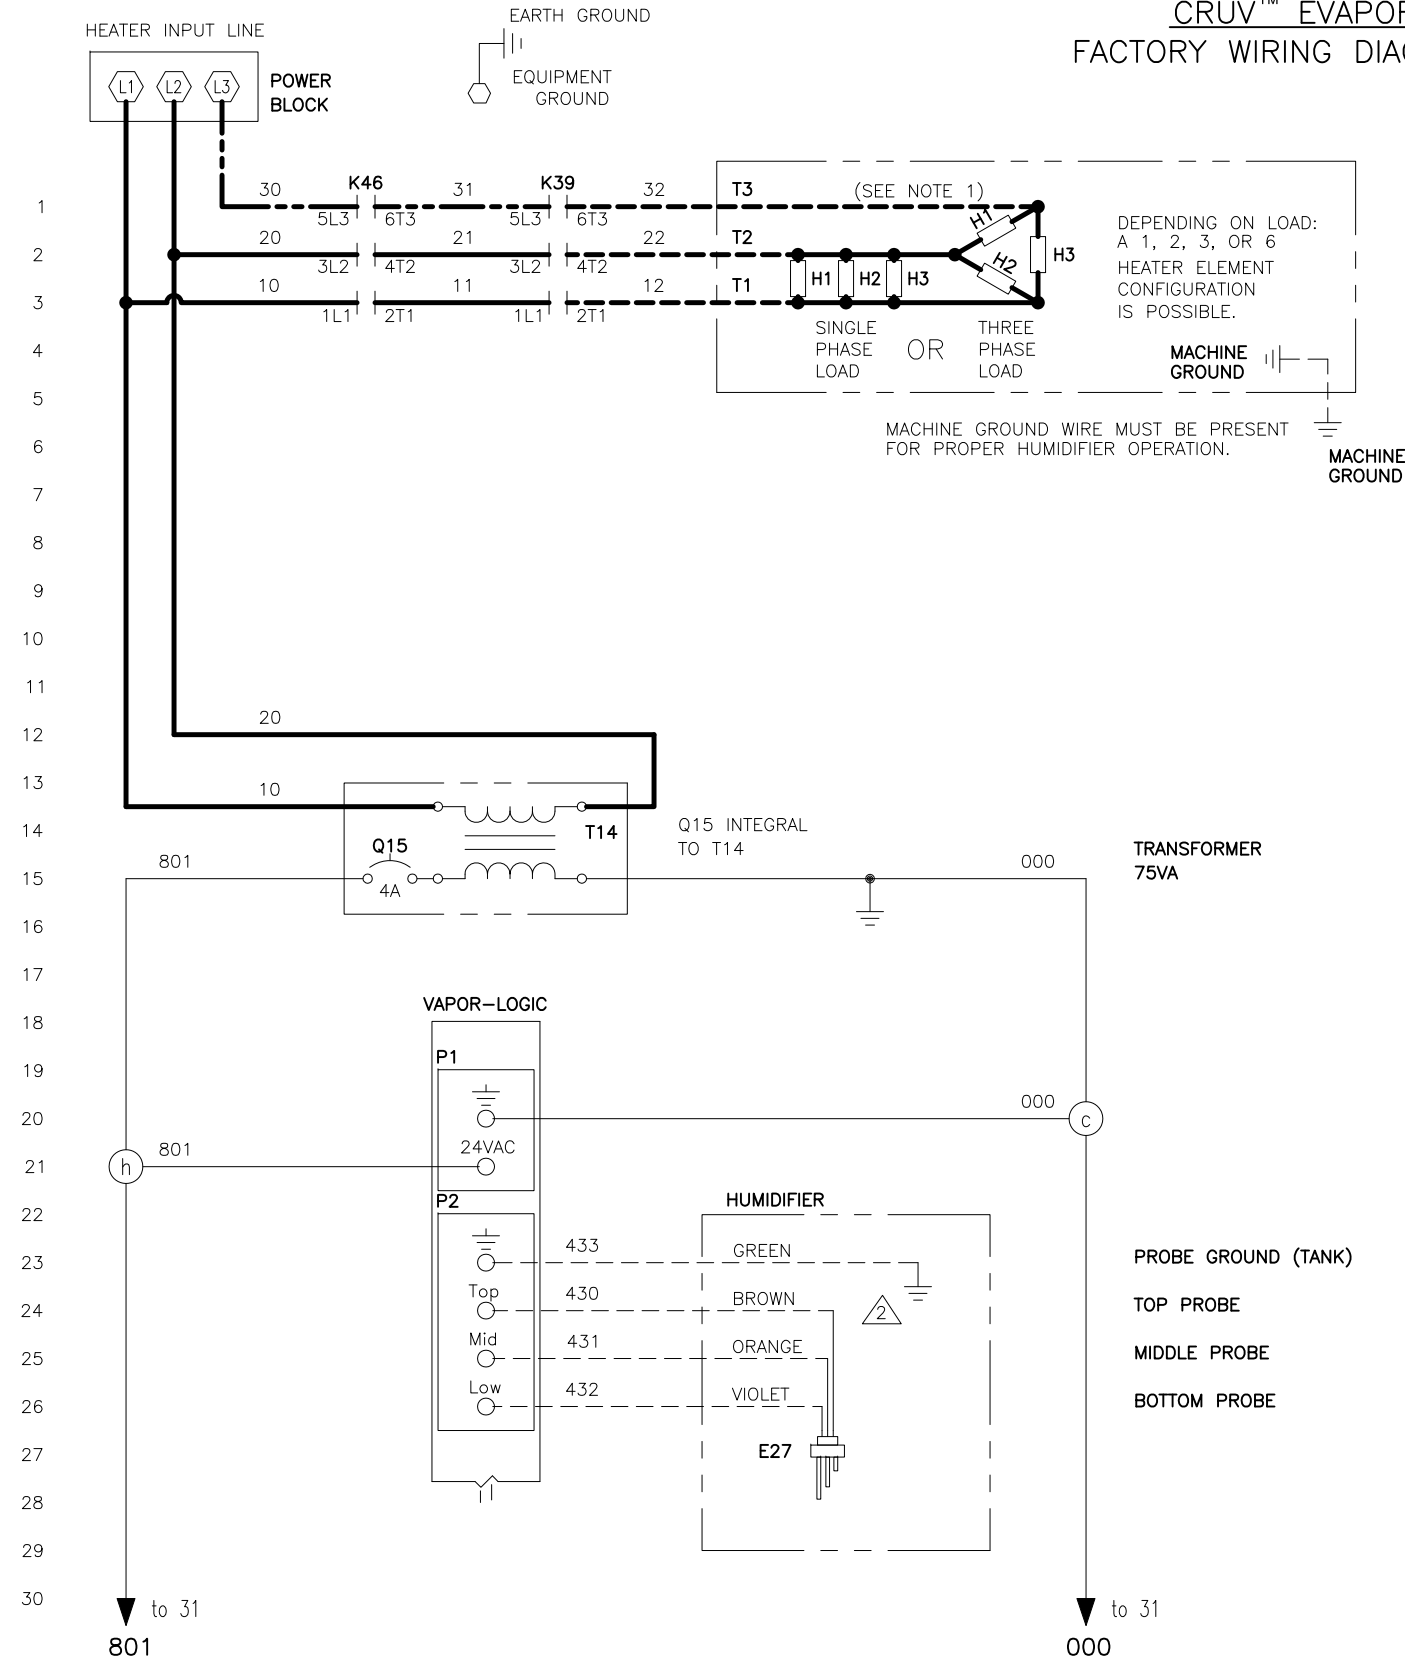

- NOTES:
- FOR THREE PHASE SYSTEM, THE THREE PHASE LOAD IS USED AND THIS WIRE IS FACTORY INSTALLED.
 - WATER LEVEL PROBE GROUND MUST BE CONNECTED TO TANK FOR PROPER HUMIDIFIER OPERATION.
 - REFER TO CRUV ELECTRICAL DATA SHEET.

POWER WIRING	LEGEND
CONTROL CIRCUIT WIRING	K RELAY/CONTACTOR
FIELD WIRING	T TRANSFORMER
OPTIONAL FACTORY	Q CIRCUIT BREAKER
OPTIONAL FIELD	S SWITCH
	H HEATER
	F FUSE
	Y SOLENOID
	N SENSOR
	J JUMPER
	E WATER PROBE
	M MOTOR/FAN

BREAK TO EXTERNAL CONNECTIONS DIAGRAM

DOMESTIC CRUV, STANDARD WATER DIAGRAM	
MAT'L:	
SCALE:	P/N
DRAWN BY: KROG	CR-VL5-1
DATE: 12/28/12	

