
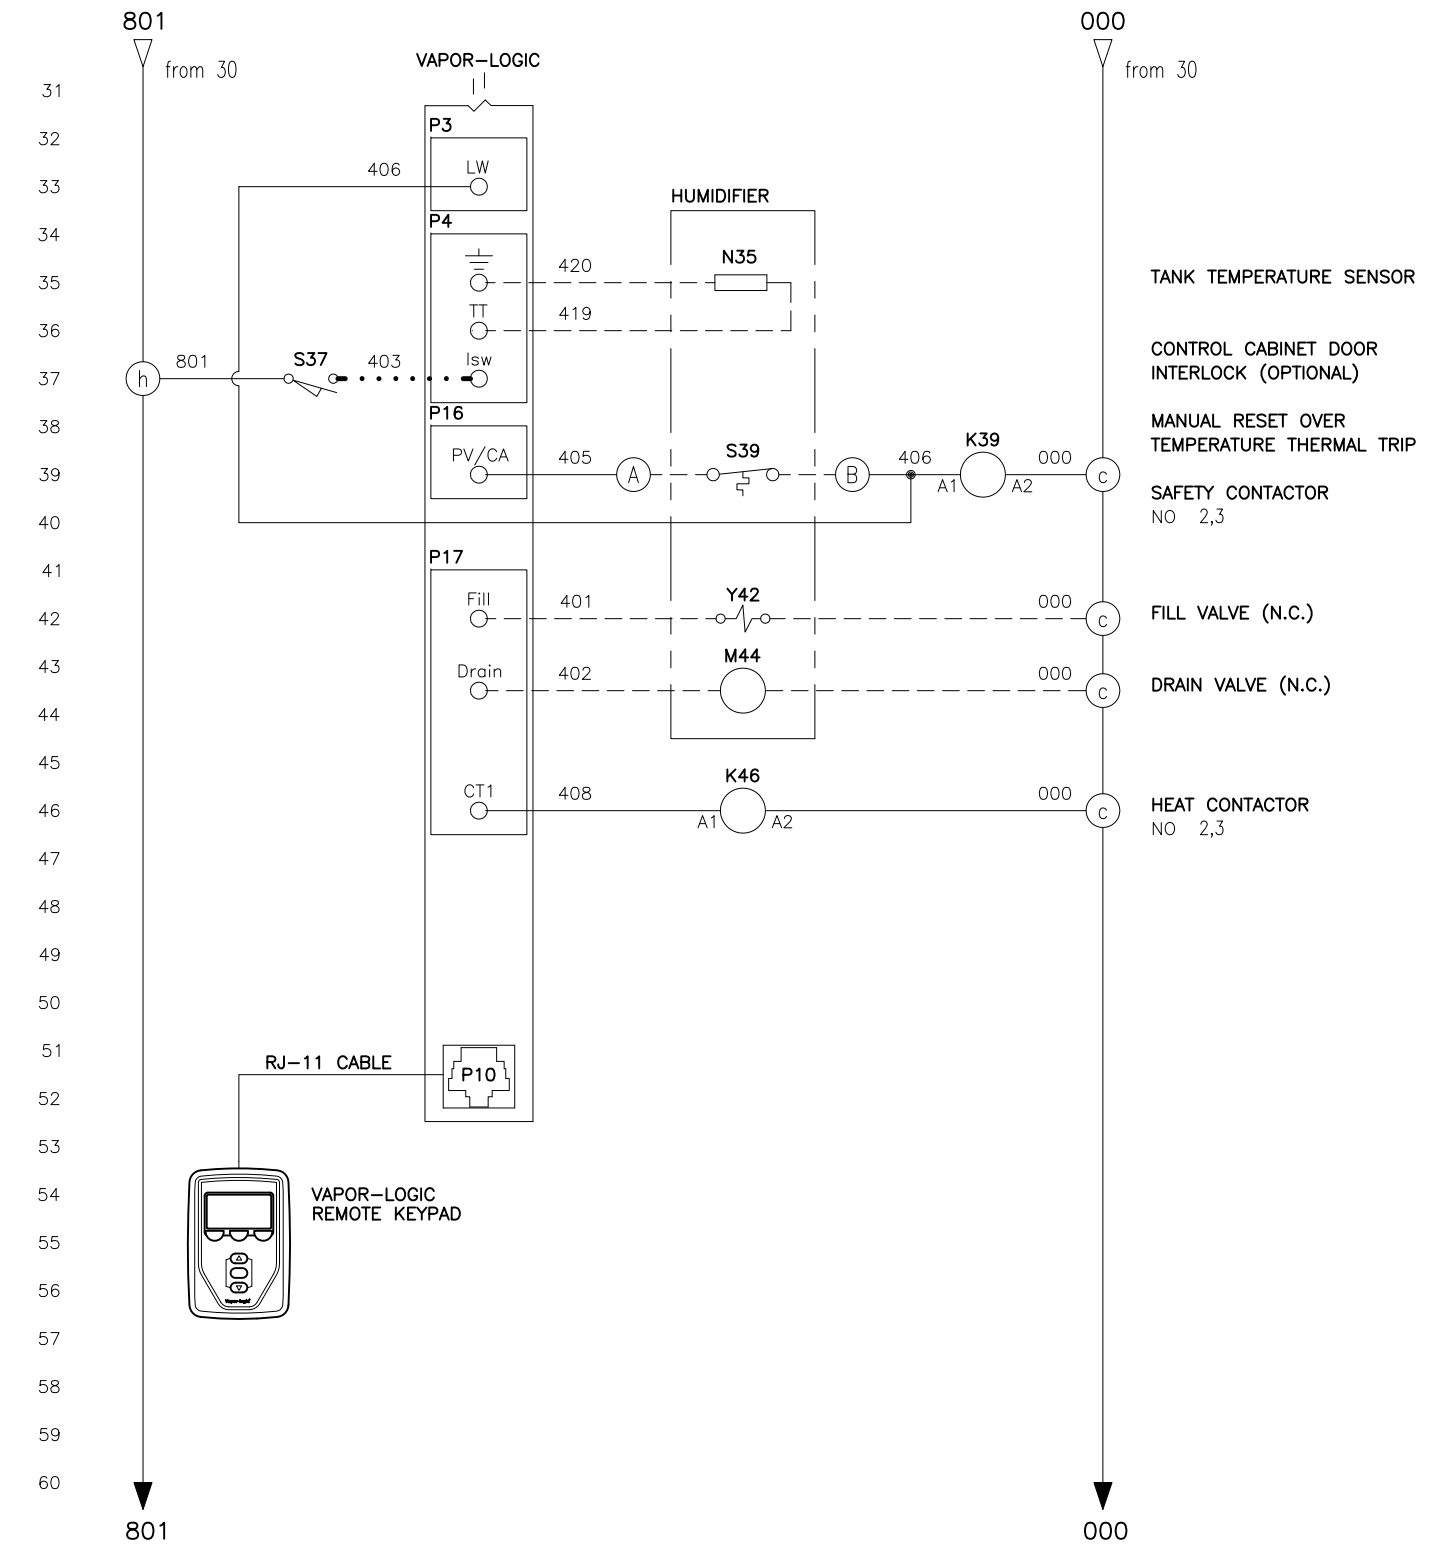


CRUV™ EVAPORATIVE HUMIDIFIER FACTORY WIRING DIAGRAM WITH VAPOR-LOGIC

DATE	REV	RECORD	DR
3/13	B	E.C.# 6053	JK
11/13	C	E.C.# 6179	JK
3/14	D	E.C.# 6238	JK

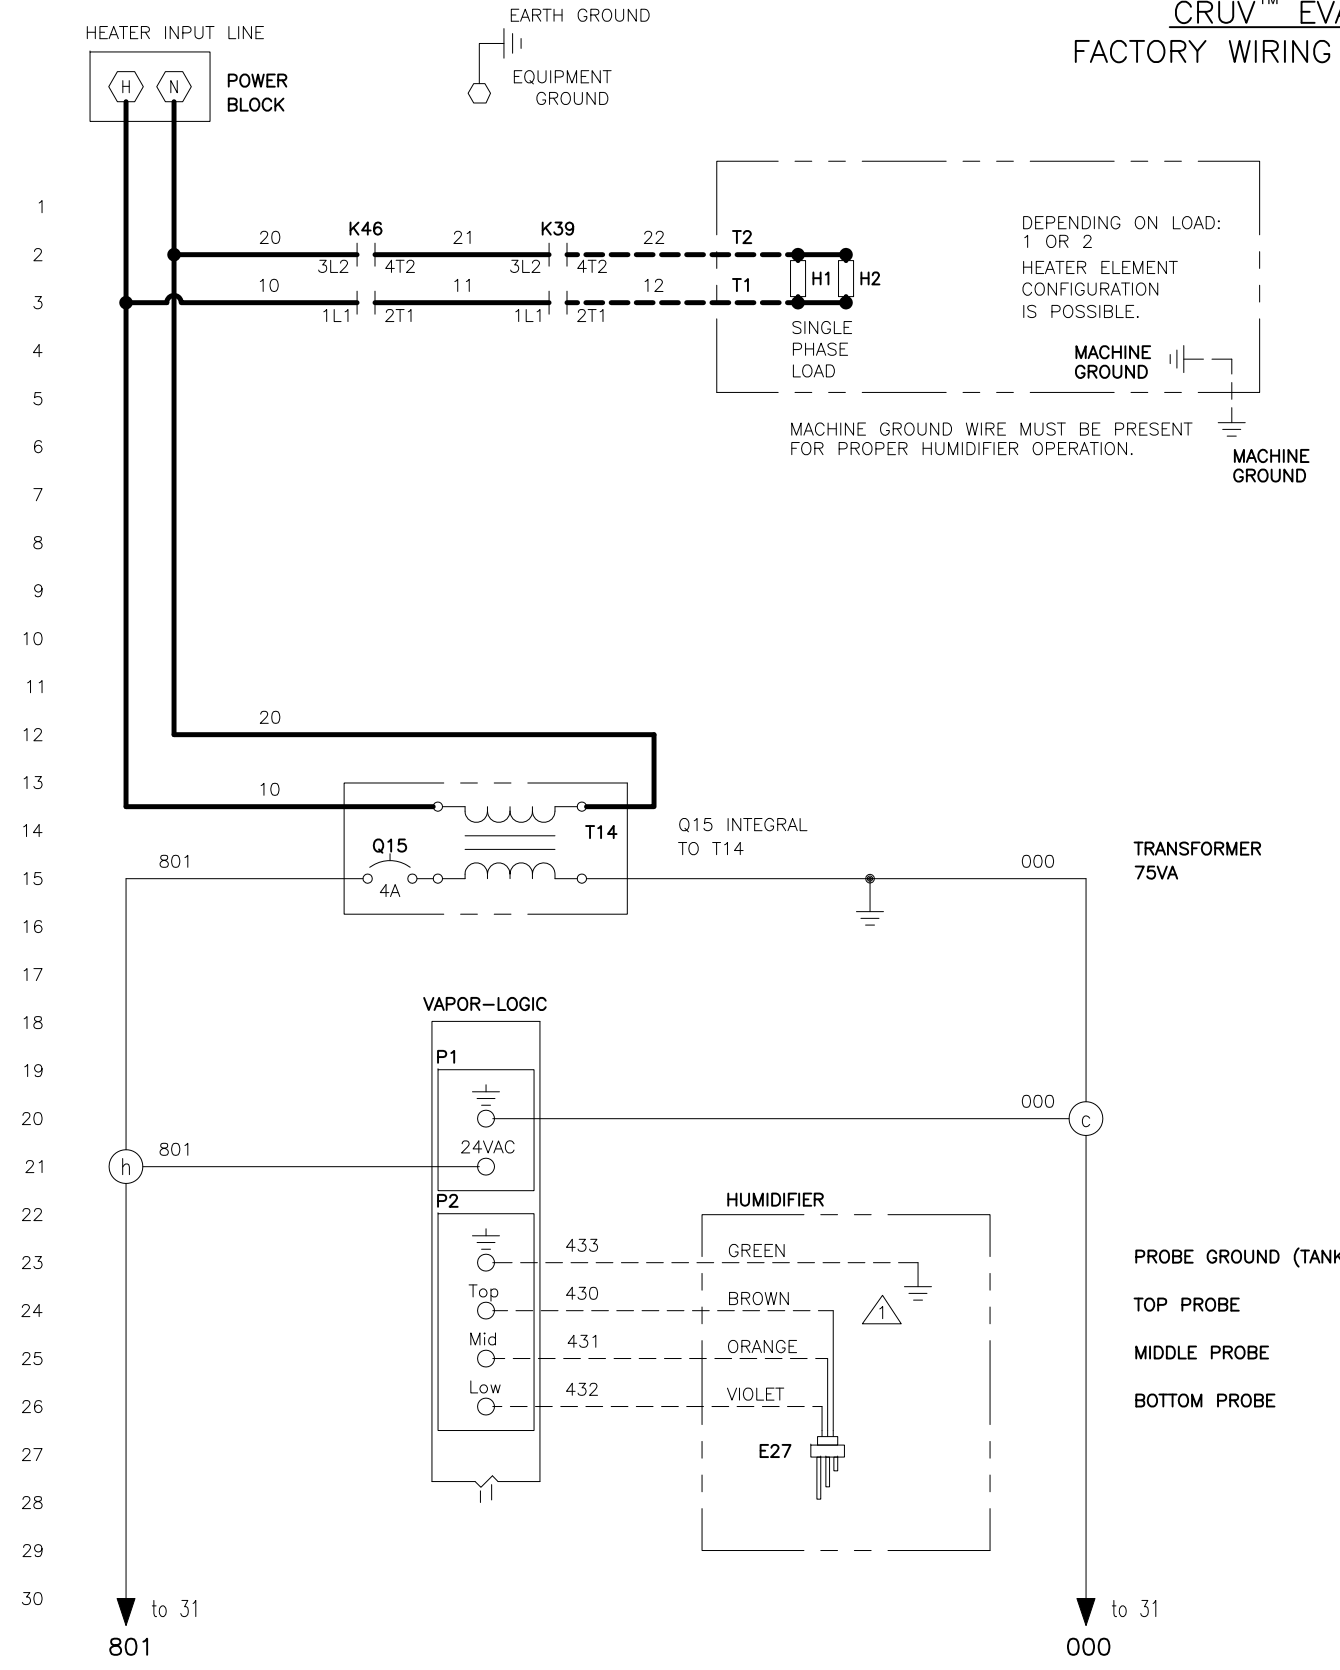

NOTES:

1. WATER LEVEL PROBE GROUND MUST BE CONNECTED TO TANK FOR PROPER HUMIDIFIER OPERATION.

2. REFER TO CRUV ELECTRICAL DATA SHEET.

- | | | |
|------------------------|-------------------|---------------|
| POWER WIRING | LEGEND | |
| CONTROL CIRCUIT WIRING | K RELAY/CONTACTOR | Y SOLENOID |
| FIELD WIRING | T TRANSFORMER | N SENSOR |
| OPTIONAL FACTORY | Q CIRCUIT BREAKER | J JUMPER |
| OPTIONAL FIELD | S SWITCH | E WATER PROBE |
| | H HEATER | M MOTOR/FAN |
| | F FUSE | |
- BREAK TO EXTERNAL CONNECTIONS DIAGRAM

DOMESTIC CRUV, STANDARD WATER 120 VOLT DIAGRAM

MAT'L:

SCALE: P/N

DRAWN BY: KROG CR-VL5-11

DATE: 12/28/12