


CRUV™ EVAPORATIVE HUMIDIFIER FACTORY WIRING DIAGRAM WITH VAPOR-LOGIC

DATE	REV	RECORD	DR
11/13	A	E.C.# 6157	JK
3/14	B	E.C.# 6238	JK

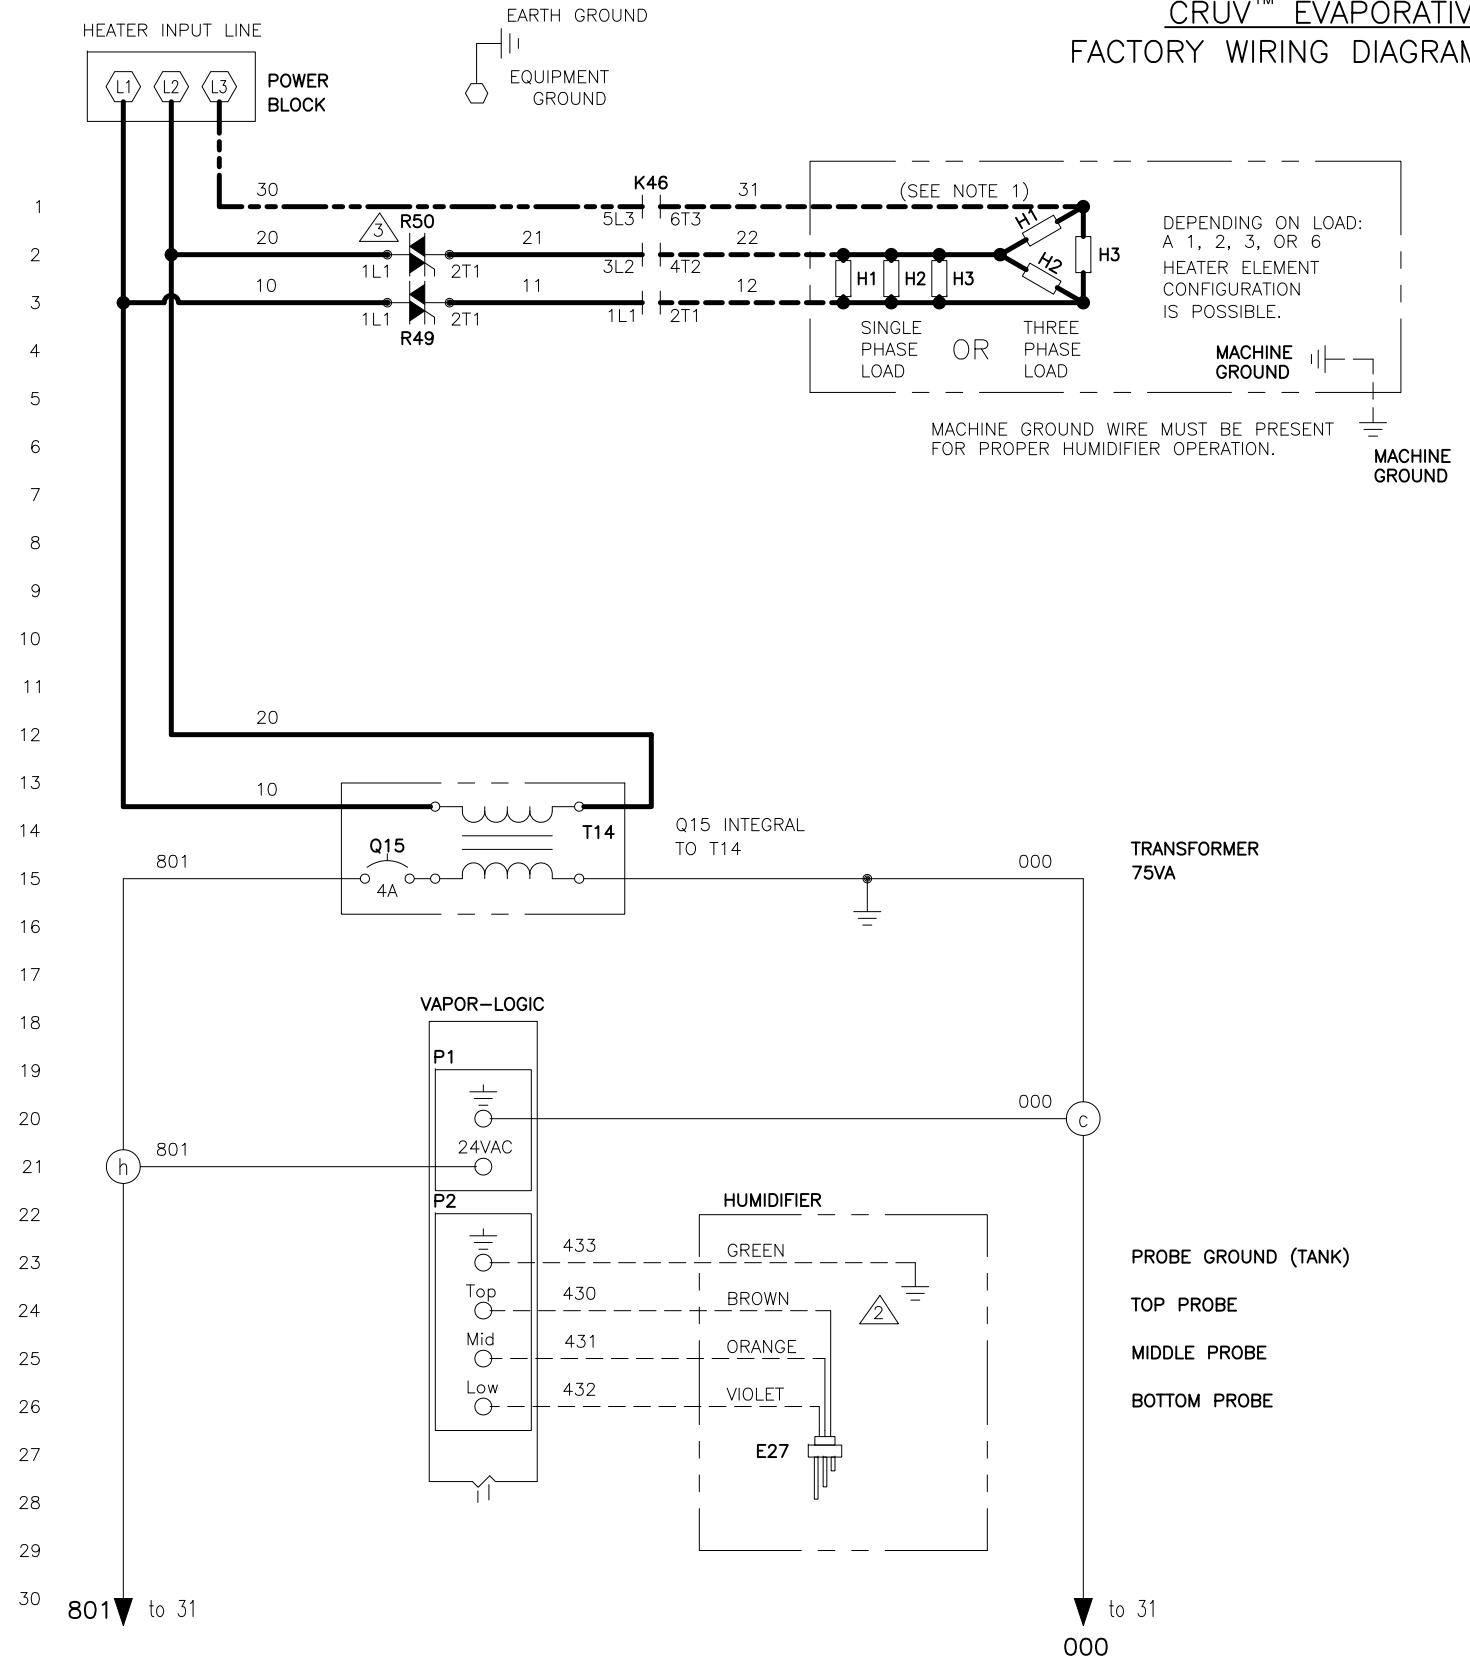


- NOTES:
- FOR THREE PHASE SYSTEM, THE THREE PHASE LOAD IS USED AND THIS WIRE IS FACTORY INSTALLED.
 - WATER LEVEL PROBE GROUND MUST BE CONNECTED TO TANK FOR PROPER HUMIDIFIER OPERATION.
 - ONLY USED ON THREE PHASE POWER.
 - REFER TO CRUV ELECTRICAL DATA SHEET.

POWER WIRING
CONTROL CIRCUIT WIRING
FIELD WIRING
OPTIONAL FACTORY
OPTIONAL FIELD

LEGEND

K RELAY/CONTACTOR	Y SOLENOID
T TRANSFORMER	N SENSOR
Q CIRCUIT BREAKER	J JUMPER
S SWITCH	E WATER PROBE
H HEATER	M MOTOR/FAN
F FUSE	R SOLID STATE RELAY

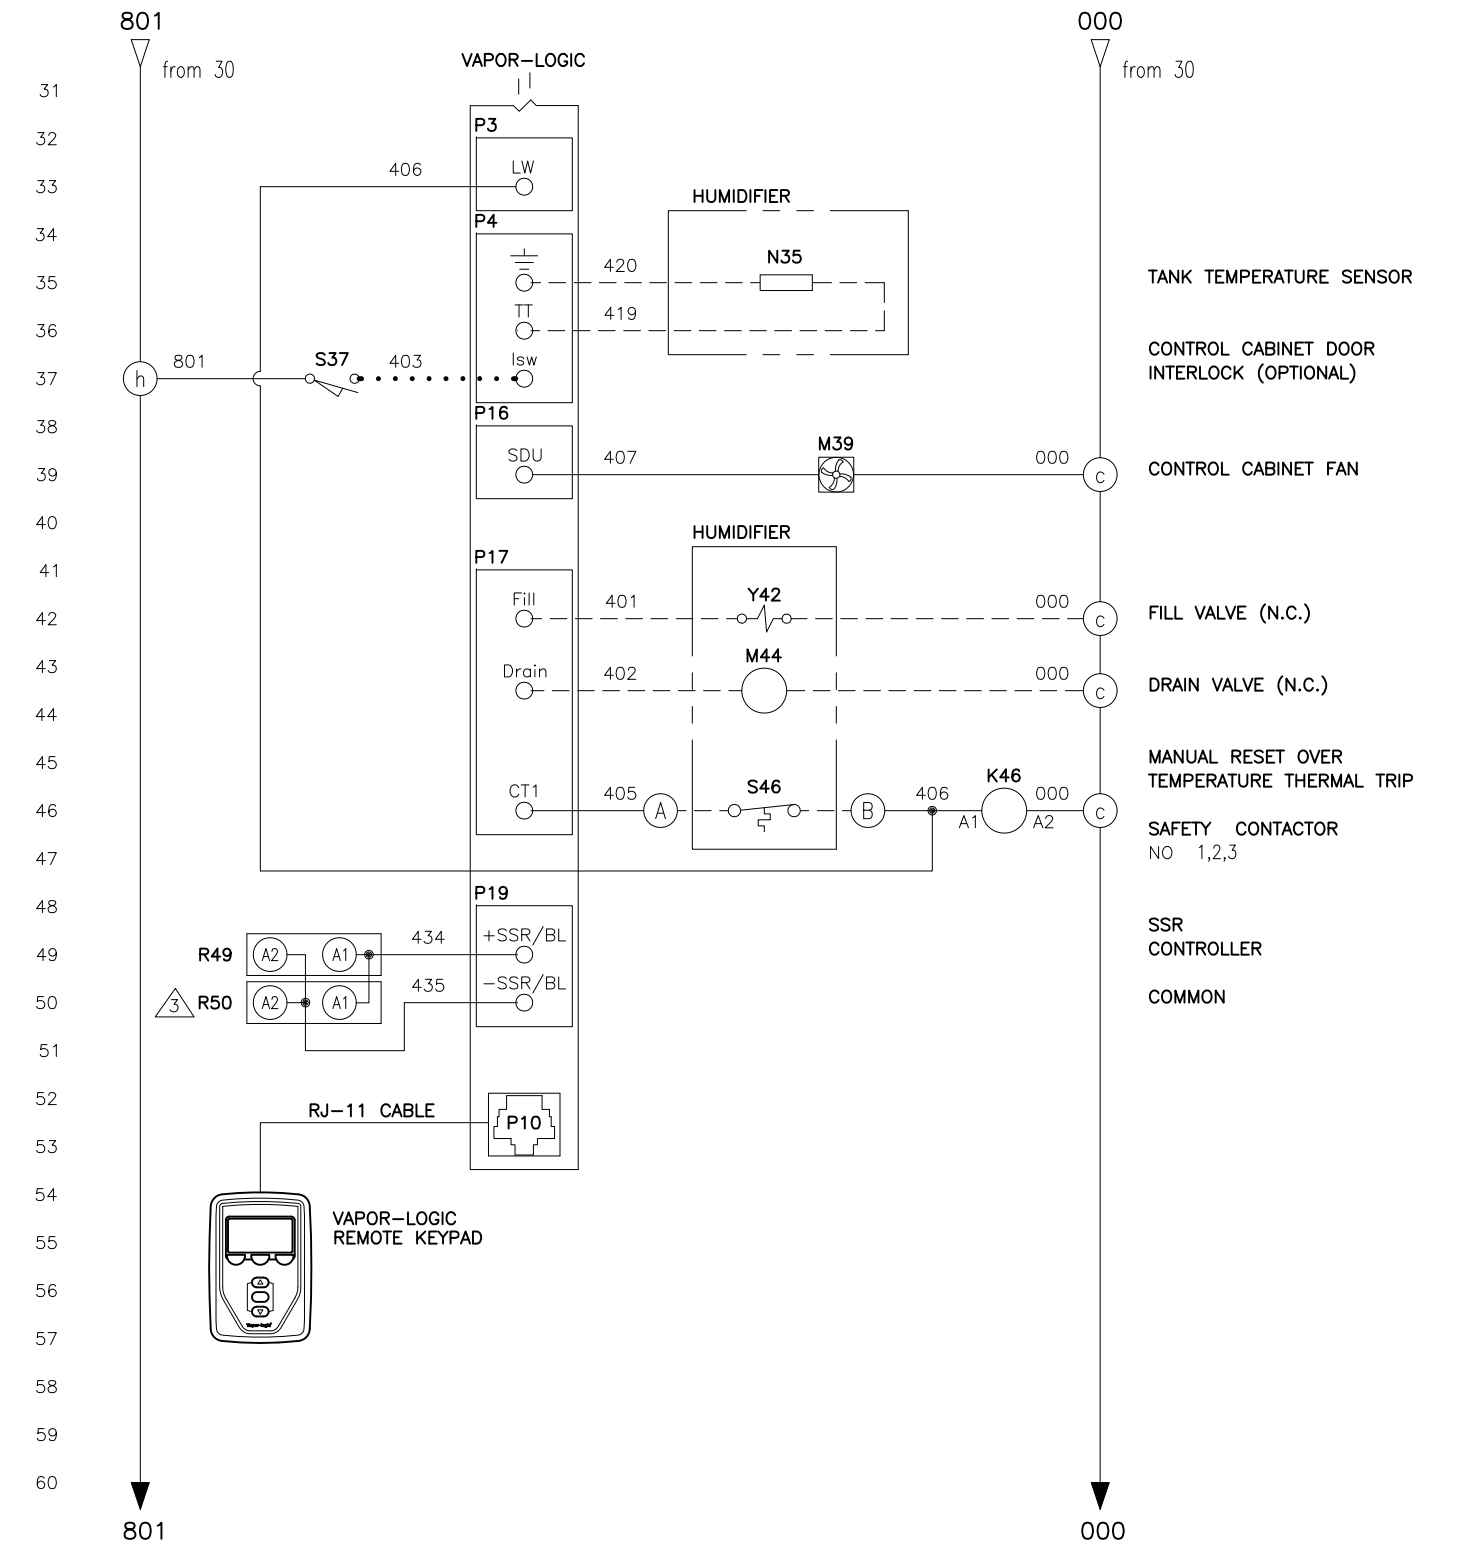

BREAK TO EXTERNAL CONNECTIONS DIAGRAM

DOMESTIC CRUV, STANDARD WATER, SSR WIRING DIAGRAM	
MAT'L:	
SCALE:	P/N
DRAWN BY: KROG	CR-VL5-15
DATE: 11/5/13	

