
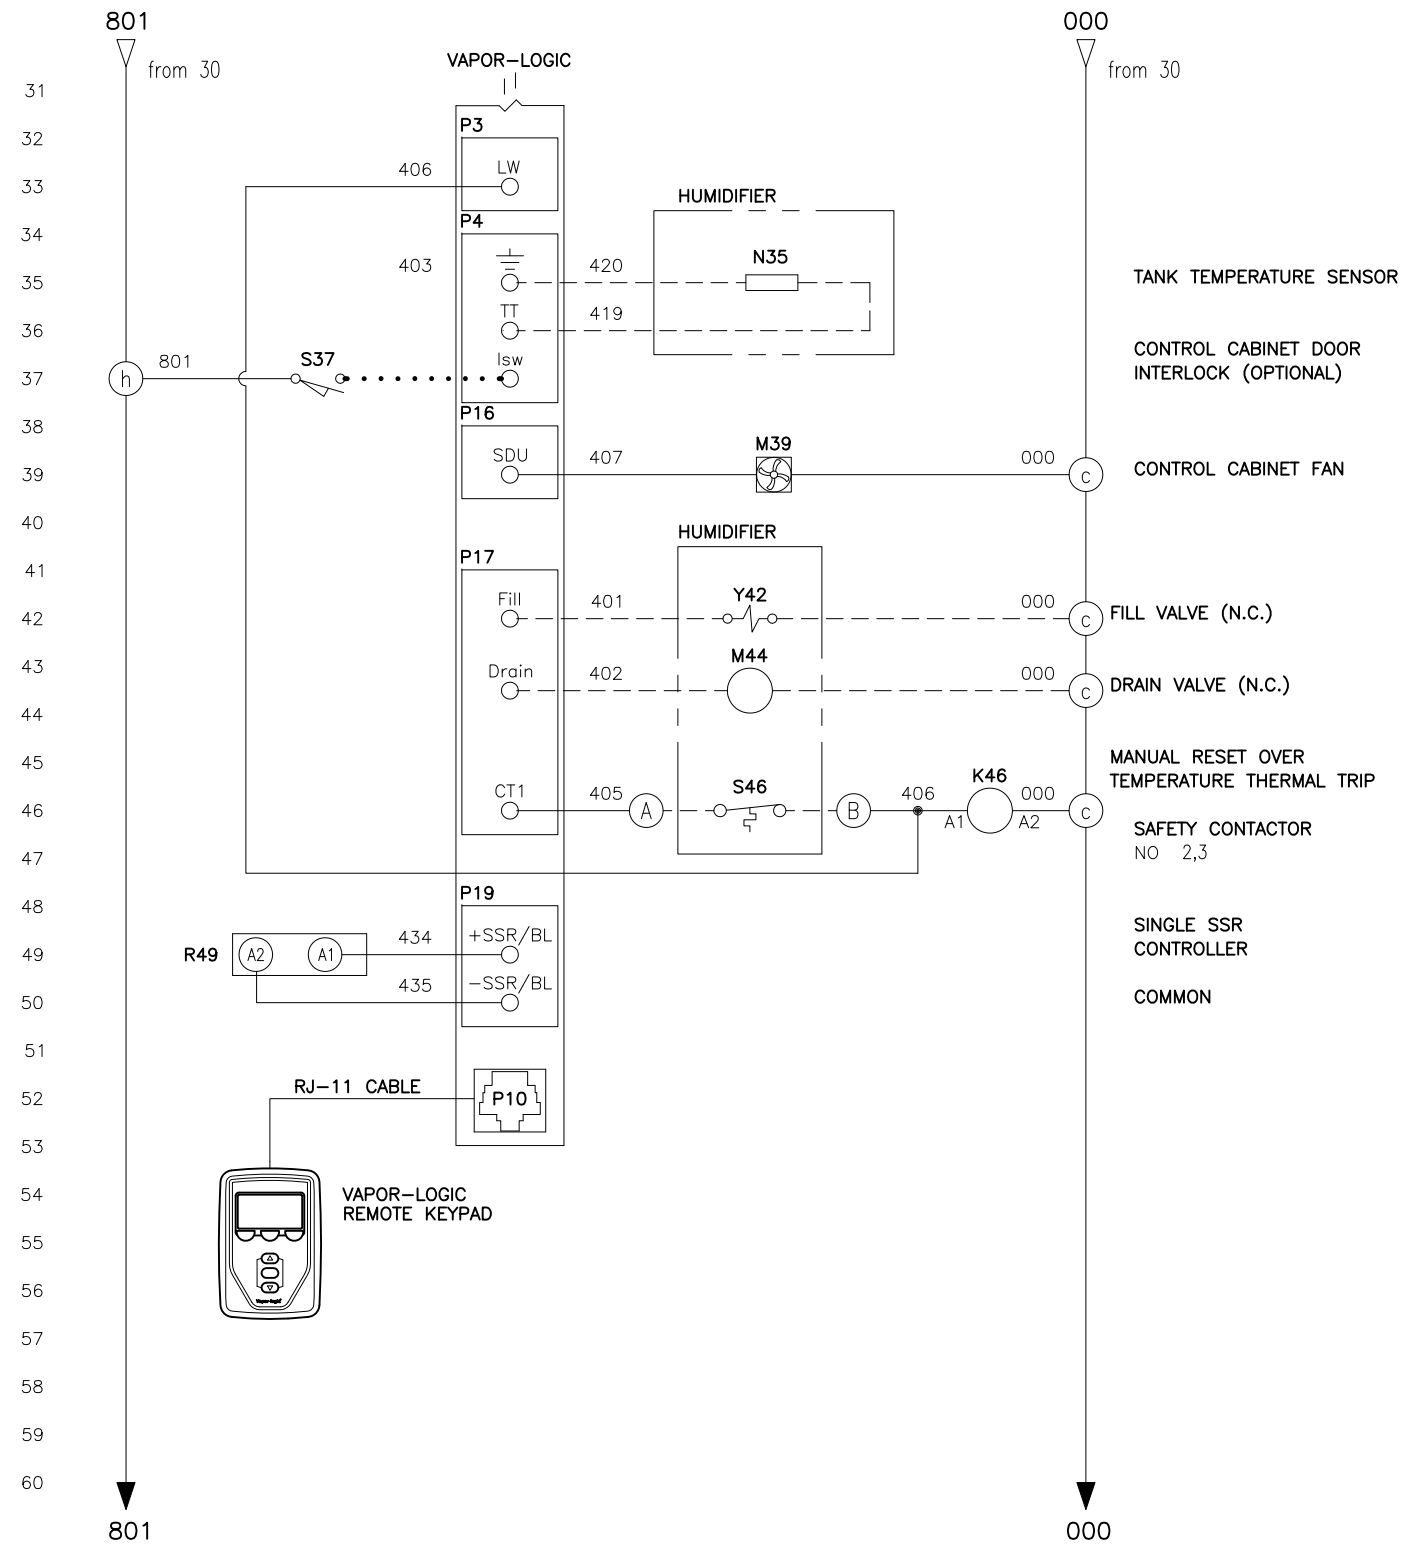


CRUV™ EVAPORATIVE HUMIDIFIER FACTORY WIRING DIAGRAM WITH VAPOR-LOGIC

DATE	REV	RECORD	DR
11/13	A	E.C.# 6157	JK
3/14	B	E.C.# 6238	JK

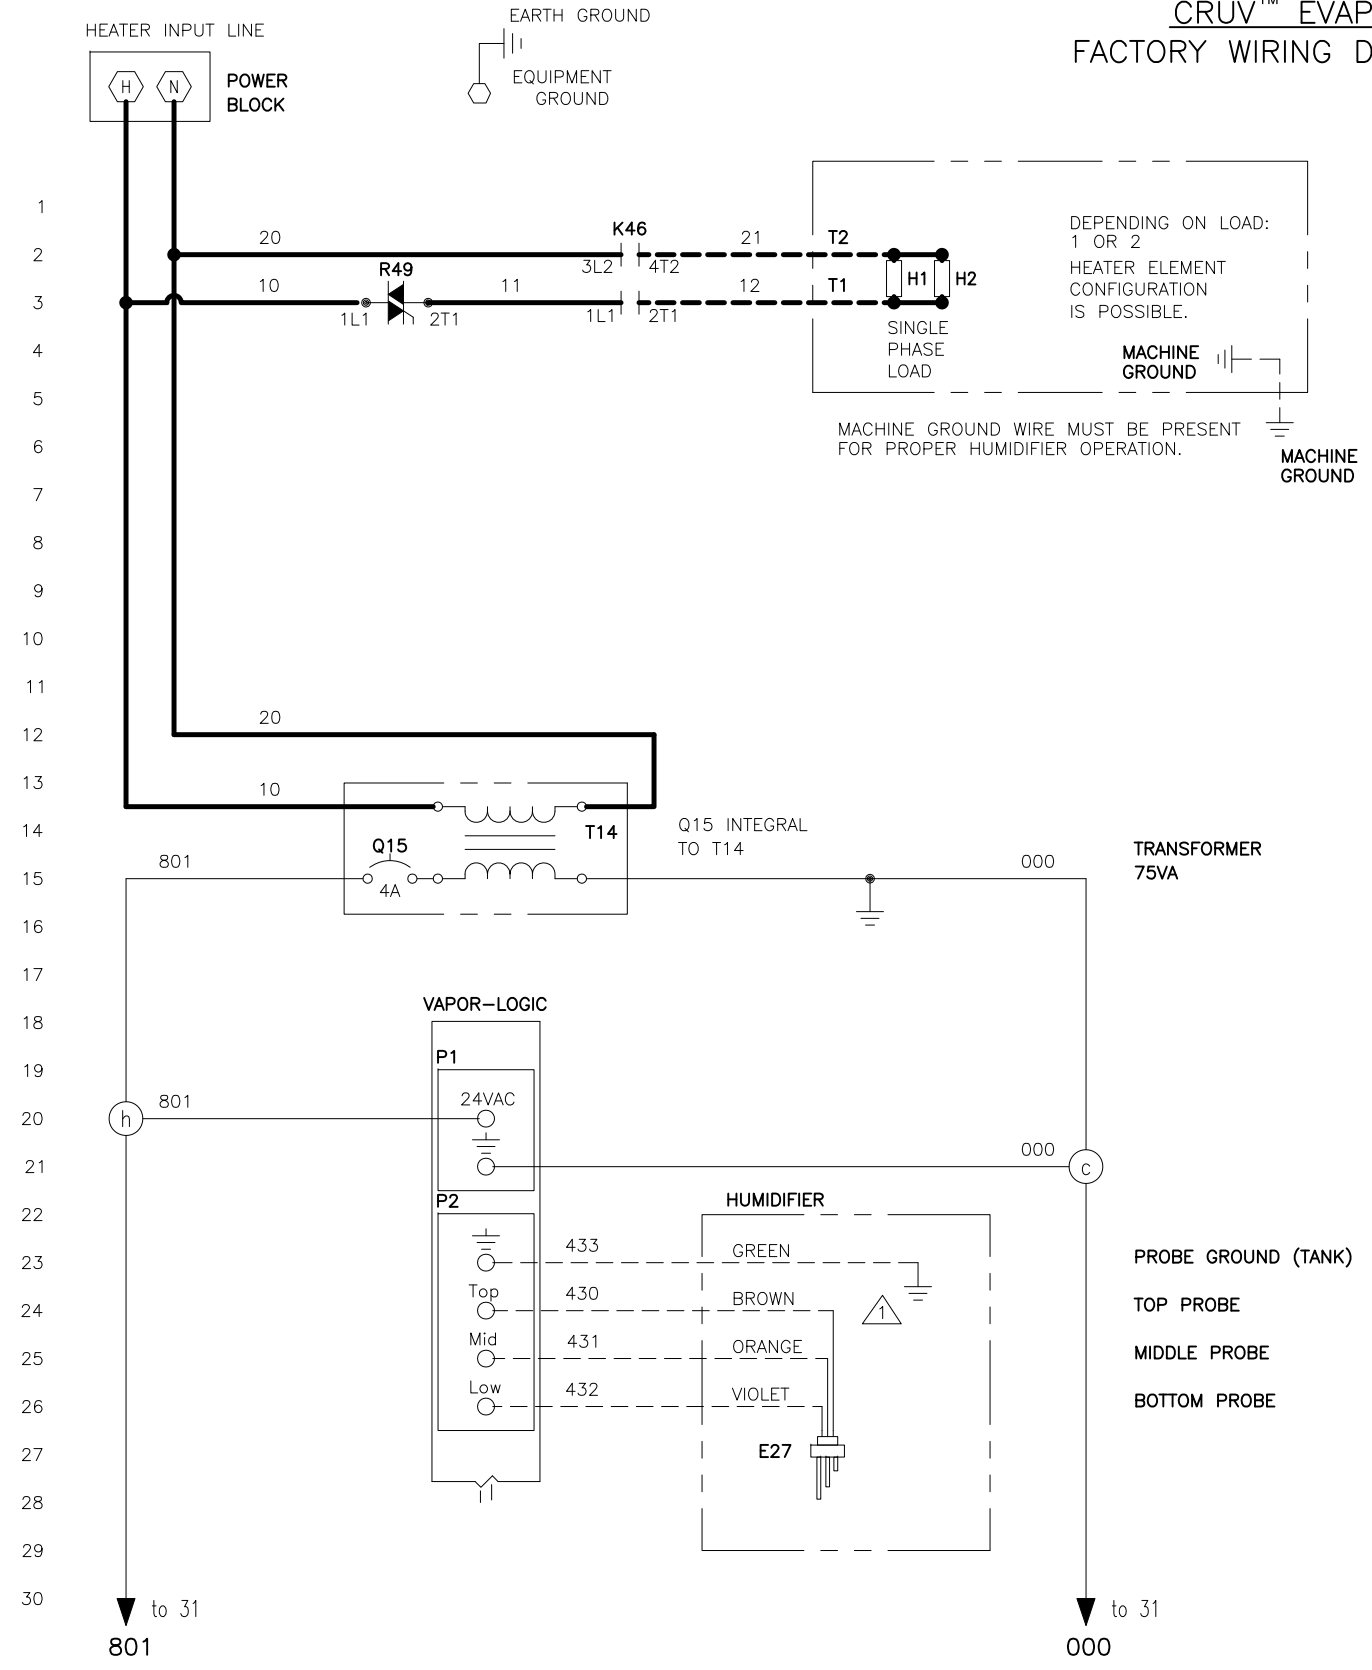

NOTES:
 1. WATER LEVEL PROBE GROUND MUST BE CONNECTED TO TANK FOR PROPER HUMIDIFIER OPERATION.
 2. REFER TO CRUV ELECTRICAL DATA SHEET.

- | | |
|------------------------|---------------------|
| POWER WIRING | LEGEND |
| CONTROL CIRCUIT WIRING | K RELAY/CONTACTOR |
| FIELD WIRING | T TRANSFORMER |
| OPTIONAL FACTORY | Q CIRCUIT BREAKER |
| OPTIONAL FIELD | S SWITCH |
| | H HEATER |
| | F FUSE |
| | Y SOLENOID |
| | N SENSOR |
| | J JUMPER |
| | E WATER PROBE |
| | M MOTOR/FAN |
| | R SOLID STATE RELAY |

DOMESTIC CRUV, STANDARD WATER, SSR, 120 VOLT WIRING DIAGRAM	
MAT'L:	
SCALE:	P/N
DRAWN BY: KROG	CR-VL5-17
DATE: 11/5/13	

