
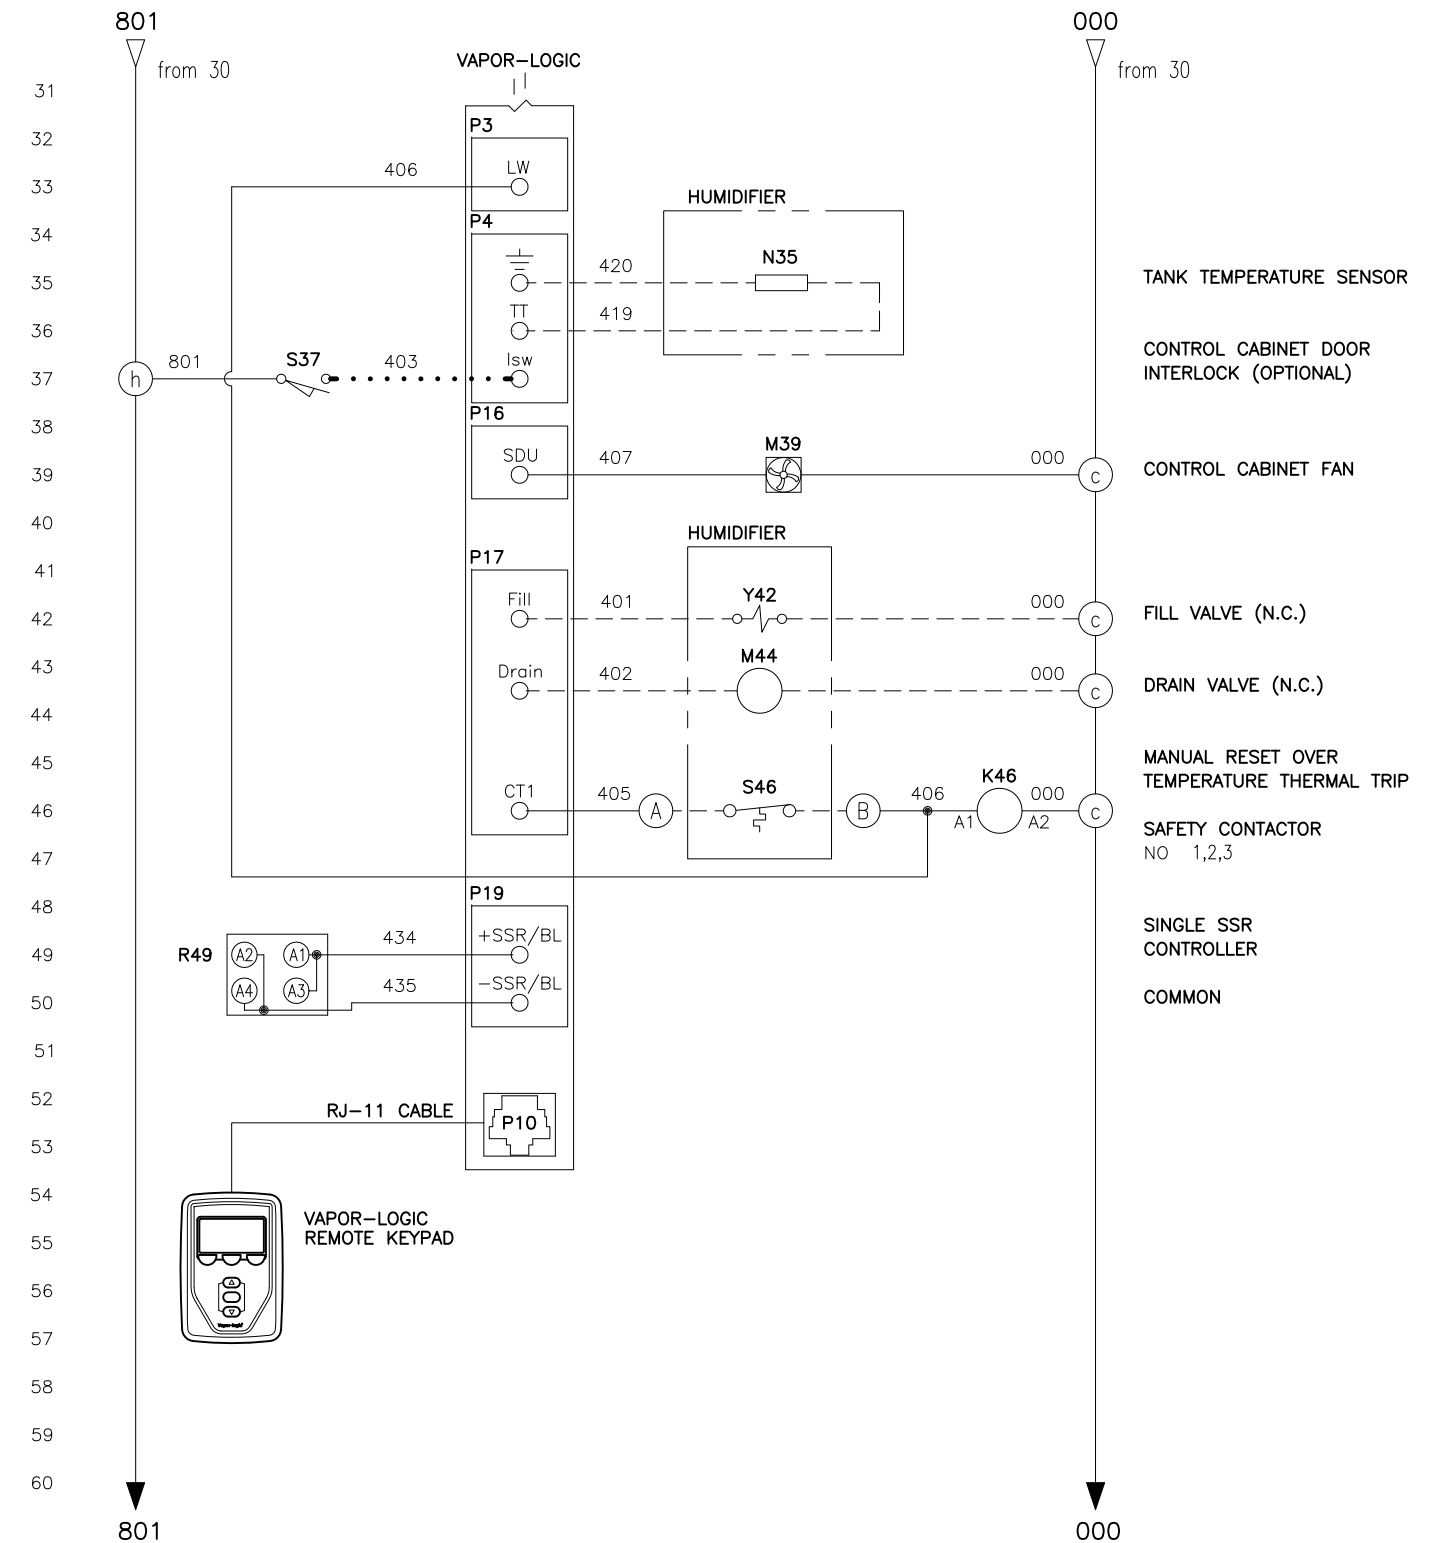


**CRUV™ EVAPORATIVE HUMIDIFIER  
FACTORY WIRING DIAGRAM WITH VAPOR-LOGIC  
FOR RN SERIES SSR'S**

DATE	REV	RECORD	DR
11/13	C	E.C.# 6157	JK
11/13	D	E.C.# 6179	JK
3/14	E	E.C.# 6238	JK

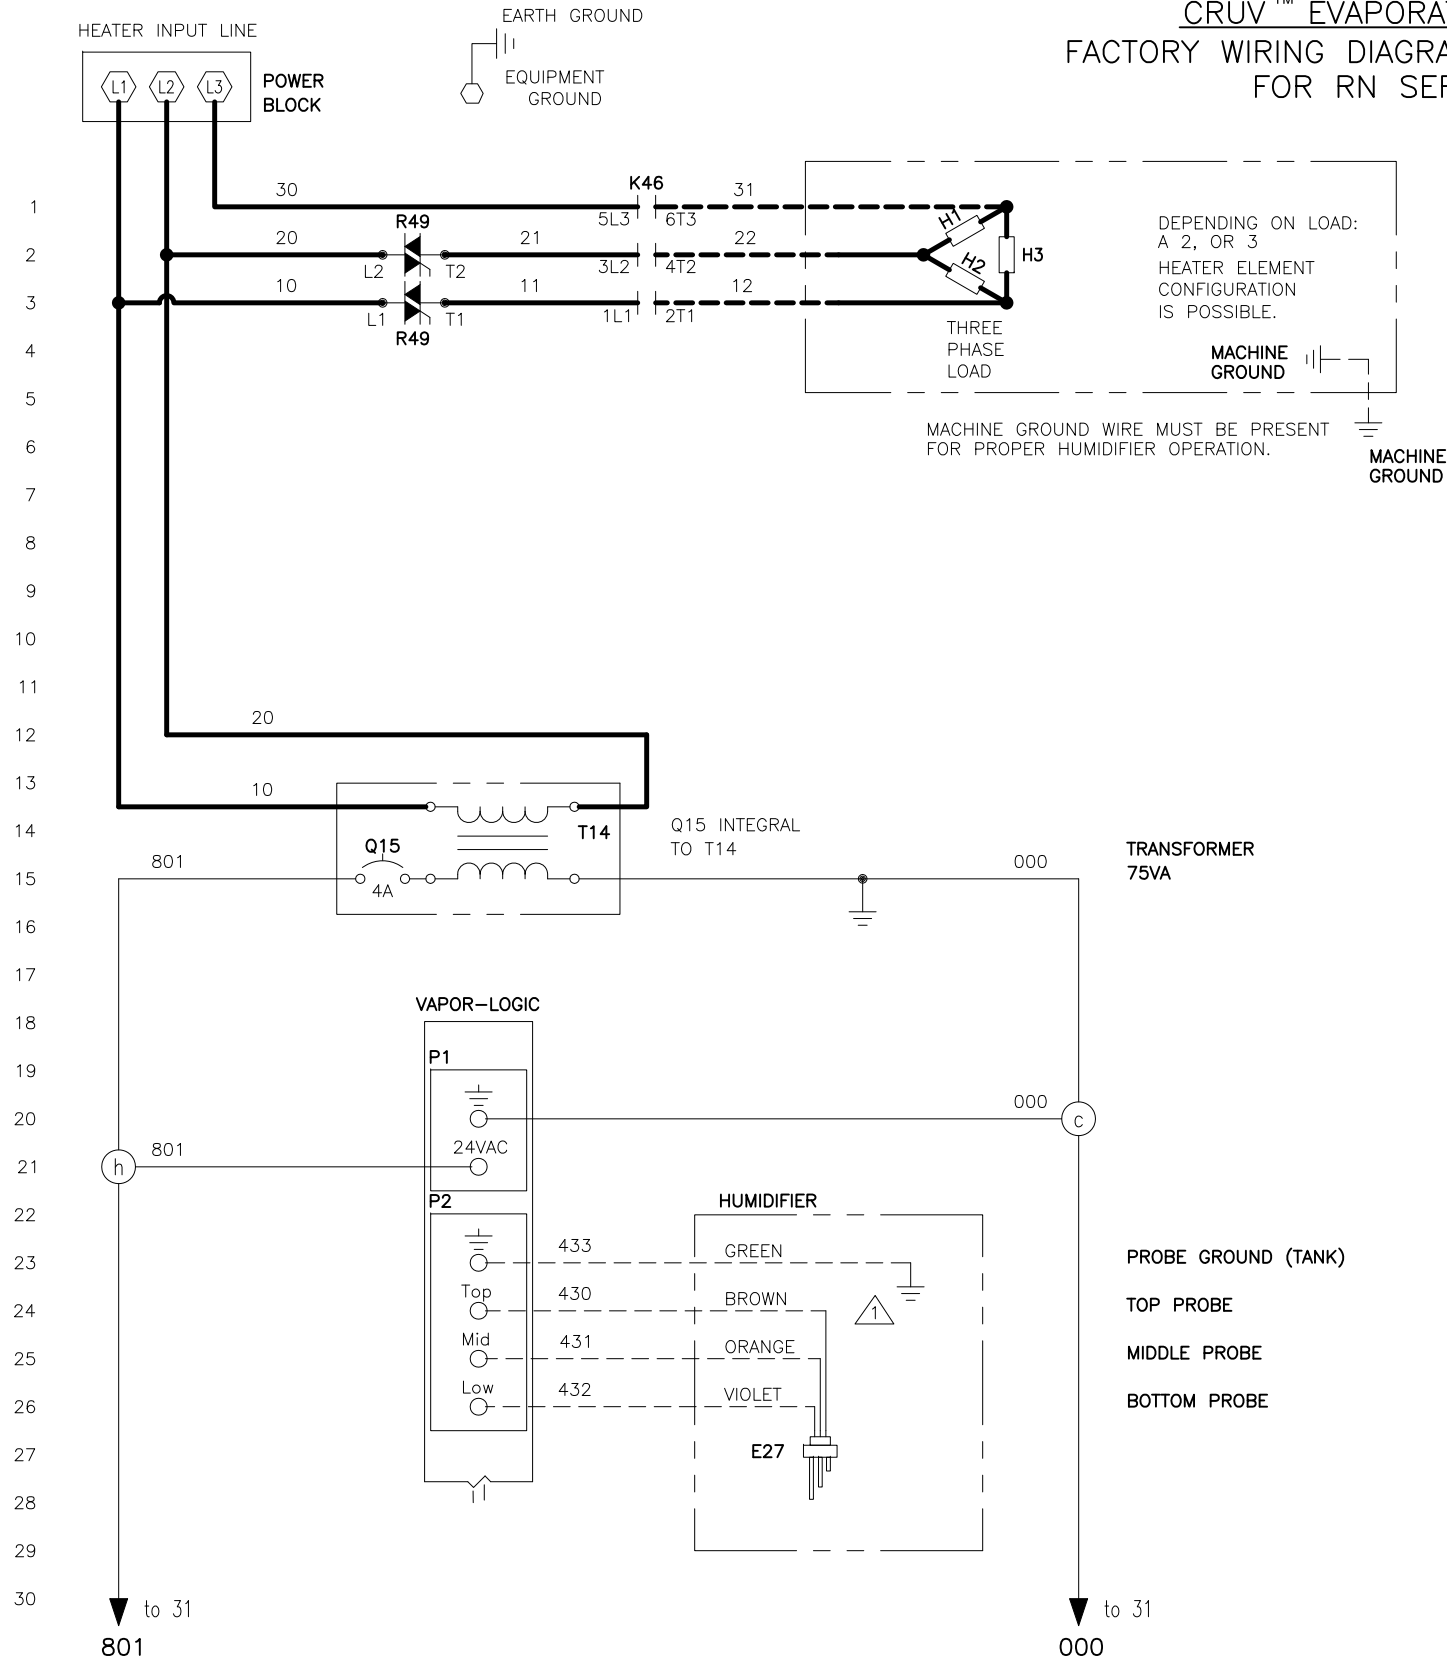

NOTES:  
1. WATER LEVEL PROBE GROUND MUST BE CONNECTED TO TANK FOR PROPER HUMIDIFIER OPERATION.  
2. REFER TO CRUV ELECTRICAL DATA SHEET.

**POWER WIRING**  
CONTROL CIRCUIT WIRING  
FIELD WIRING  
OPTIONAL FACTORY  
OPTIONAL FIELD

**LEGEND**  
K RELAY/CONTACTOR  
T TRANSFORMER  
Q CIRCUIT BREAKER  
S SWITCH  
H HEATER  
F FUSE  
Y SOLENOID  
N SENSOR  
J JUMPER  
E WATER PROBE  
M MOTOR/FAN  
R SOLID STATE RELAY

BREAK TO EXTERNAL CONNECTIONS DIAGRAM

	DOMESTIC CRUV, STANDARD WATER, SINGLE SSR 3Ø WIRING DIAGRAM (LESS THAN OR EQUAL TO 480V.)	
	MAT'L:	
	SCALE:	P/N
	DRAWN BY: KROG	CR-VL5-3
DATE: 12/28/12		