
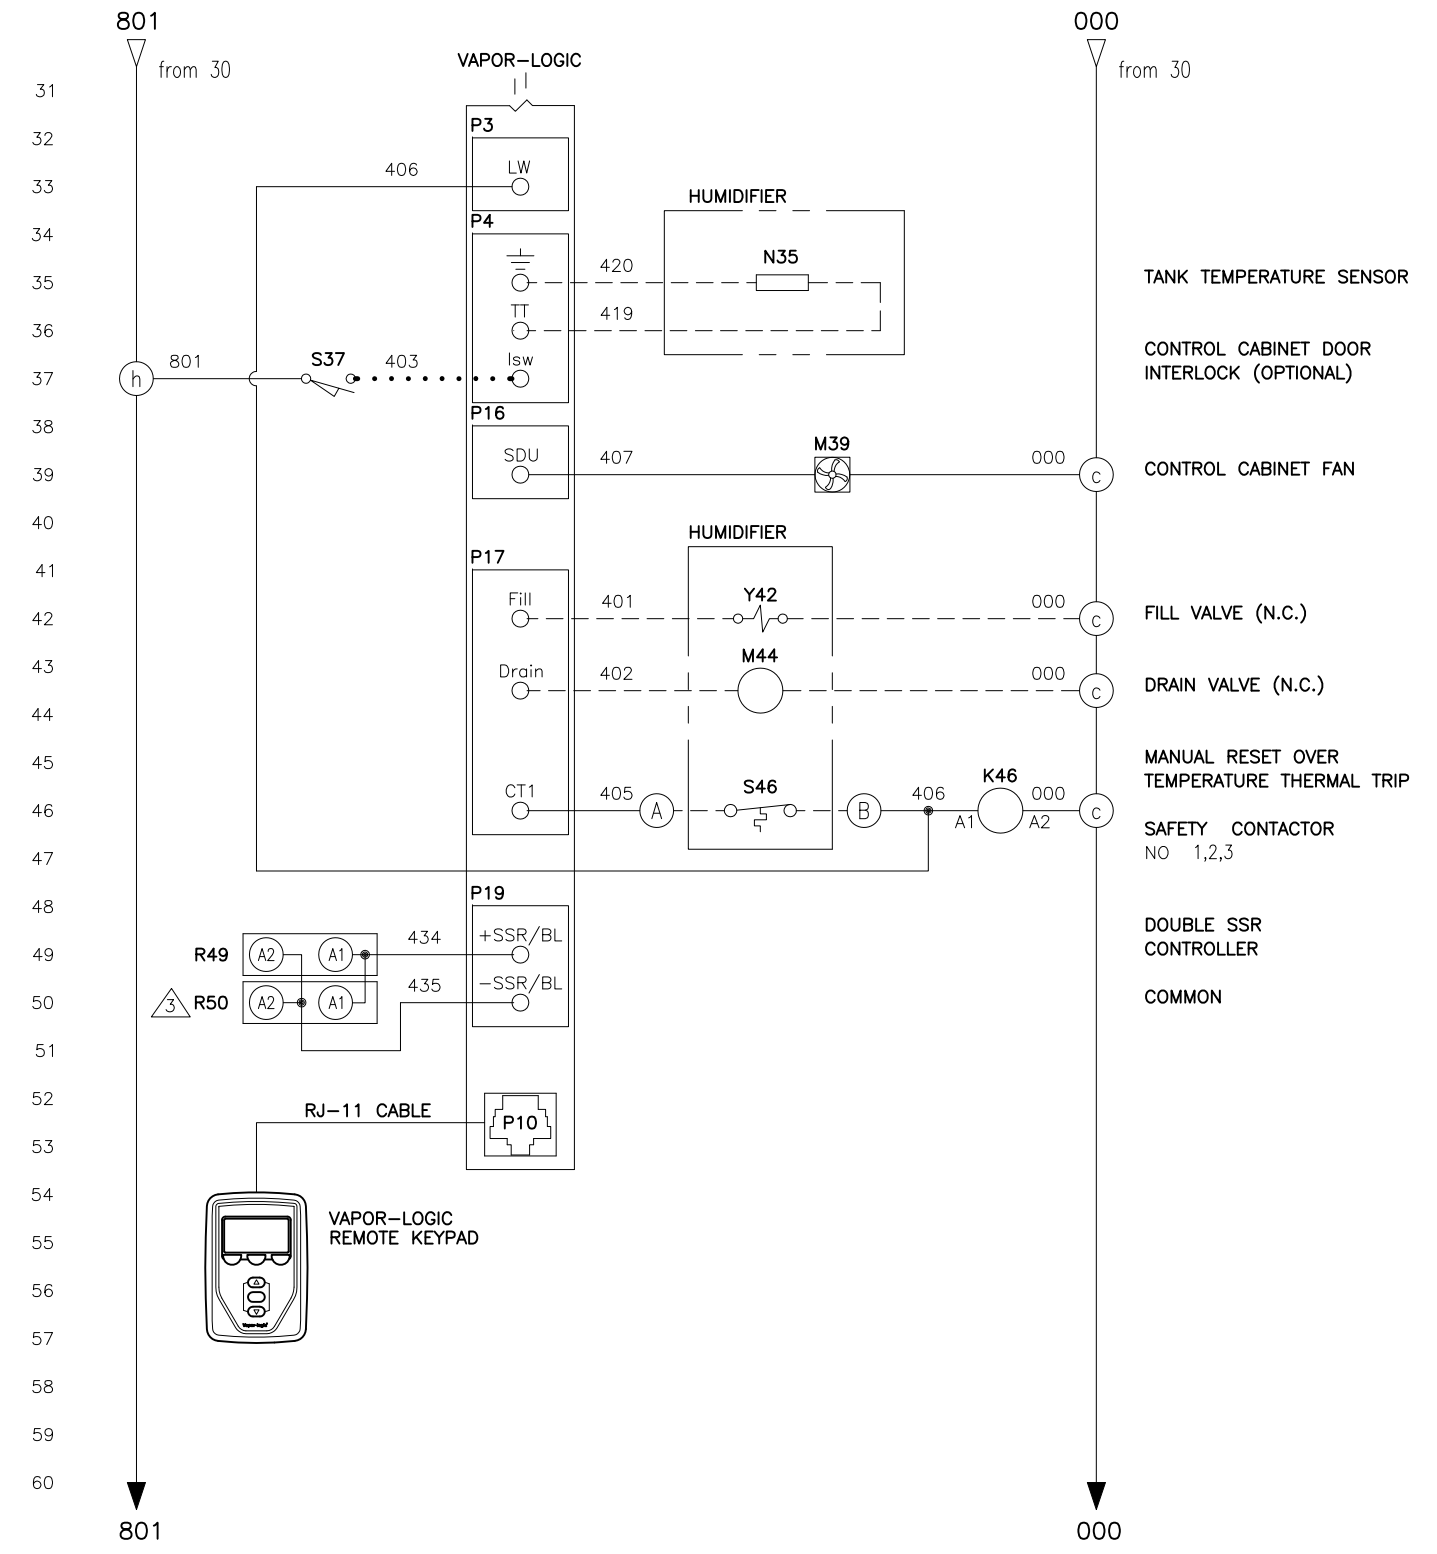


# CRUV™ EVAPORATIVE HUMIDIFIER FACTORY WIRING DIAGRAM WITH VAPOR-LOGIC FOR RN SERIES SSR'S

DATE	REV	RECORD	DR
11/13	C	E.C.# 6157	JK
11/13	D	E.C.# 6179	JK
3/14	E	E.C.# 6238	JK

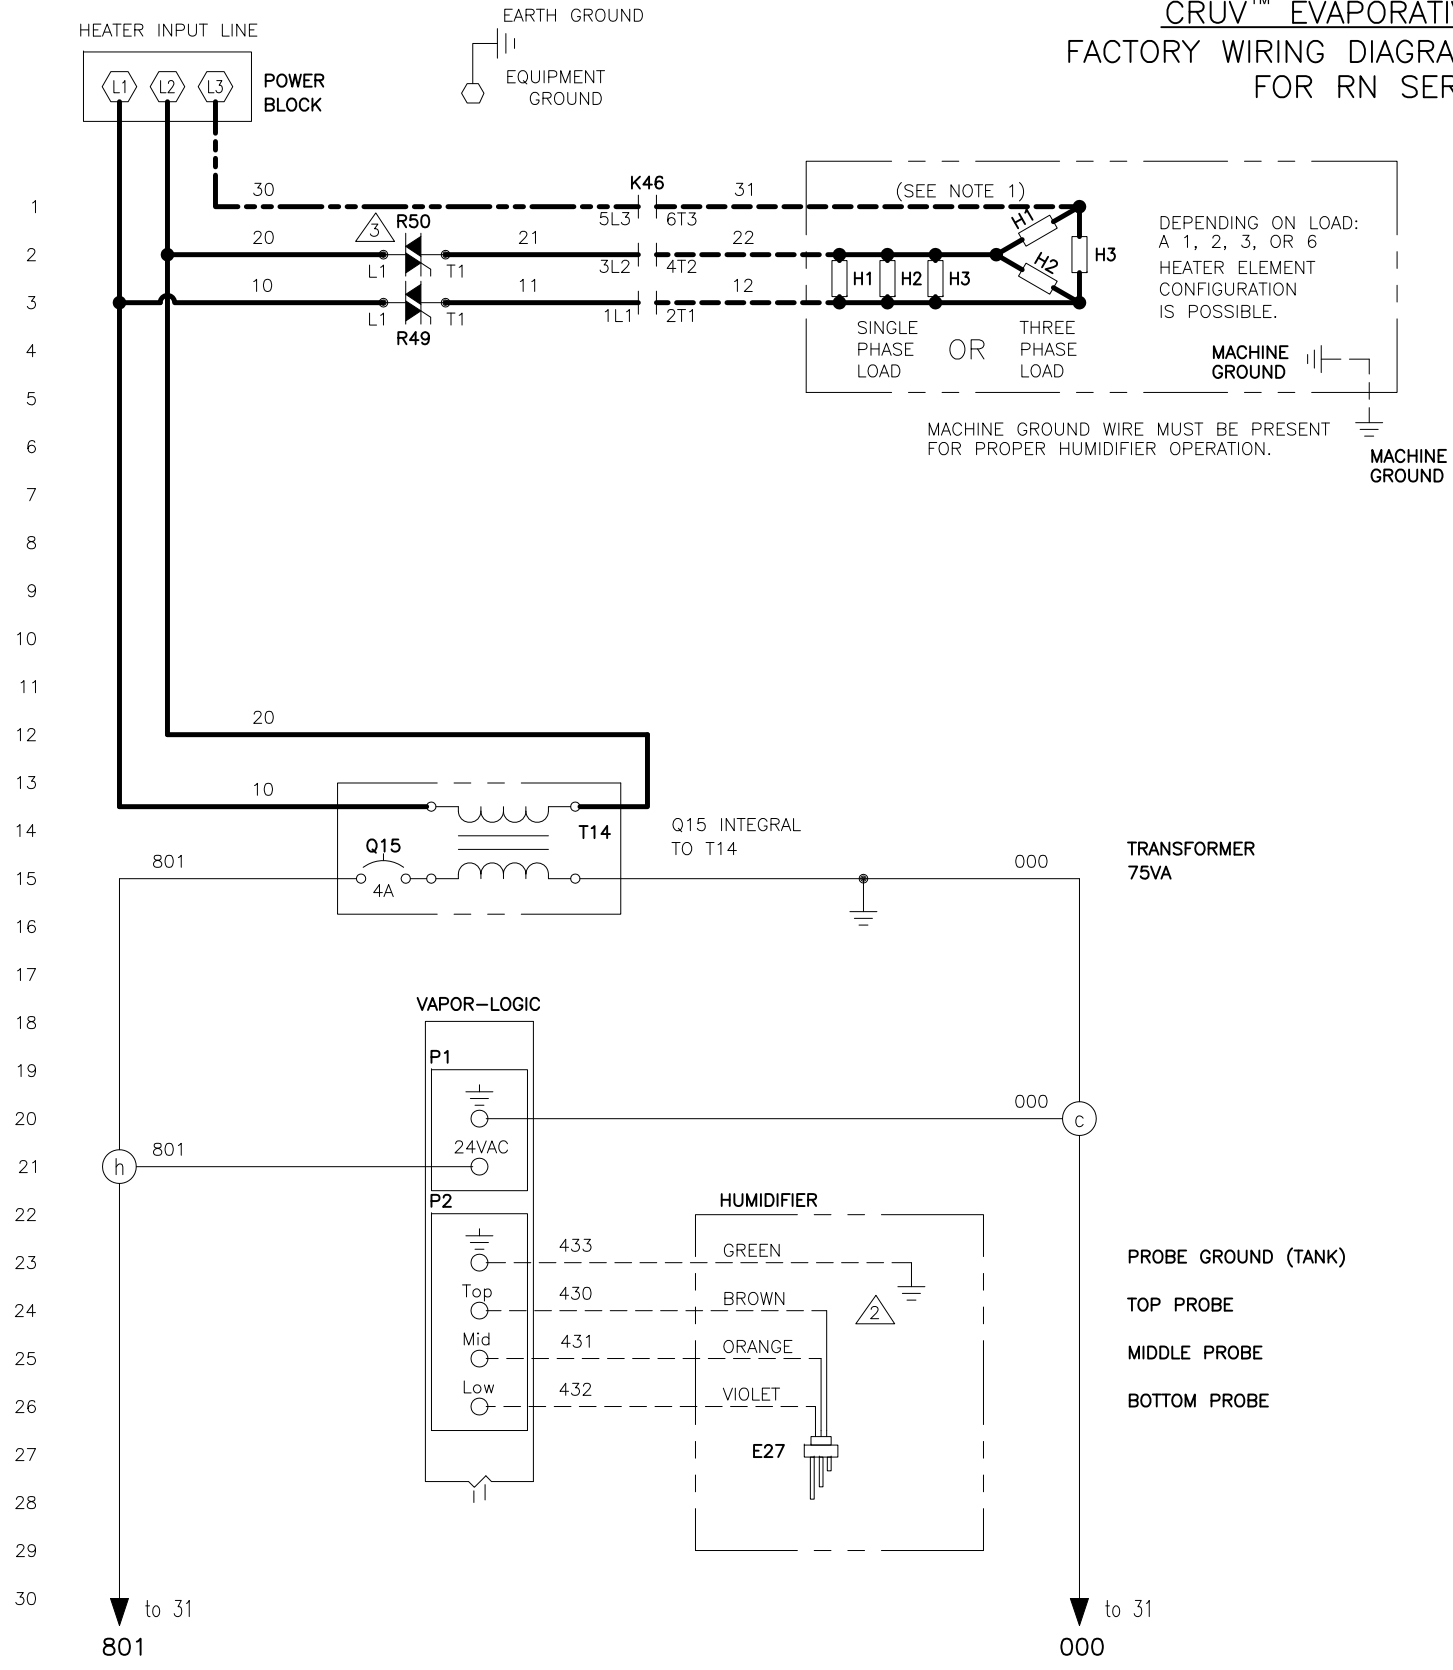

- NOTES:
- FOR THREE PHASE SYSTEM, THE THREE PHASE LOAD IS USED AND THIS WIRE IS FACTORY INSTALLED.
  - WATER LEVEL PROBE GROUND MUST BE CONNECTED TO TANK FOR PROPER HUMIDIFIER OPERATION.
  - ONLY USED ON THREE PHASE POWER.
  - REFER TO CRUV ELECTRICAL DATA SHEET.

POWER WIRING		LEGEND	
—	CONTROL CIRCUIT WIRING	K	RELAY/CONTACTOR
—	FIELD WIRING	T	TRANSFORMER
—	OPTIONAL FACTORY	Q	CIRCUIT BREAKER
—	OPTIONAL FIELD	S	SWITCH
—		H	HEATER
—		F	FUSE
—		Y	SOLENOID
—		N	SENSOR
—		J	JUMPER
—		E	WATER PROBE
—		M	MOTOR/FAN
—		R	SOLID STATE RELAY

BREAK TO EXTERNAL CONNECTIONS DIAGRAM

	DOMESTIC CRUV, STANDARD WATER, DOUBLE SSR WIRING DIAGRAM (LESS THAN OR EQUAL TO 480V.)	
	MATERIAL: P/N CR-VL5-4	
SCALE: DRAWN BY: KROG DATE: 12/28/12		