
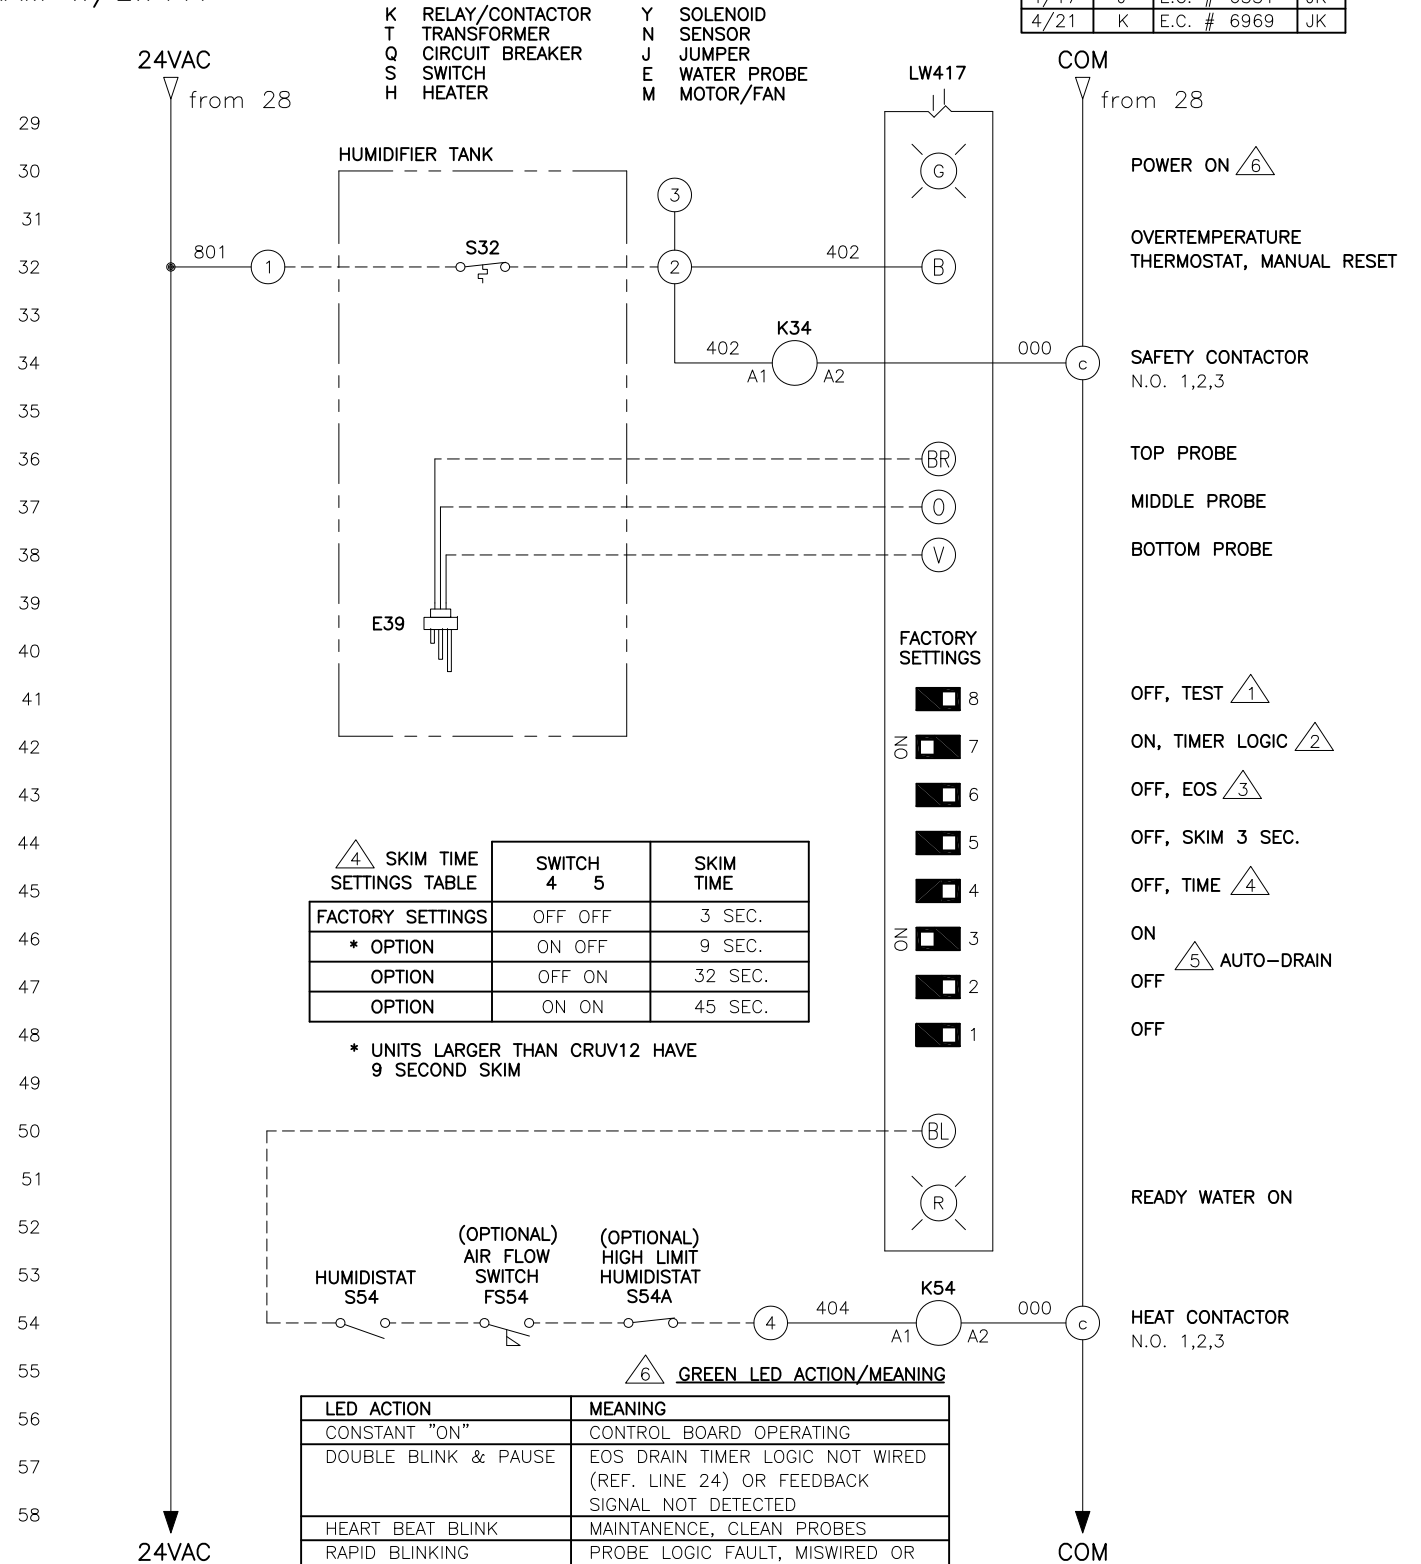


CRUV™ EVAPORATIVE HUMIDIFIER  
WIRING DIAGRAM W/LW417

DATE	REV	RECORD	DR
3/14	I	E.C. # 6238	JK
4/17	J	E.C. # 6551	JK
4/21	K	E.C. # 6969	JK

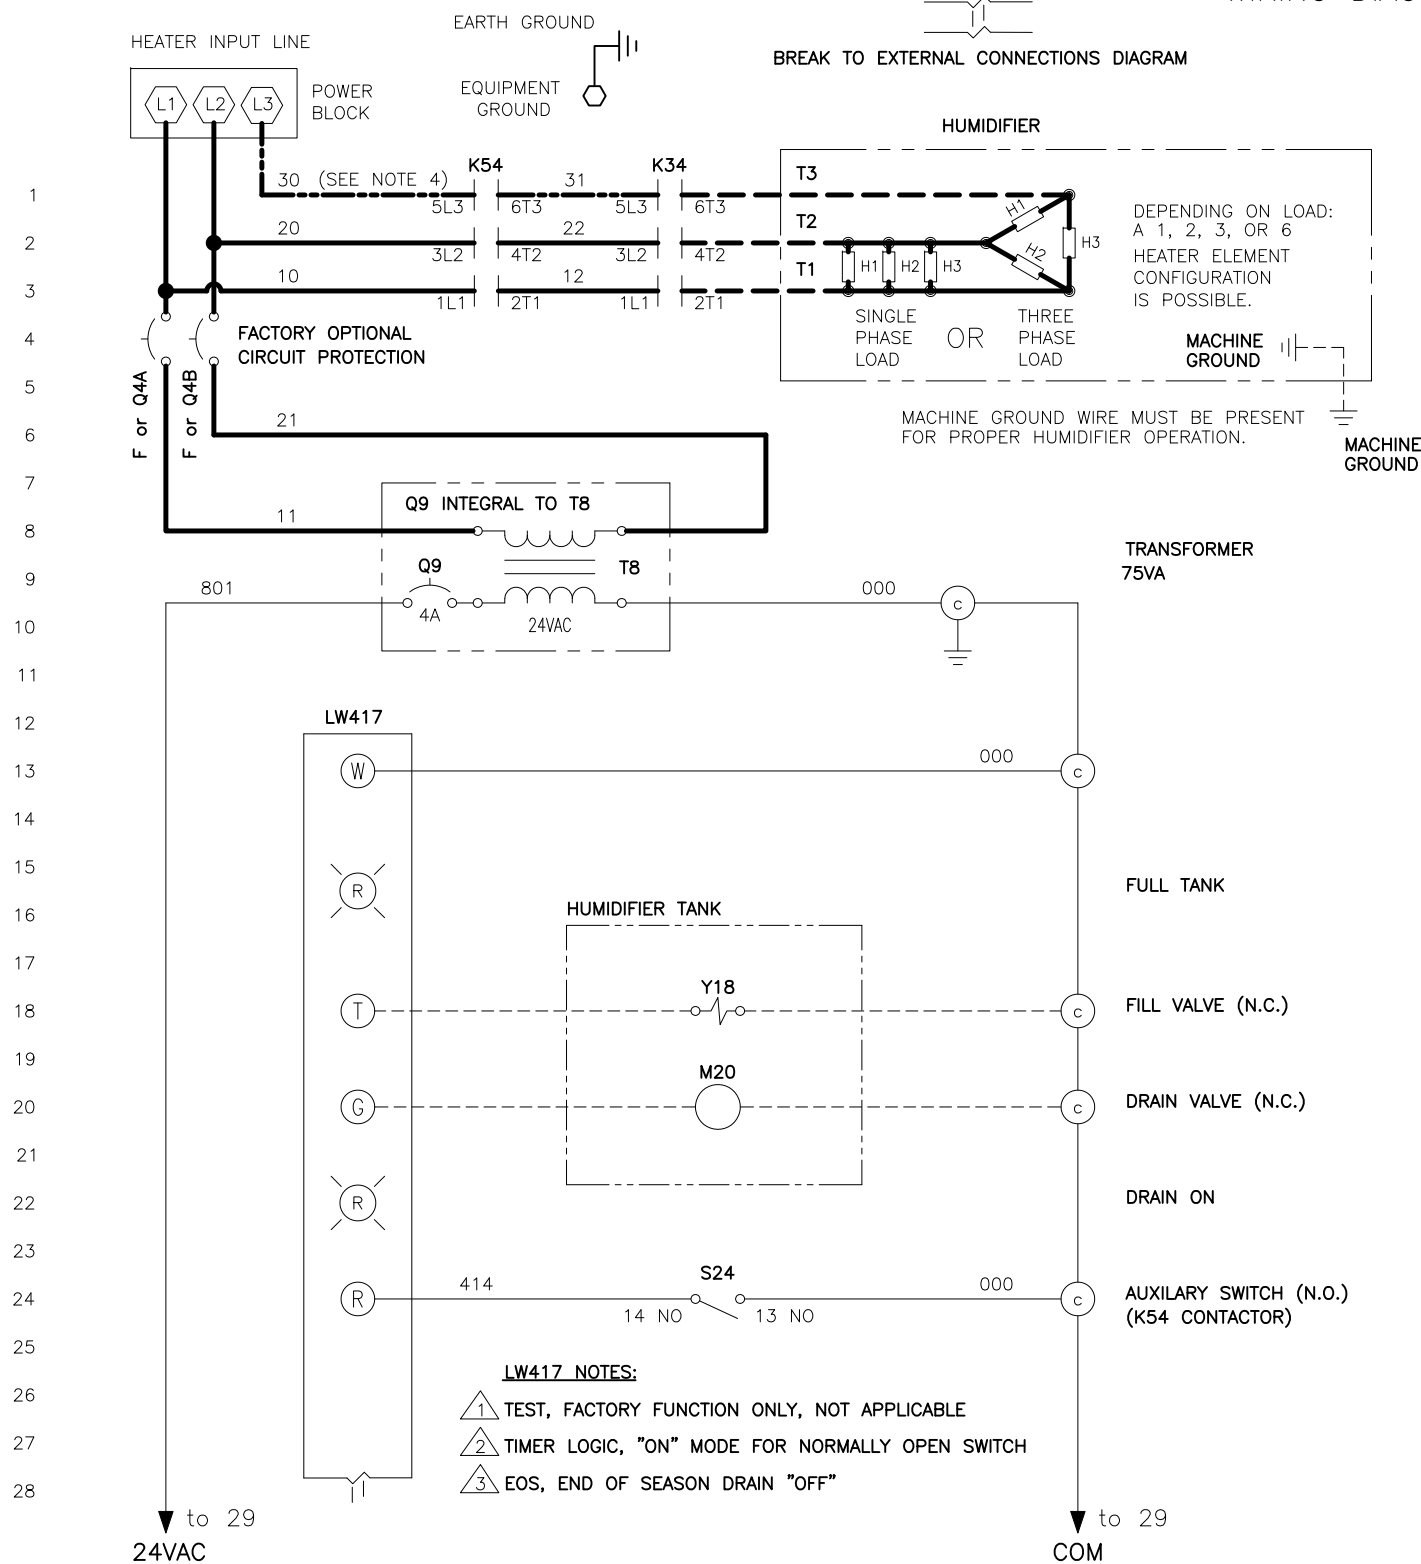

5 AUTO-DRAIN SETTINGS TABLE

	SWITCH 1	SWITCH 2	SWITCH 3	DRAIN TIME	INTERVAL TIME
SELF TEST	OFF	OFF	OFF	10 MIN.	2 MIN.
DISABLED	ON	OFF	OFF	-----	-----
OPTION	OFF	ON	OFF	10 MIN.	20 HRS
OPTION	ON	ON	OFF	30 MIN.	20 HRS
FACTORY SETTINGS	OFF	OFF	ON	10 MIN.	40 HRS
OPTION	ON	OFF	ON	30 MIN.	40 HRS
OPTION	OFF	ON	ON	10 MIN.	80 HRS
OPTION	ON	ON	ON	30 MIN.	80 HRS

NOTES:  
4. FOR THREE PHASE SYSTEM, THE THREE PHASE LOAD IS USED AND THIS WIRE IS FACTORY INSTALLED.  
5. REFER TO CRUV ELECTRICAL DATA SHEET.

POWER WIRING  
CONTROL CIRCUIT WIRING  
FIELD WIRING

CR-LW417-1

CRUV, STANDARD WATER ON/OFF CTRL DIAGRAM

MAT'L:  
SCALE:  
DRAWN BY: KROG  
DATE: 5/6/02

P/N  
CR-LW417-1