


DATE	REV	RECORD	DR
10/19	A	E.C.# 6843	JK
12/19	B	E.C.# 6858	JK
7/24	C	E.C.# 7296	JK

## GTS LX WITH VL OUTDOOR ENCLOSURE WIRING DIAGRAM

### LEGEND

POWER WIRING  
 OPTIONAL FACTORY

K RELAY  
 H HEATER  
 Q CIRCUIT BREAKER  
 S SWITCH  
 M FAN

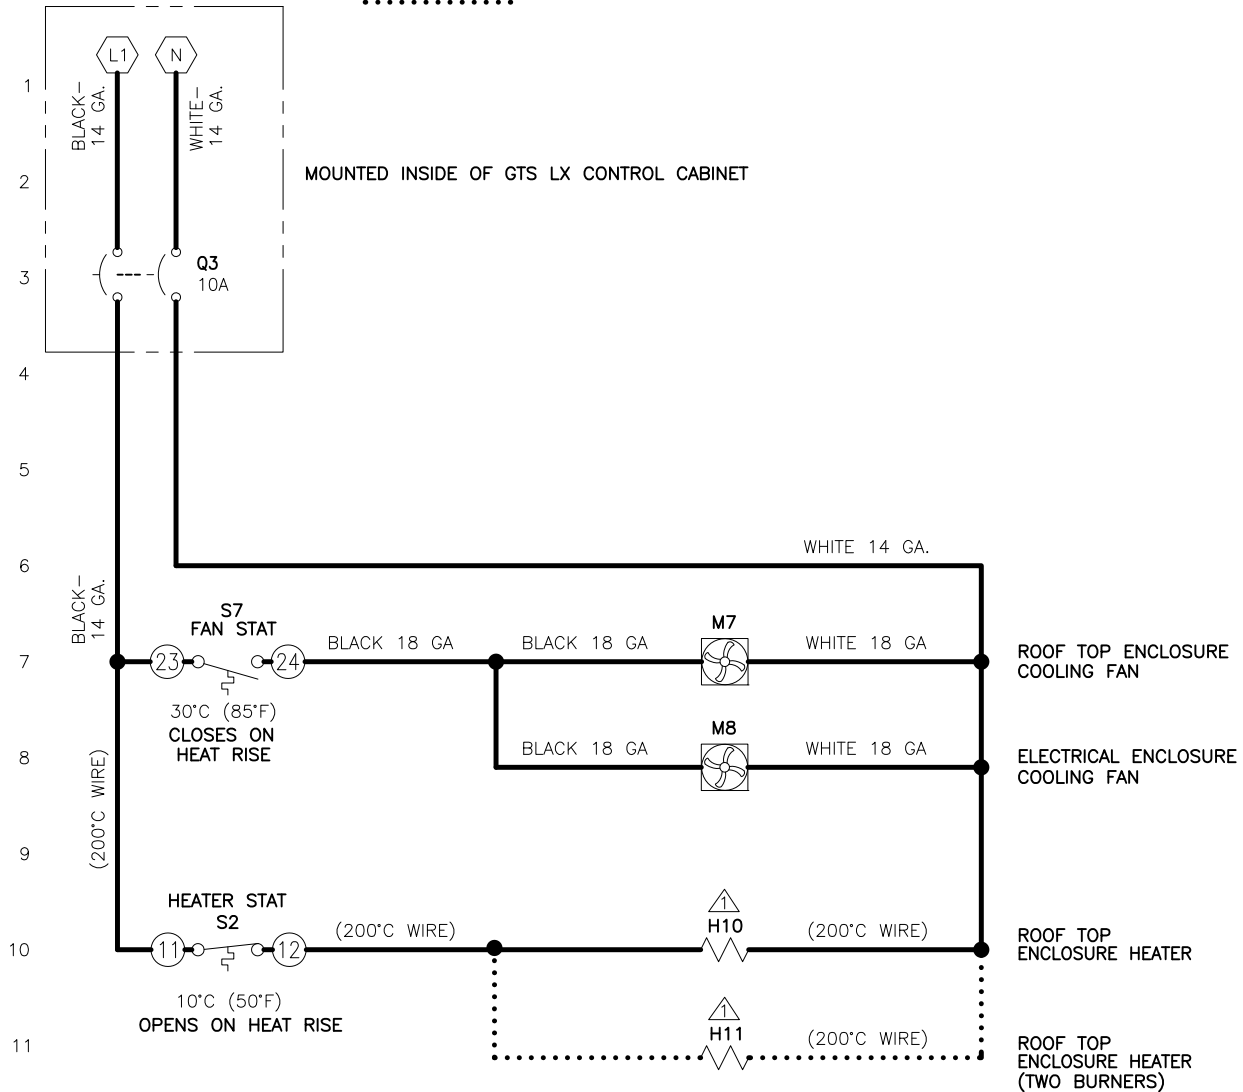

### NOTES:

1. USE UNINSULATED RING TERMINALS FOR TERMINATIONS AT HEATER LUGS.
2. ALL WIRING IS 14 GAUGE UNLESS NOTED OTHERWISE.
3. CAP ALL LOOSE LINE VOLTAGE WIRES BEFORE TEST.

		GTS LX W/VL OUTDOOR ENCLOSURE WIRING DIAGRAM	
		MAT'L:	P/N
SCALE:	DATE:	GTS-LX-VL-5	
DRAWN BY: JK	10/9/19		