


DATE	REV	RECORD	DR
6/25	A	E.C.# 7389	JK

HPA OUTDOOR ENCLOSURE WIRING DIAGRAM

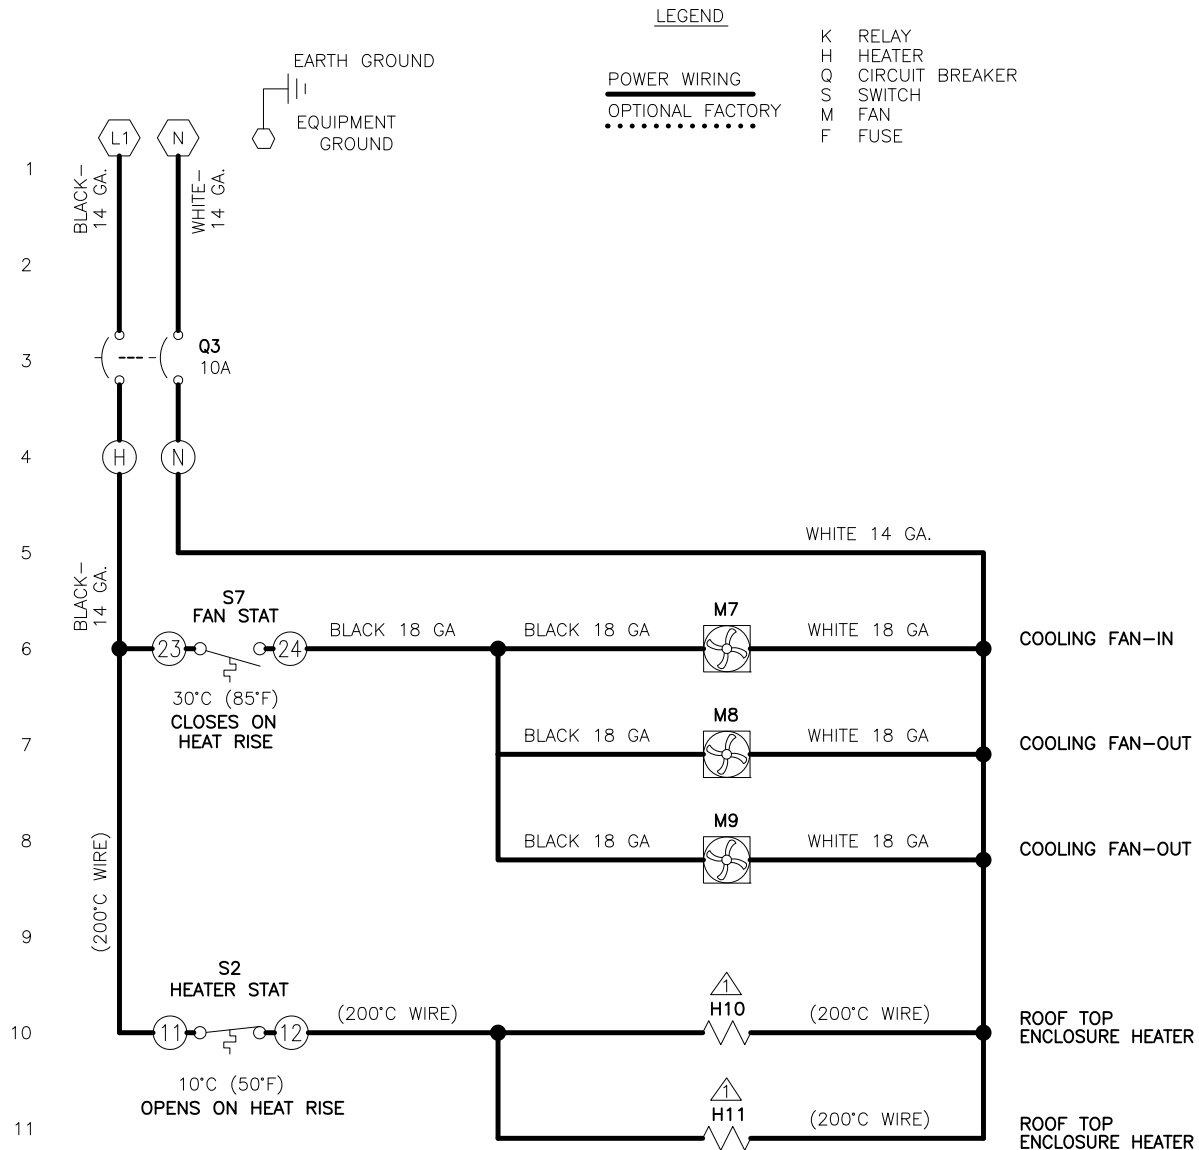

NOTES:

1. USE UNINSULATED RING TERMINALS FOR TERMINATIONS AT HEATER LUGS.
2. ALL WIRING IS 14 GAUGE UNLESS NOTED OTHERWISE.

		HPA OUTDOOR ENCLOSURE WIRING DIAGRAM	
		MAT'L:	P/N
SCALE:		HPAS-PS-VL-OE	
DRAWN BY: SBK		DATE: 06/04/25	