
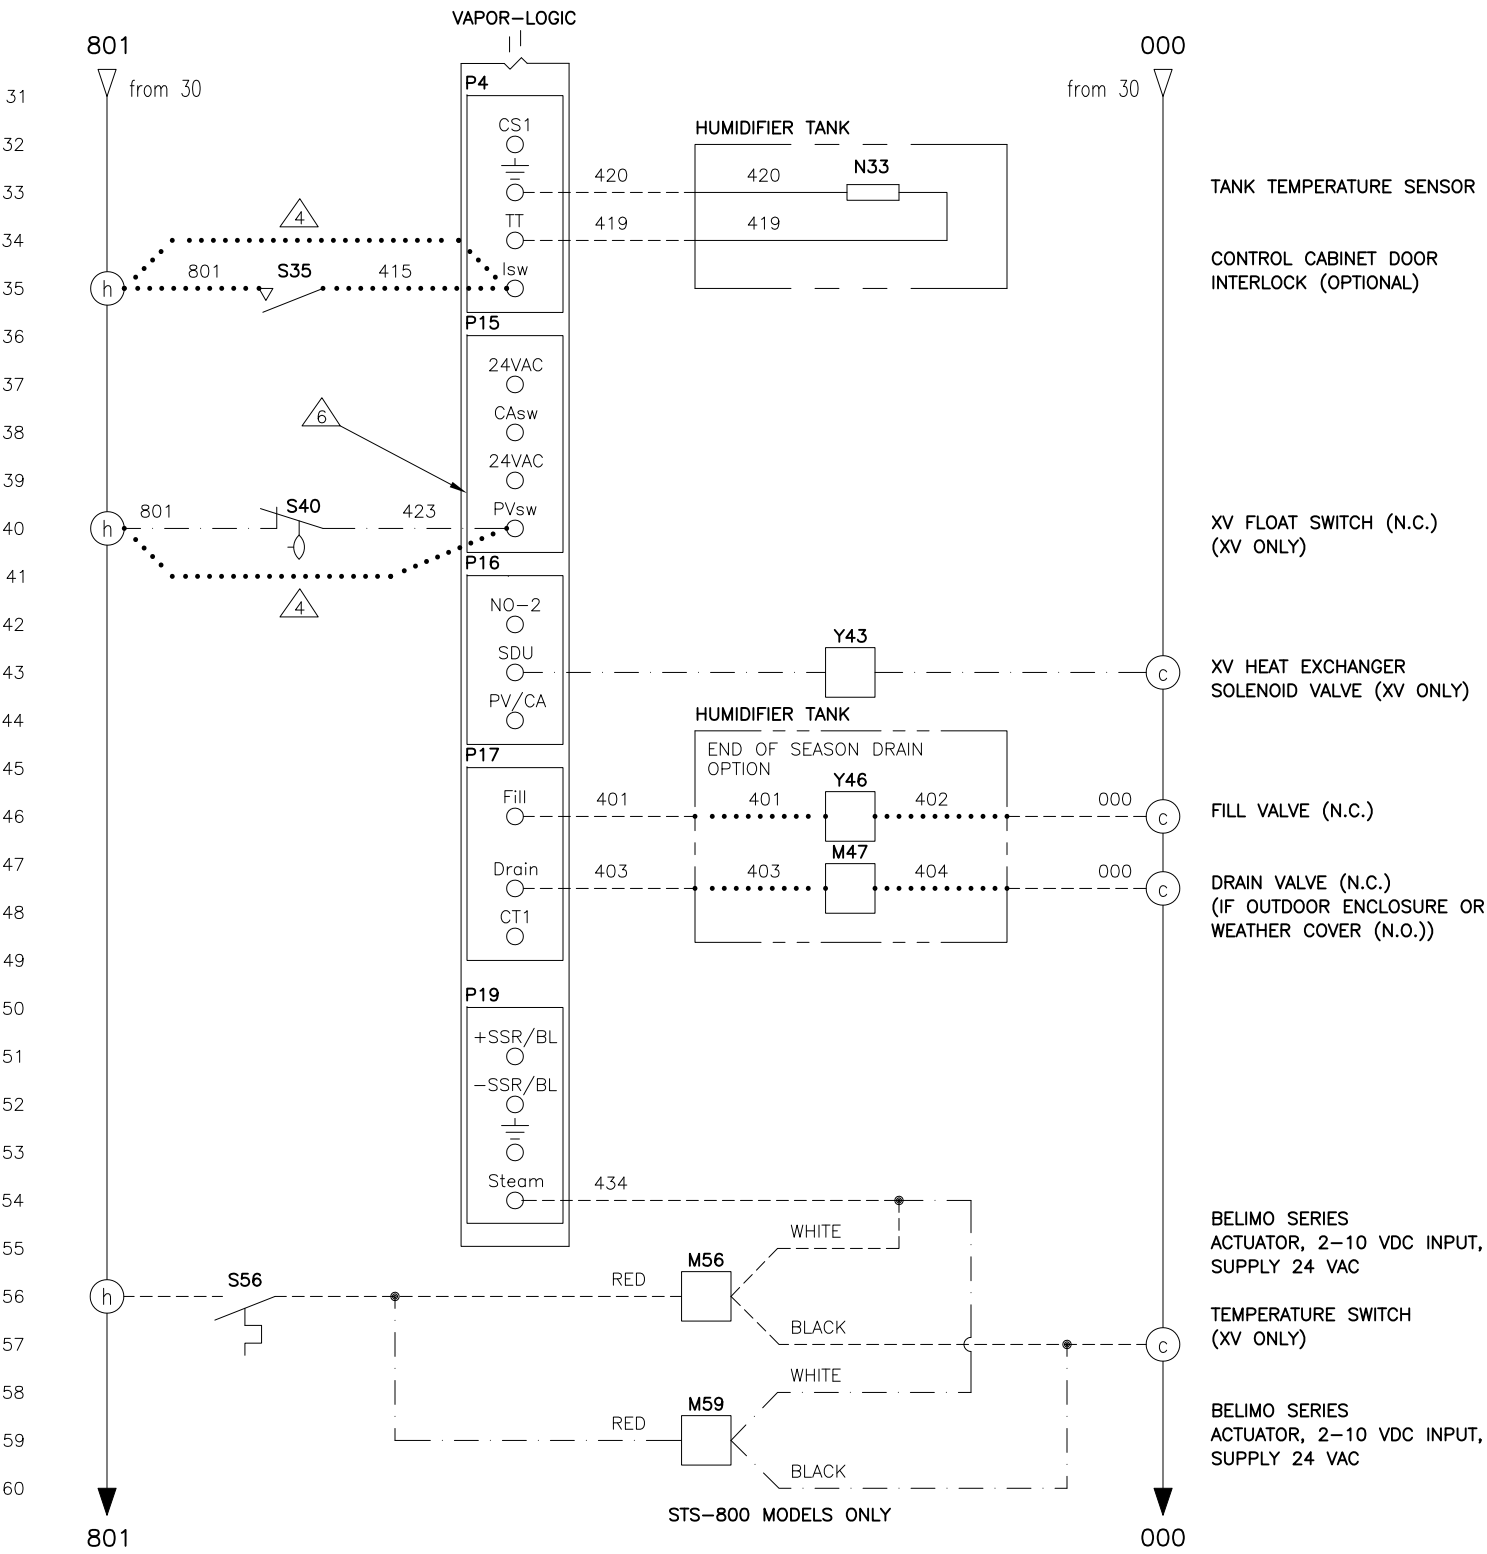


STS[®] DI EVAPORATIVE HUMIDIFIER
WIRING DIAGRAM W/VL[®]

DATE	REV	RECORD	DR
12/24	A	E.C.# 7334	JK

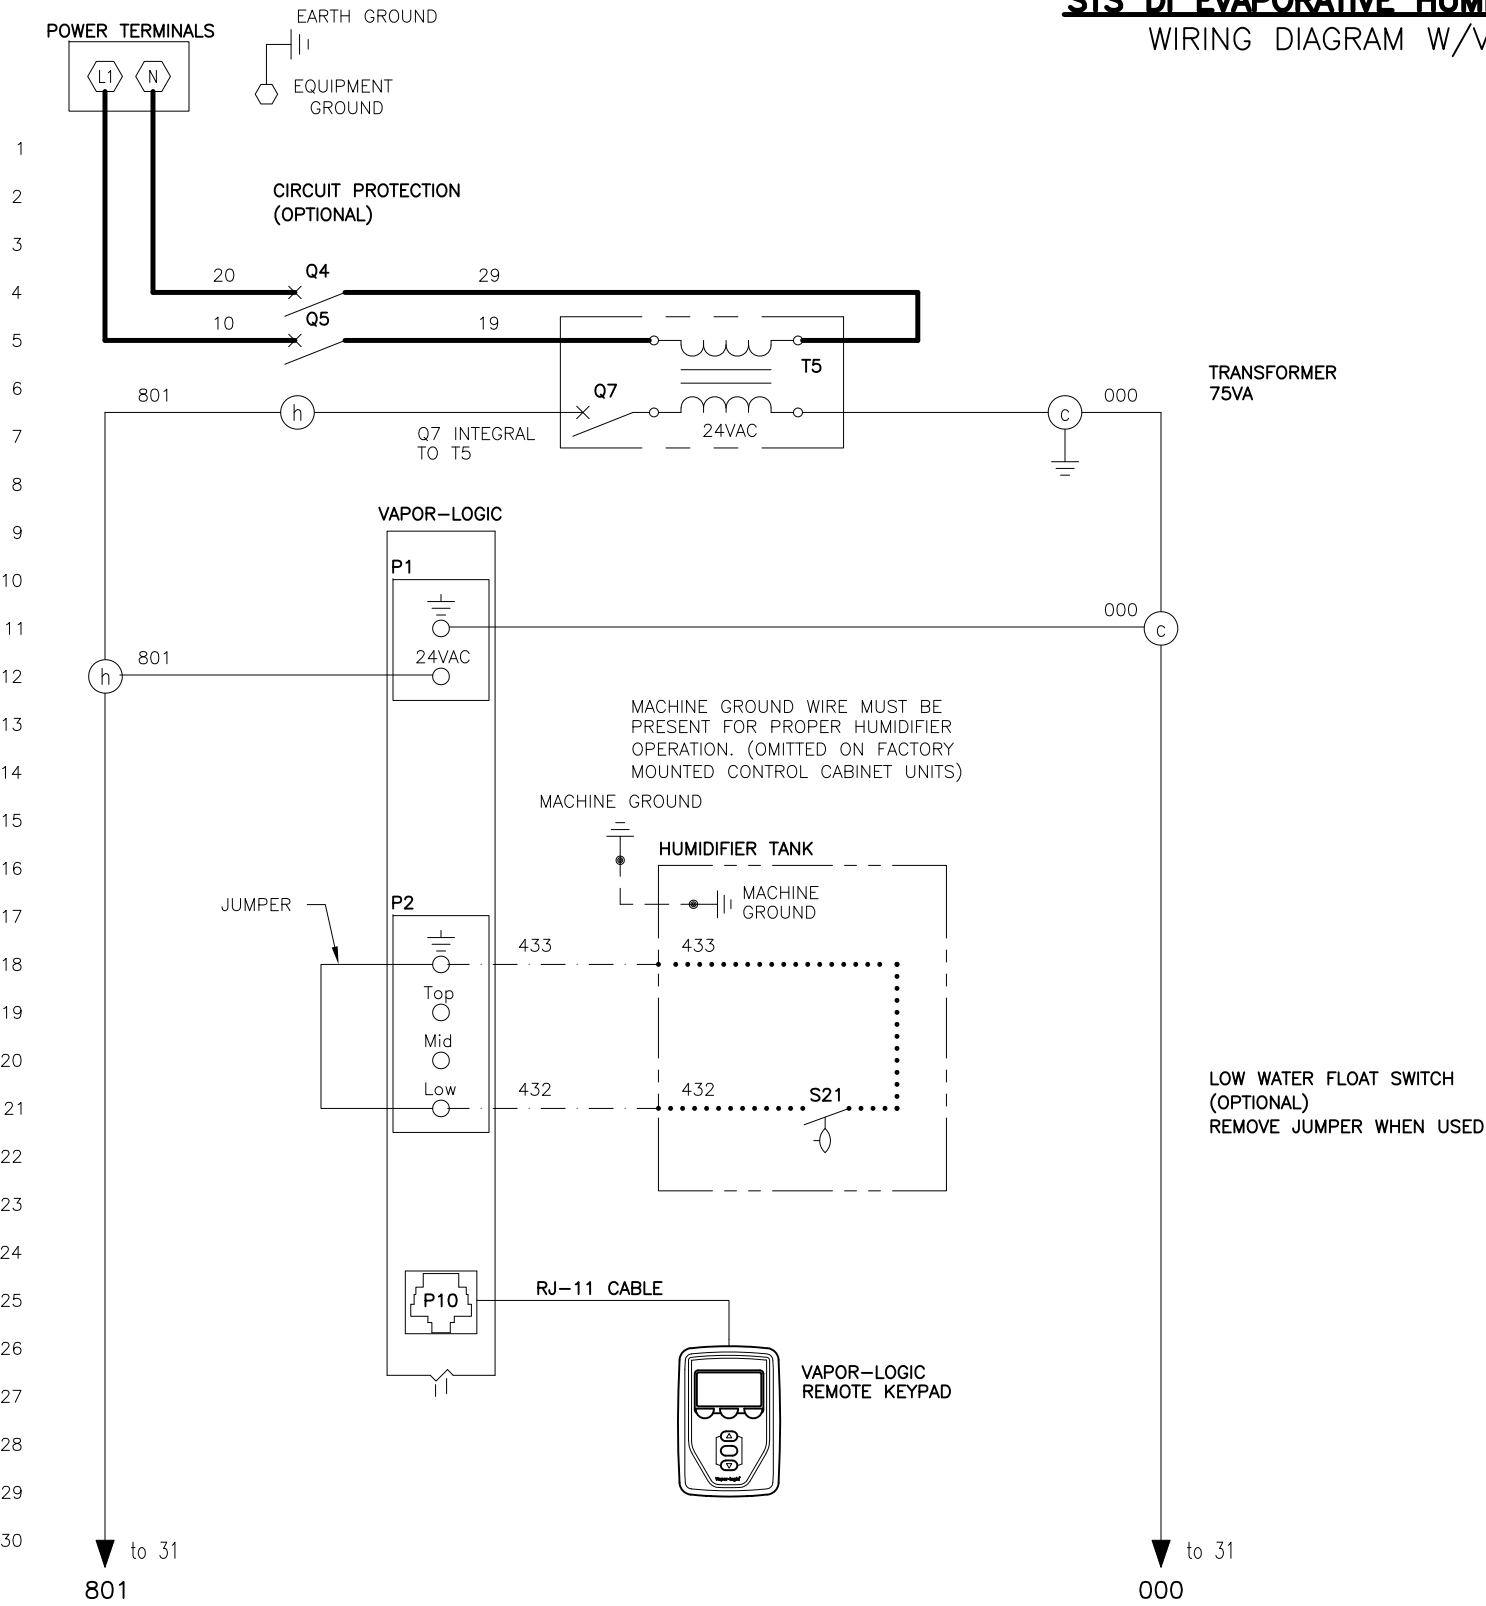

POWER WIRING
CONTROL CIRCUIT WIRING

FIELD WIRING
OPTIONAL FACTORY
OPTIONAL FIELD

- NOTES:**
1. WIRING AND BRANCH CIRCUIT PROTECTION PROVIDED BY INSTALLER AS PER NATIONAL ELECTRICAL CODE.
 2. FOR SUPPLY AND MACHINE GROUND CONNECTIONS, SIZE WIRE USING 75°C WIRE TABLE PER NATIONAL ELECTRICAL CODE.
 3. USE COPPER CONNECTORS RATED FOR 105°C.

- LEGEND**
- △ IF THE SWITCH IS NOT USED, THEN WIRE DIRECTLY TO TERMINAL SWITCH.
 - 5. REFER TO STS ELECTRICAL DATA SHEET.
 - △ REMOVE SHUNT J404 FROM BOARD IF USING OPTIONAL ACCESSORY.

BREAK TO EXTERNAL CONNECTIONS DIAGRAM

- LEGEND**
- K RELAY/CONTACTOR
 - T TRANSFORMER
 - Q CIRCUIT BREAKER
 - S SWITCH
 - H HEATER
 - Y SOLENOID
 - N SENSOR
 - J JUMPER
 - E WATER PROBE
 - M MOTOR/FAN

EUROPEAN STS, DI
WATER, ELECTRIC ACTUATOR
WIRING DIAGRAM

MAT'L:

SCALE: P/N

DRAWN BY: JK

DATE: 12/19/24

STS-CE-VL-22