


DATE	REV	RECORD	DR
5/15	A	E.C.# 6396	JK

STS[®] WITH VL OUTDOOR ENCLOSURE WIRING DIAGRAM

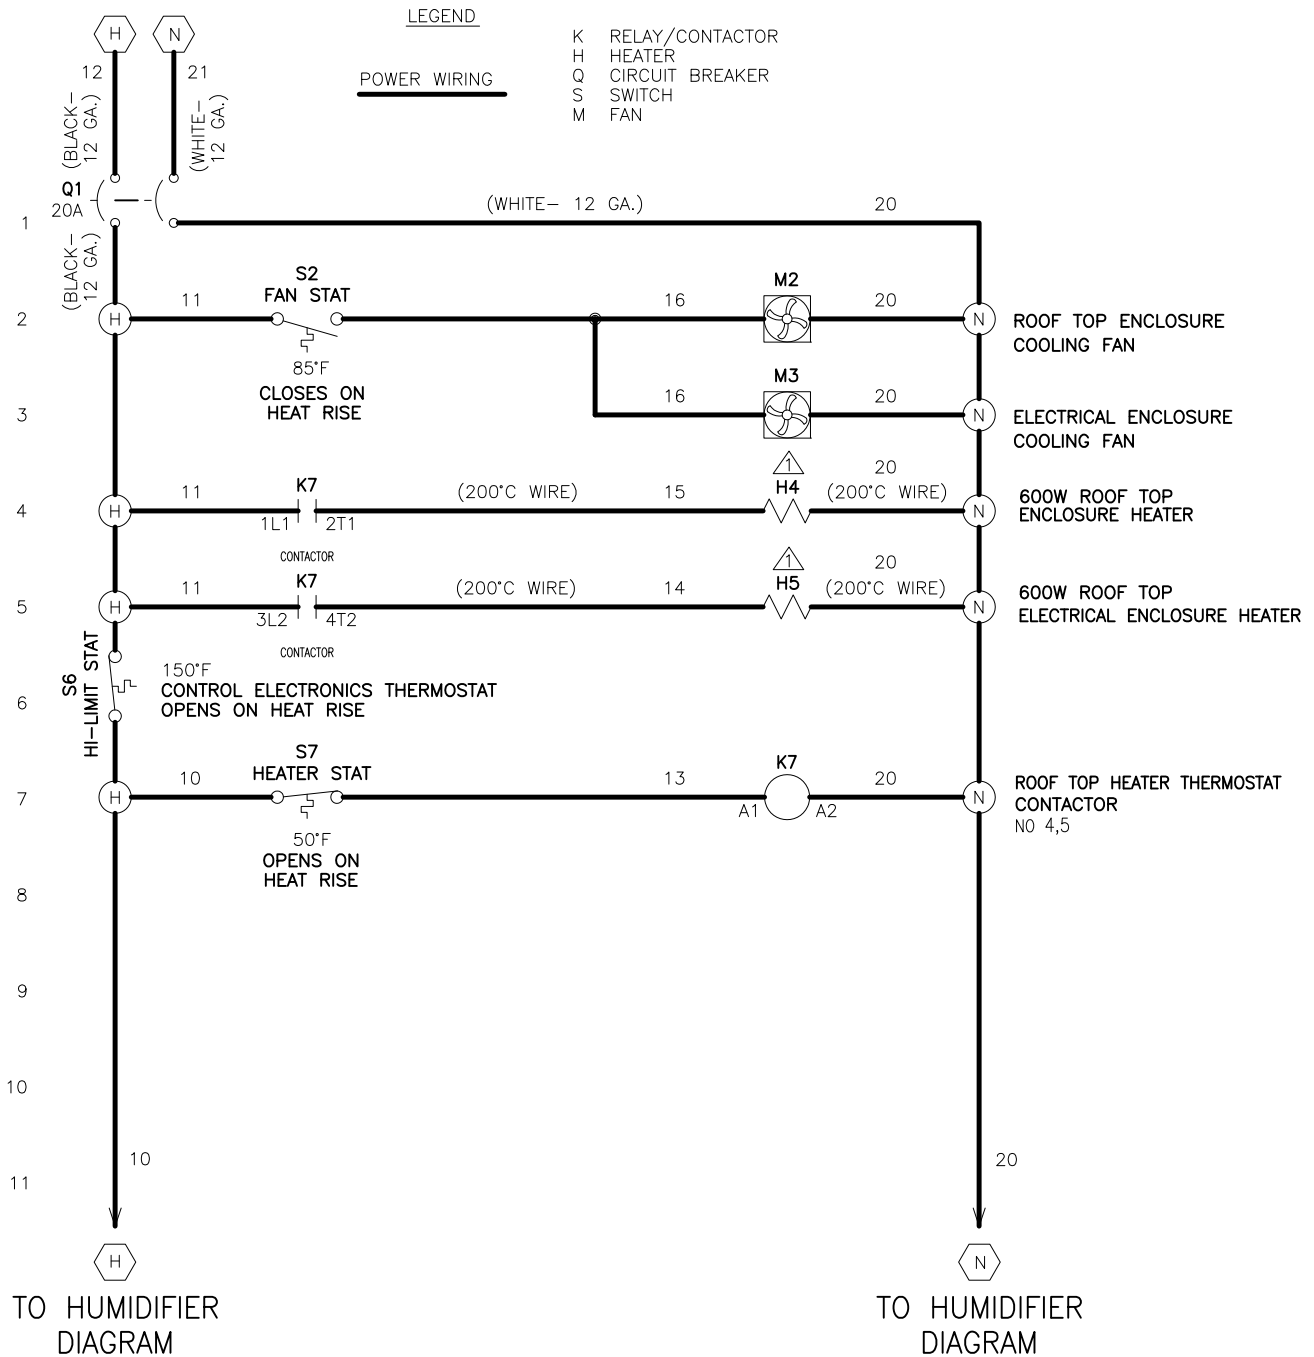

NOTES:

1. USE UNINSULATED RING TERMINALS FOR TERMINATIONS AT HEATER LUGS.
2. ALL WIRING IS 14 GAUGE UNLESS NOTED OTHERWISE.

		STS WITH VL OUTDOOR ENCLOSURE WIRING DIAGRAM	
		MAT'L:	
		SCALE:	P/N
		DRAWN BY: JK	STS-VL-7
		DATE: 5/21/15	