


DATE	REV	RECORD	DR
4/21	D	E.C.# 6964	JK
9/22	E	E.C.# 7110	JK
2/24	F	E.C.# 7229	JK

VAPOR-LOGIC EXTERNAL CONTROL CONNECTIONS DIAGRAM

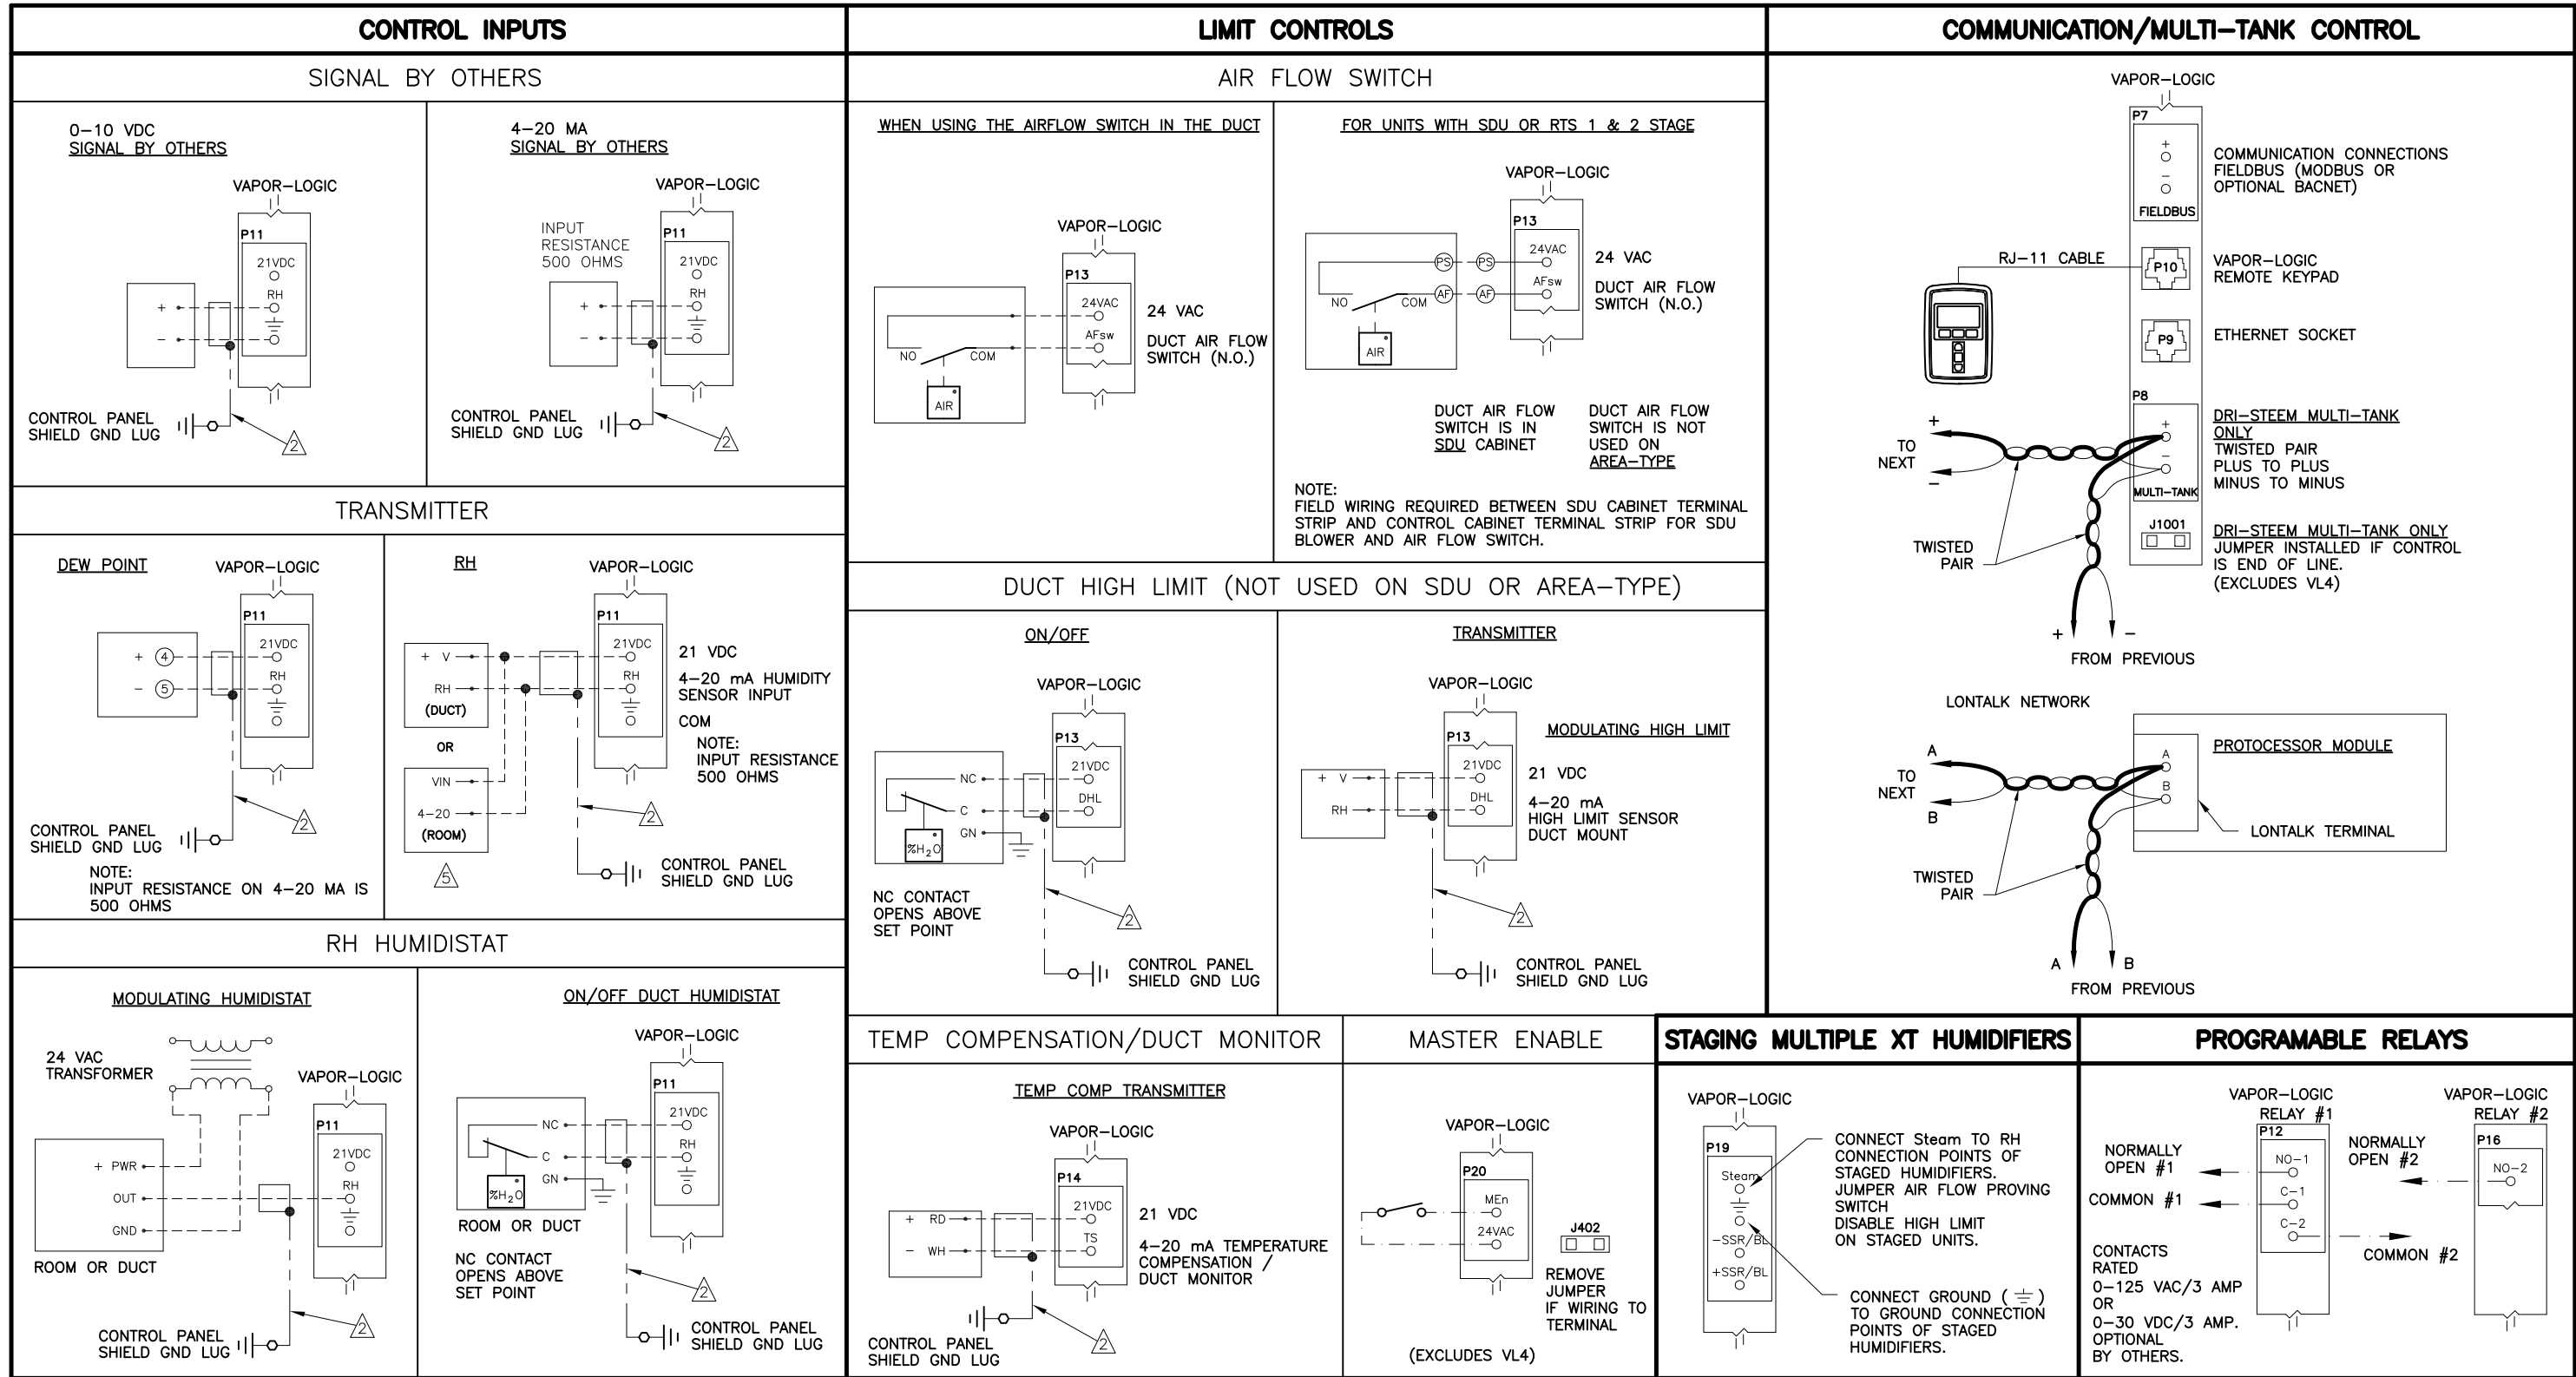

NOTES:

1. CHANGING CONTROL INPUT SIGNAL MAY REQUIRE WIRING CHANGE AND PROGRAM CHANGE. REFER TO VAPOR-LOGIC INSTALLATION AND OPERATION MANUAL (IOM), KEYPAD INPUT SELECTION SUB-MENU.

2. FOR ALL CONTROL DEVICES, EXCEPT WATER LEVEL CONTROLS/PROBE USE: 18 AWG/1.5 mm² PLENUM RATED 2-WIRE SHIELDED CABLE.

3. THIS PRODUCT WAS FACTORY TESTED FOR PROPER OPERATION. FAULTY HANDLING OR WIRING IS NOT COVERED UNDER DriSteen's WARRANTY.

4. REMOVE POWER BEFORE WIRING CONNECTIONS.

5. REFER TO TRANSMITTER INSTALL INSTRUCTIONS.

CONTROL CIRCUIT WIRING

FIELD WIRING

OPTIONAL FACTORY

OPTIONAL FIELD

VAPOR-LOGIC CONNECTIONS WIRING DIAGRAM	
MAT'L:	
SCALE: _____	P/N VL-1
DRAWN BY: JK	
DATE: 5/19/15	

