


**VAPOR-LOGIC® 3 EXTERNAL CONNECTIONS DIAGRAM**

EVAPORATIVE HUMIDIFIER W/ SDU FAN  
CONTROL ARRANGEMENT: SOE  
4-20 mA CONTROLLER BY OTHERS

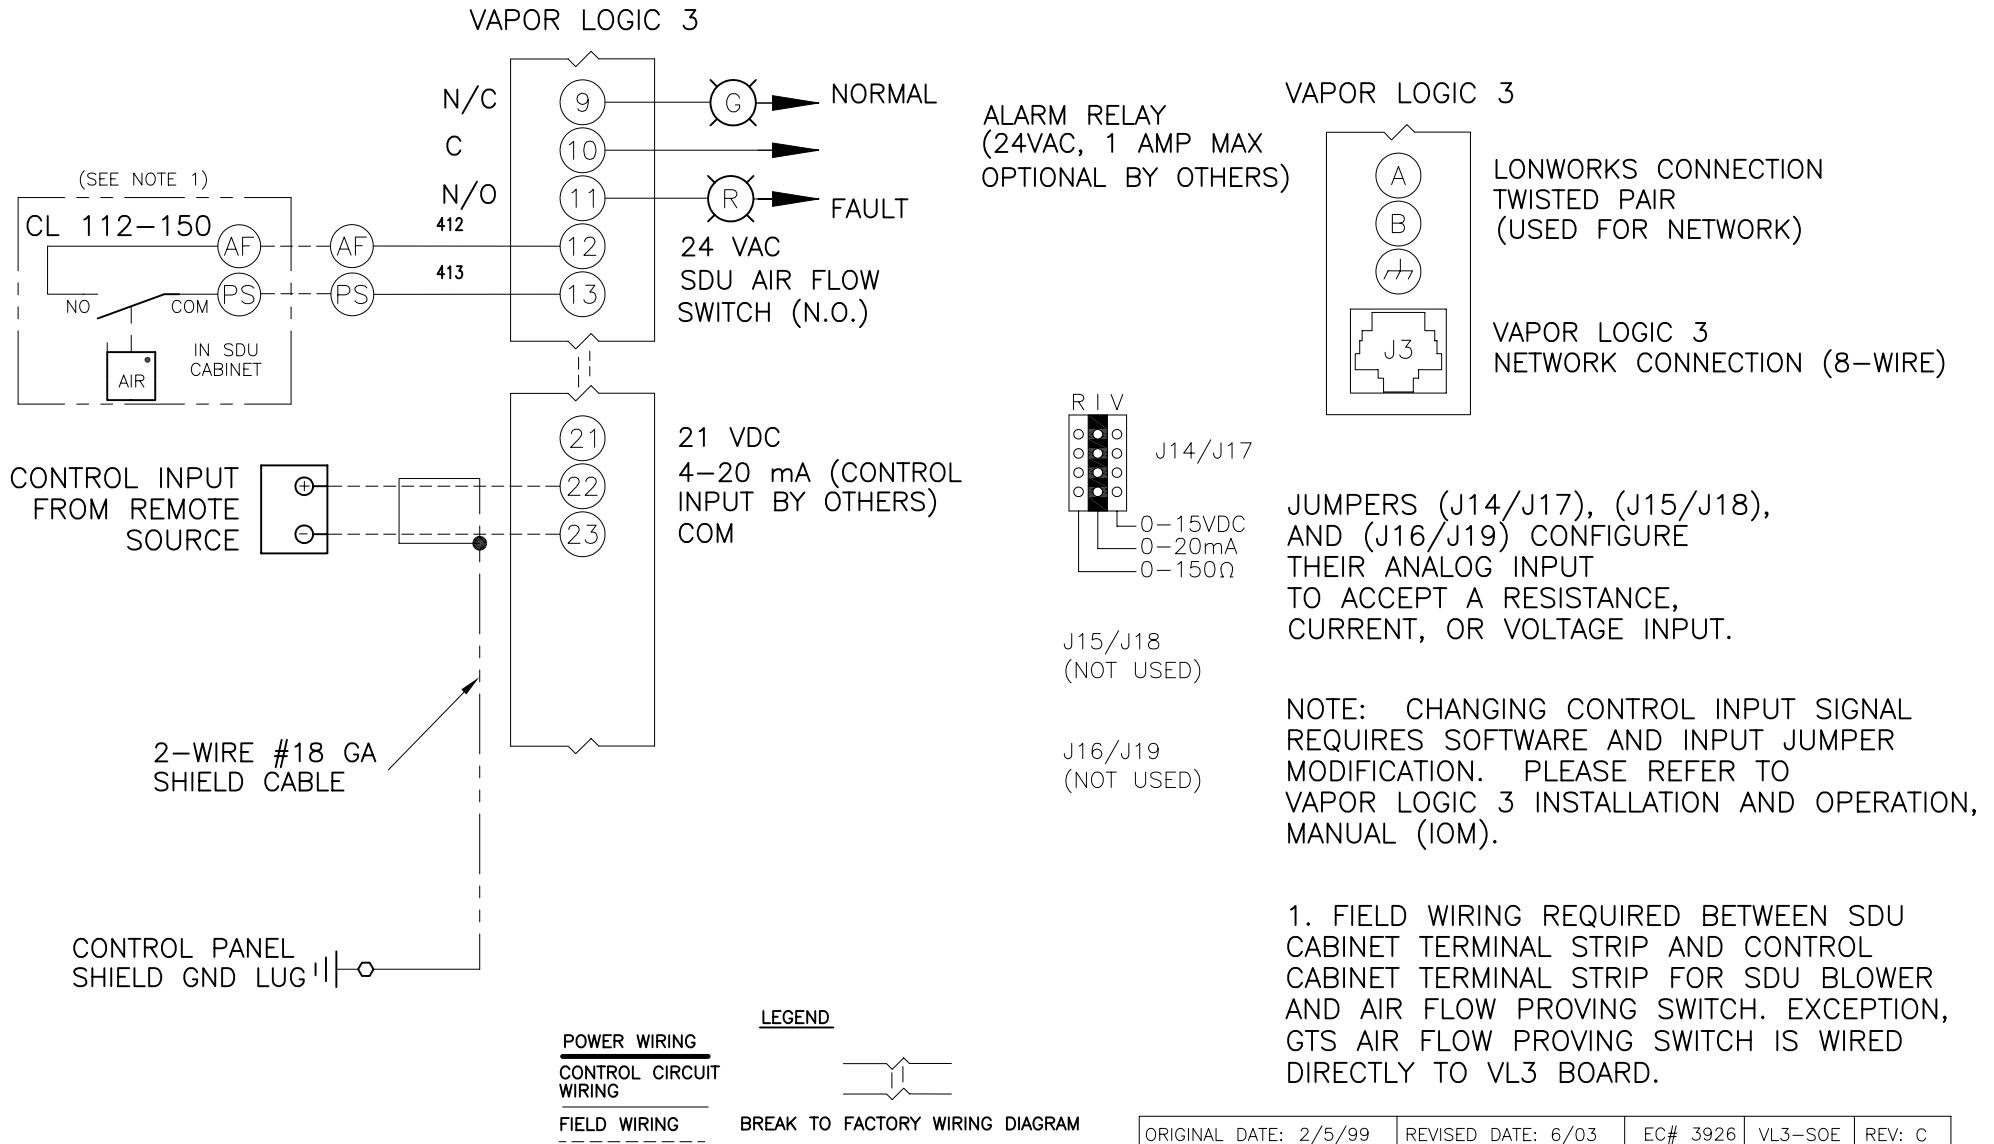

1. FIELD WIRING REQUIRED BETWEEN SDU CABINET TERMINAL STRIP AND CONTROL CABINET TERMINAL STRIP FOR SDU BLOWER AND AIR FLOW PROVING SWITCH. EXCEPTION, GTS AIR FLOW PROVING SWITCH IS WIRED DIRECTLY TO VL3 BOARD.

ORIGINAL DATE: 2/5/99	REVISED DATE: 6/03	EC# 3926	VL3-SOE	REV: C
-----------------------	--------------------	----------	---------	--------