VAPORSTREAM® VLDI EVAPORATIVE HUMIDIFIER
SSR SEQUENCING MODULATION (NO SDU/AREA)

REFER TO FOLLOWING DOCUMENTS
–INSTALLATION REQUIREMENTS
–EXTERNAL CONNECTIONS
–HEATER ELEMENT WIRING ARRANGEMENTS

DATE	REV	RECORD	DR
9/03	C	E.C. # 3988	JK
5/05	D	E.C. # 4263	JK

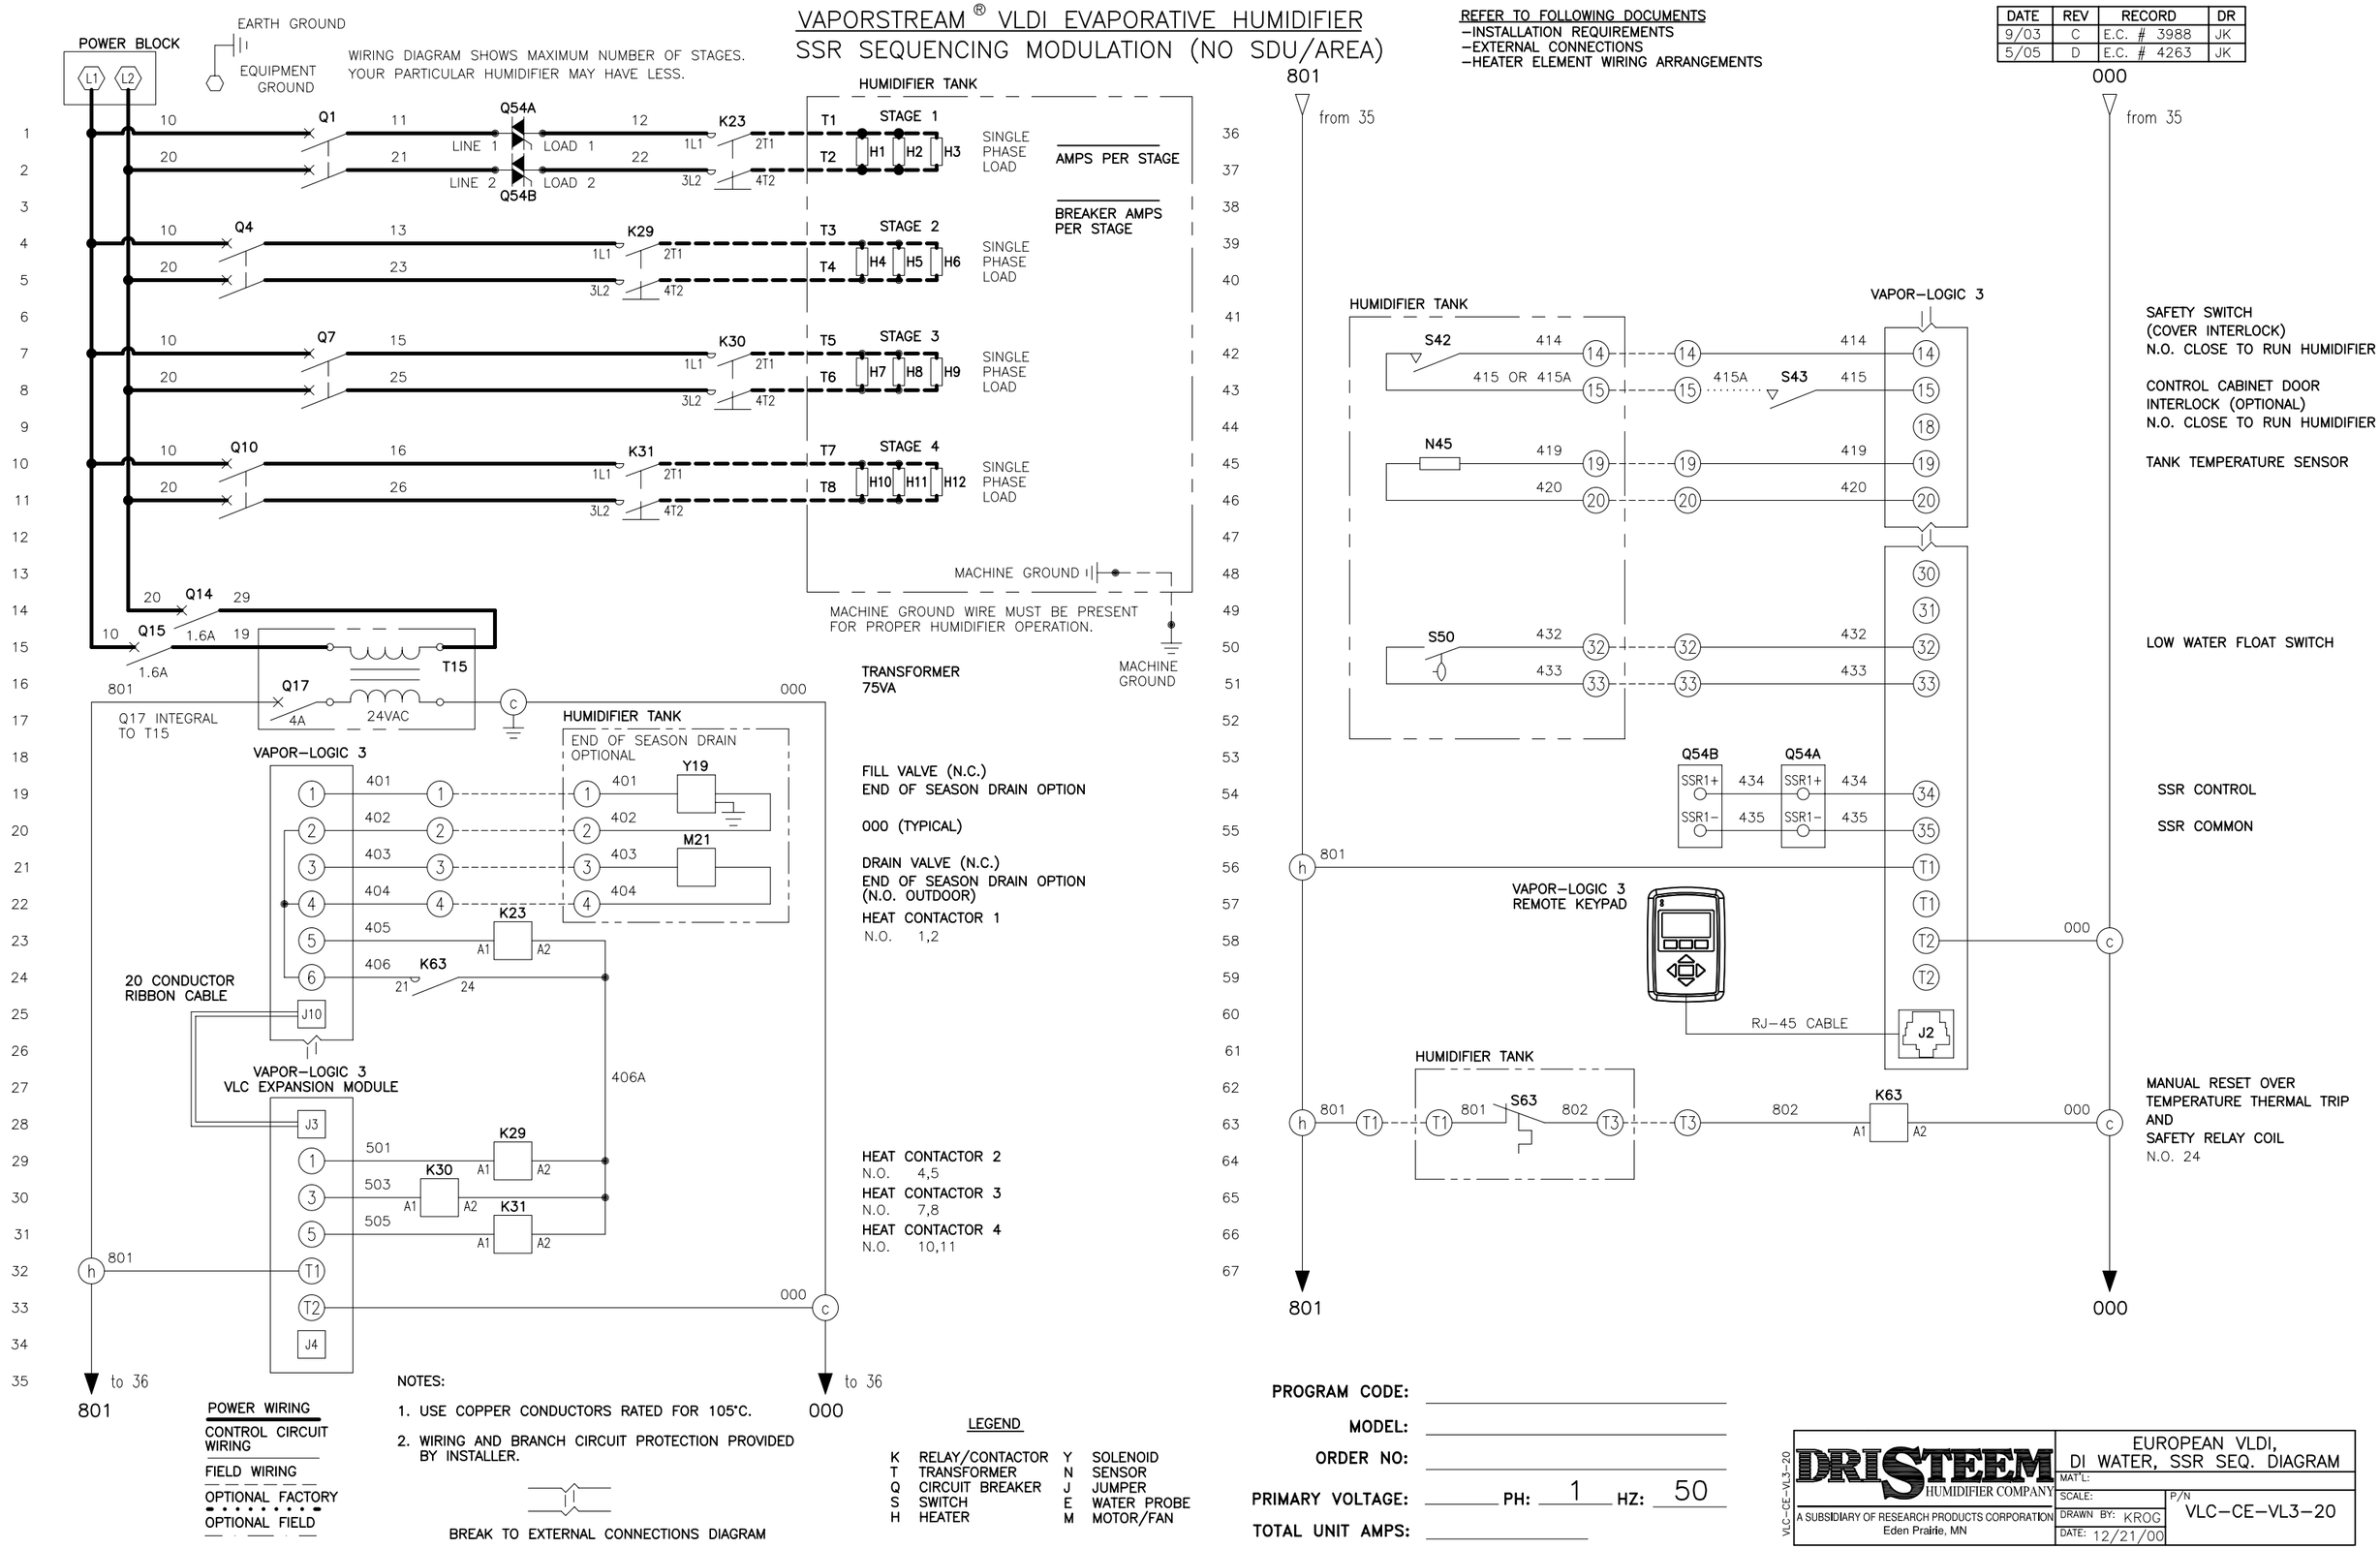

NOTES:
1. USE COPPER CONDUCTORS RATED FOR 105°C.
2. WIRING AND BRANCH CIRCUIT PROTECTION PROVIDED BY INSTALLER.

POWER WIRING
CONTROL CIRCUIT WIRING
FIELD WIRING
OPTIONAL FACTORY
OPTIONAL FIELD

BREAK TO EXTERNAL CONNECTIONS DIAGRAM

LEGEND

K	RELAY/CONTACTOR	Y	SOLENOID
T	TRANSFORMER	N	SENSOR
Q	CIRCUIT BREAKER	J	JUMPER
S	SWITCH	E	WATER PROBE
H	HEATER	M	MOTOR/FAN

PROGRAM CODE: _____
MODEL: _____
ORDER NO: _____
PRIMARY VOLTAGE: _____ PH: 1 HZ: 50
TOTAL UNIT AMPS: _____

DRISTEEM HUMIDIFIER COMPANY
A SUBSIDIARY OF RESEARCH PRODUCTS CORPORATION
Eden Prairie, MN

EUROPEAN VLDI, DI WATER, SSR SEQ. DIAGRAM
MAT'L:
SCALE:
DRAWN BY: KROG
DATE: 12/21/00
P/N VLC–CE–VL3–20
VLC–CE–VL3–20