
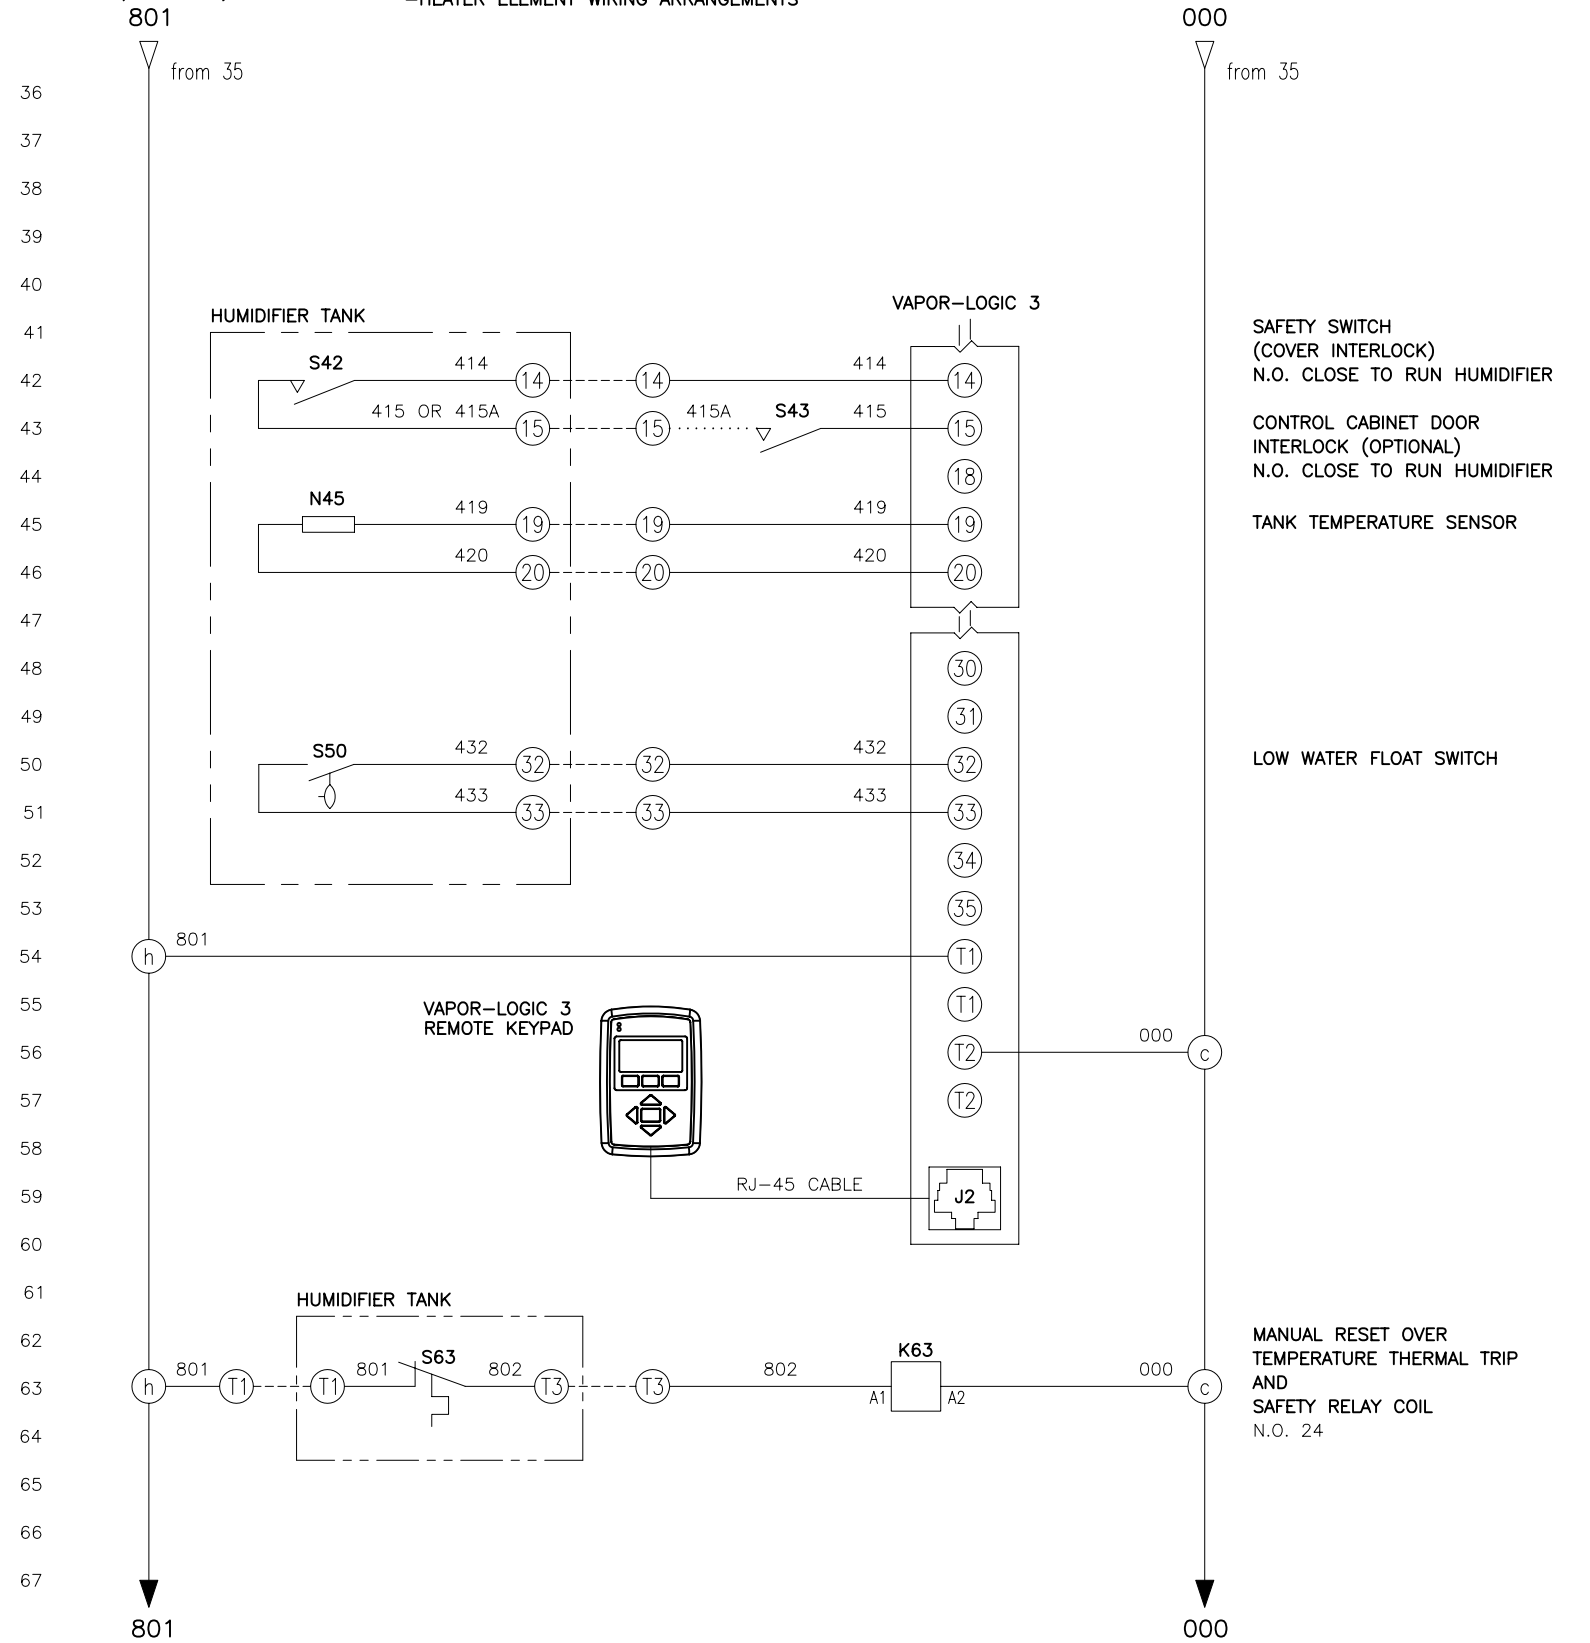


VAPORSTREAM® VLDI EVAPORATIVE HUMIDIFIER
ON-OFF/TP MODULATION (NO SDU/AREA)

REFER TO FOLLOWING DOCUMENTS
 -INSTALLATION REQUIREMENTS
 -EXTERNAL CONNECTIONS
 -HEATER ELEMENT WIRING ARRANGEMENTS

DATE	REV	RECORD	DR
9/03	C	E.C. # 3988	JK
5/05	D	E.C. # 4263	JK

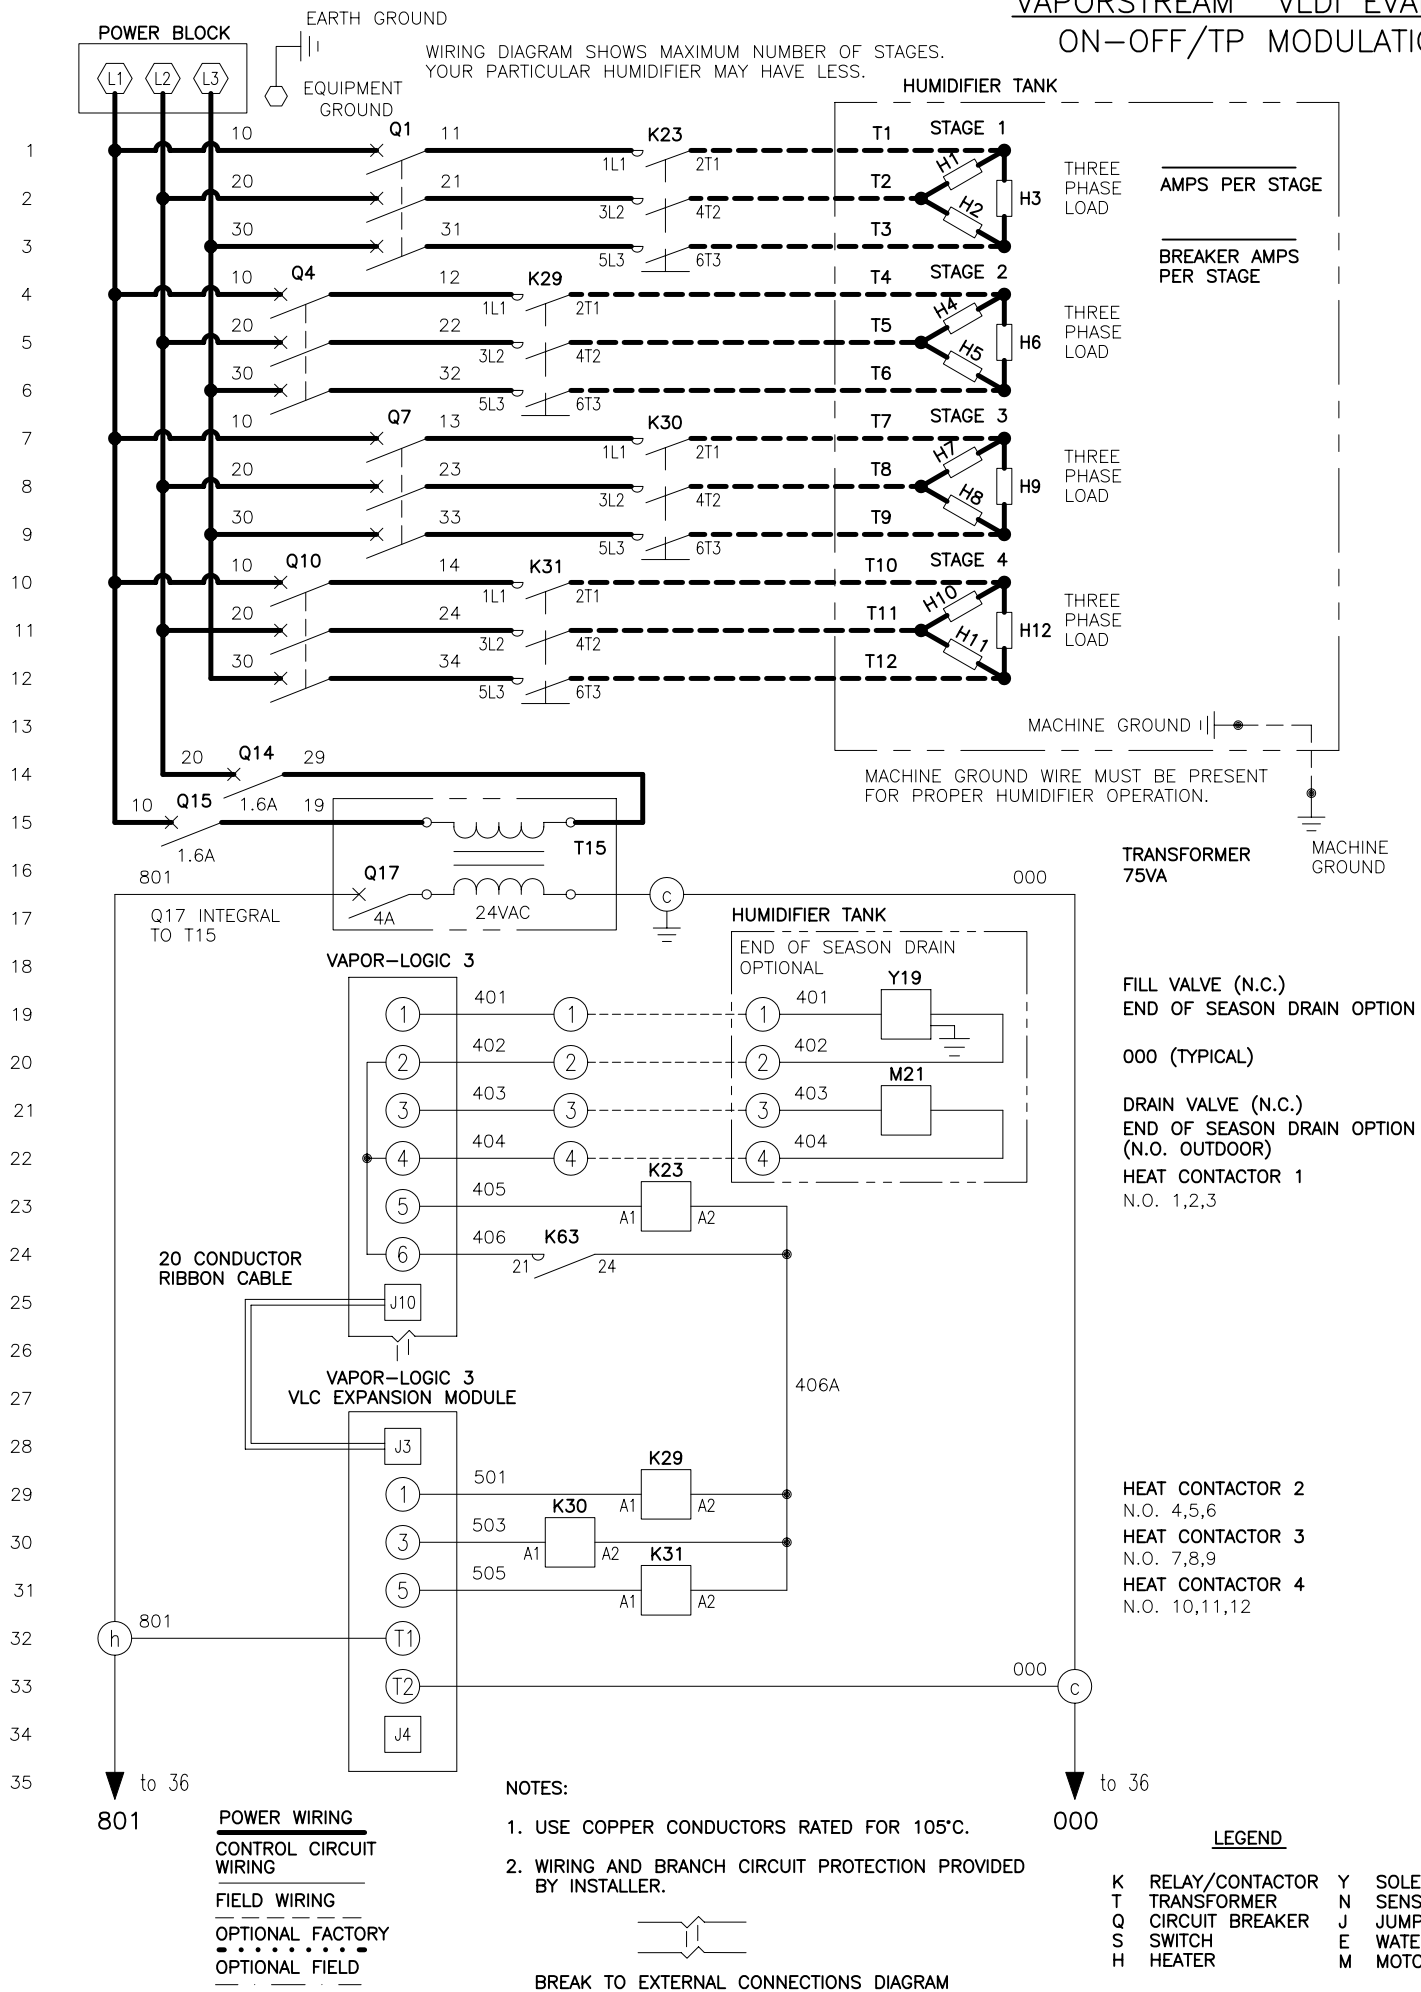

PROGRAM CODE:

MODEL: _____

ORDER NO:

PRIMARY VOLTAGE: _____ PH: 3 HZ: 50

TOTAL UNIT AMPS: _____

