
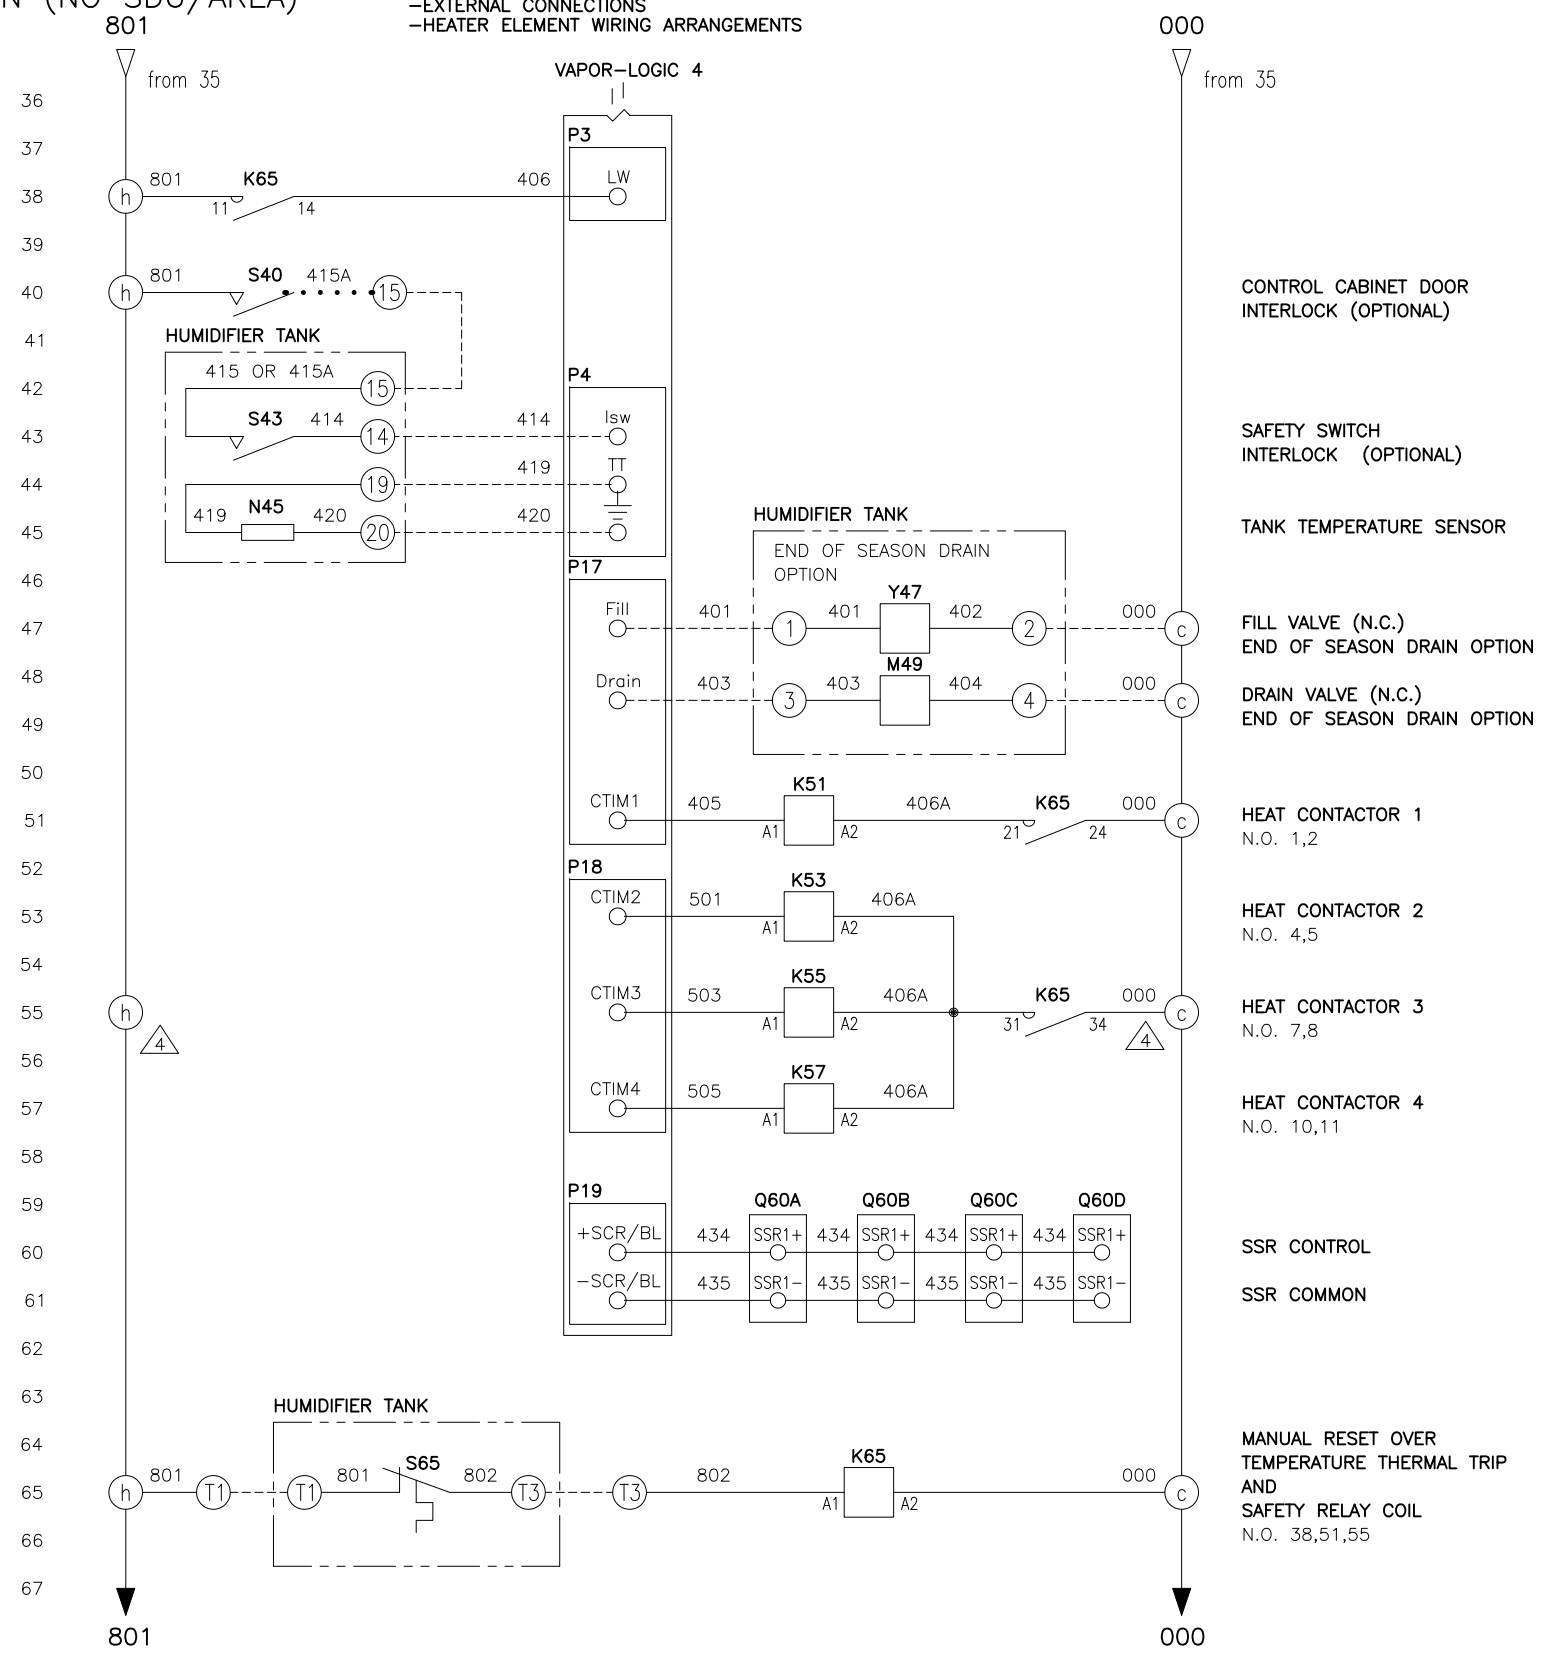


DATE	REV	RECORD	DR
12/09	A	E.C.# 4973	JK

VAPORSTREAM® VLDI EVAPORATIVE HUMIDIFIER

100% (DUAL) SSR MODULATION (NO SDU/AREA)

REFER TO FOLLOWING DOCUMENTS
 -INSTALLATION REQUIREMENTS
 -EXTERNAL CONNECTIONS
 -HEATER ELEMENT WIRING ARRANGEMENTS

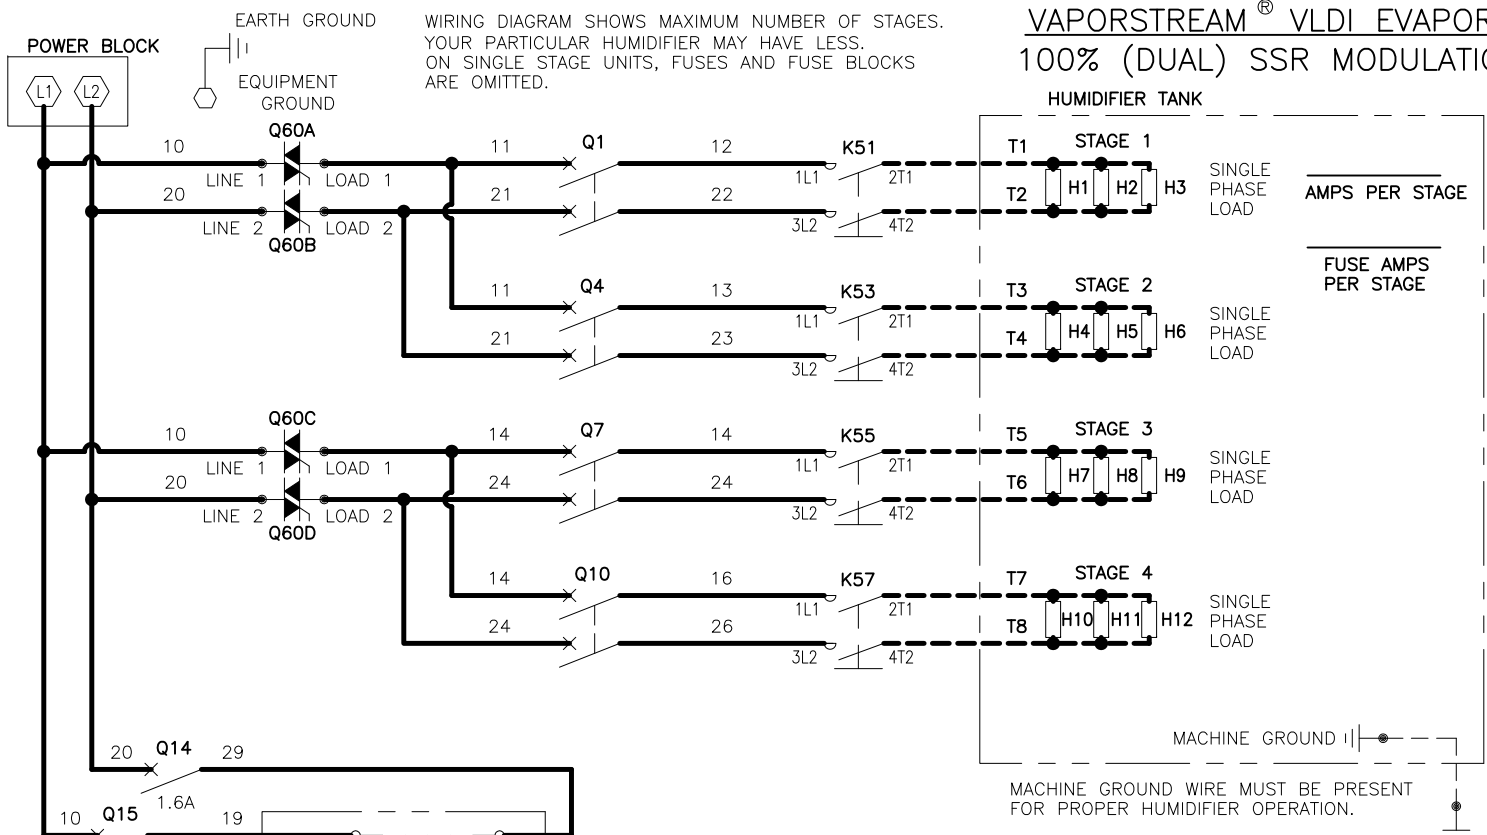

- NOTES:
1. WIRING AND BRANCH CIRCUIT PROTECTION PROVIDED BY INSTALLER AS PER NATIONAL ELECTRICAL CODE.
 2. FOR SUPPLY HEATER AND MACHINE GROUND CONNECTIONS, SIZE WIRE USING 75°C WIRE TABLE PER NATIONAL ELECTRICAL CODE.
 3. USE COPPER CONNECTORS RATED FOR 105°C.
4. REFER TO AUXILIARY TRANSFORMER WIRING DIAGRAM FOR ALL MULTIPLE STAGE WITH HIGH VA DRAW, WHEN TWO TRANSFORMERS ARE PRESENT.

- LEGEND
- | | | | |
|---|-----------------|---|-------------|
| K | RELAY/CONTACTOR | Y | SOLENOID |
| T | TRANSFORMER | N | SENSOR |
| Q | CIRCUIT BREAKER | J | JUMPER |
| S | SWITCH | E | WATER PROBE |
| H | HEATER | M | MOTOR/FAN |
| F | FUSE | | |

MODEL: _____
 ORDER NO: _____
 PRIMARY VOLTAGE: _____ PH: 1 HZ: 50
 TOTAL UNIT AMPS: _____

DRISTEEM	EUROPEAN VLDI, DI WATER, (2) SSR'S DIAGRAM	
	MAT#:	P/N
	SCALE:	VLC-CE-VL4-24
	DATE: 12/9/09	

POWER WIRING
 CONTROL CIRCUIT WIRING
 FIELD WIRING
 OPTIONAL FACTORY
 OPTIONAL FIELD

BREAK TO EXTERNAL CONNECTIONS DIAGRAM