
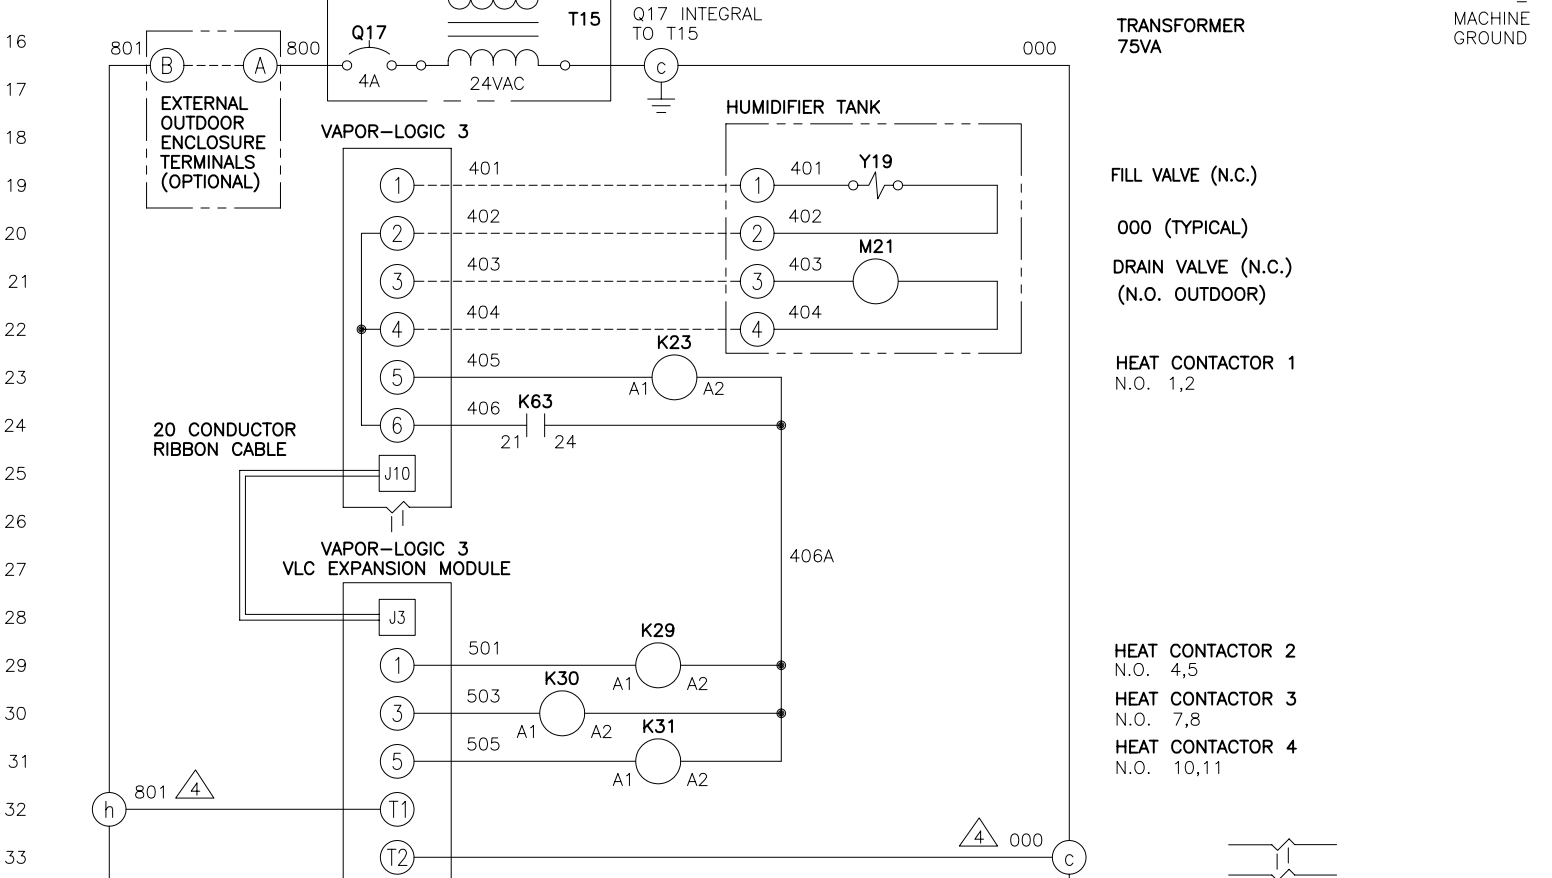


VAPORSTREAM® VLC EVAPORATIVE HUMIDIFIER
100% (DUAL) SSR MODULATION (NO SDU/AREA)

REFER TO FOLLOWING DOCUMENTS
-INSTALLATION REQUIREMENTS
-EXTERNAL CONNECTIONS
-HEATER ELEMENT WIRING ARRANGEMENTS


DATE	REV	RECORD	DR
5/05	E	E.C. # 4263	JK
2/07	F	E.C. # 4504	JK

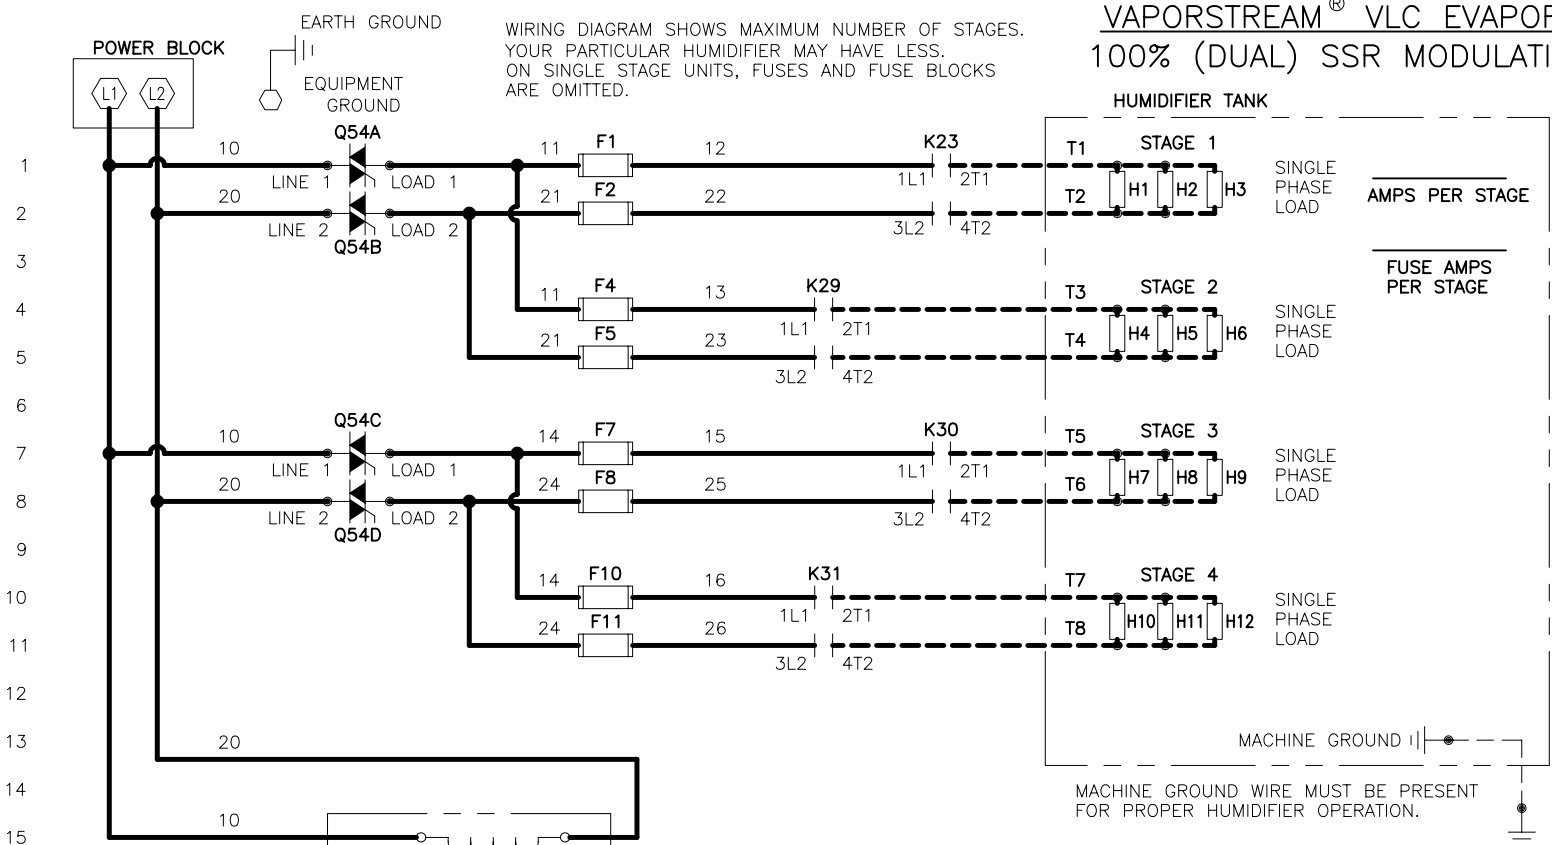

- NOTES:
1. WIRING AND BRANCH CIRCUIT PROTECTION PROVIDED BY INSTALLER AS PER NATIONAL ELECTRICAL CODE.
 2. FOR SUPPLY HEATER AND MACHINE GROUND CONNECTIONS, SIZE WIRE USING 75°C WIRE TABLE PER NATIONAL ELECTRICAL CODE.
 3. USE COPPER CONNECTORS RATED FOR 105°C.
- 4 REFER TO AUXILIARY TRANSFORMER WIRING DIAGRAM FOR ALL MULTIPLE STAGE WITH MERCURY CONTACTOR.

LEGEND

K	RELAY/CONTACTOR	Y	SOLENOID
T	TRANSFORMER	N	SENSOR
Q	CIRCUIT BREAKER	J	JUMPER
S	SWITCH	E	WATER PROBE
H	HEATER	M	MOTOR/FAN
F	FUSE		

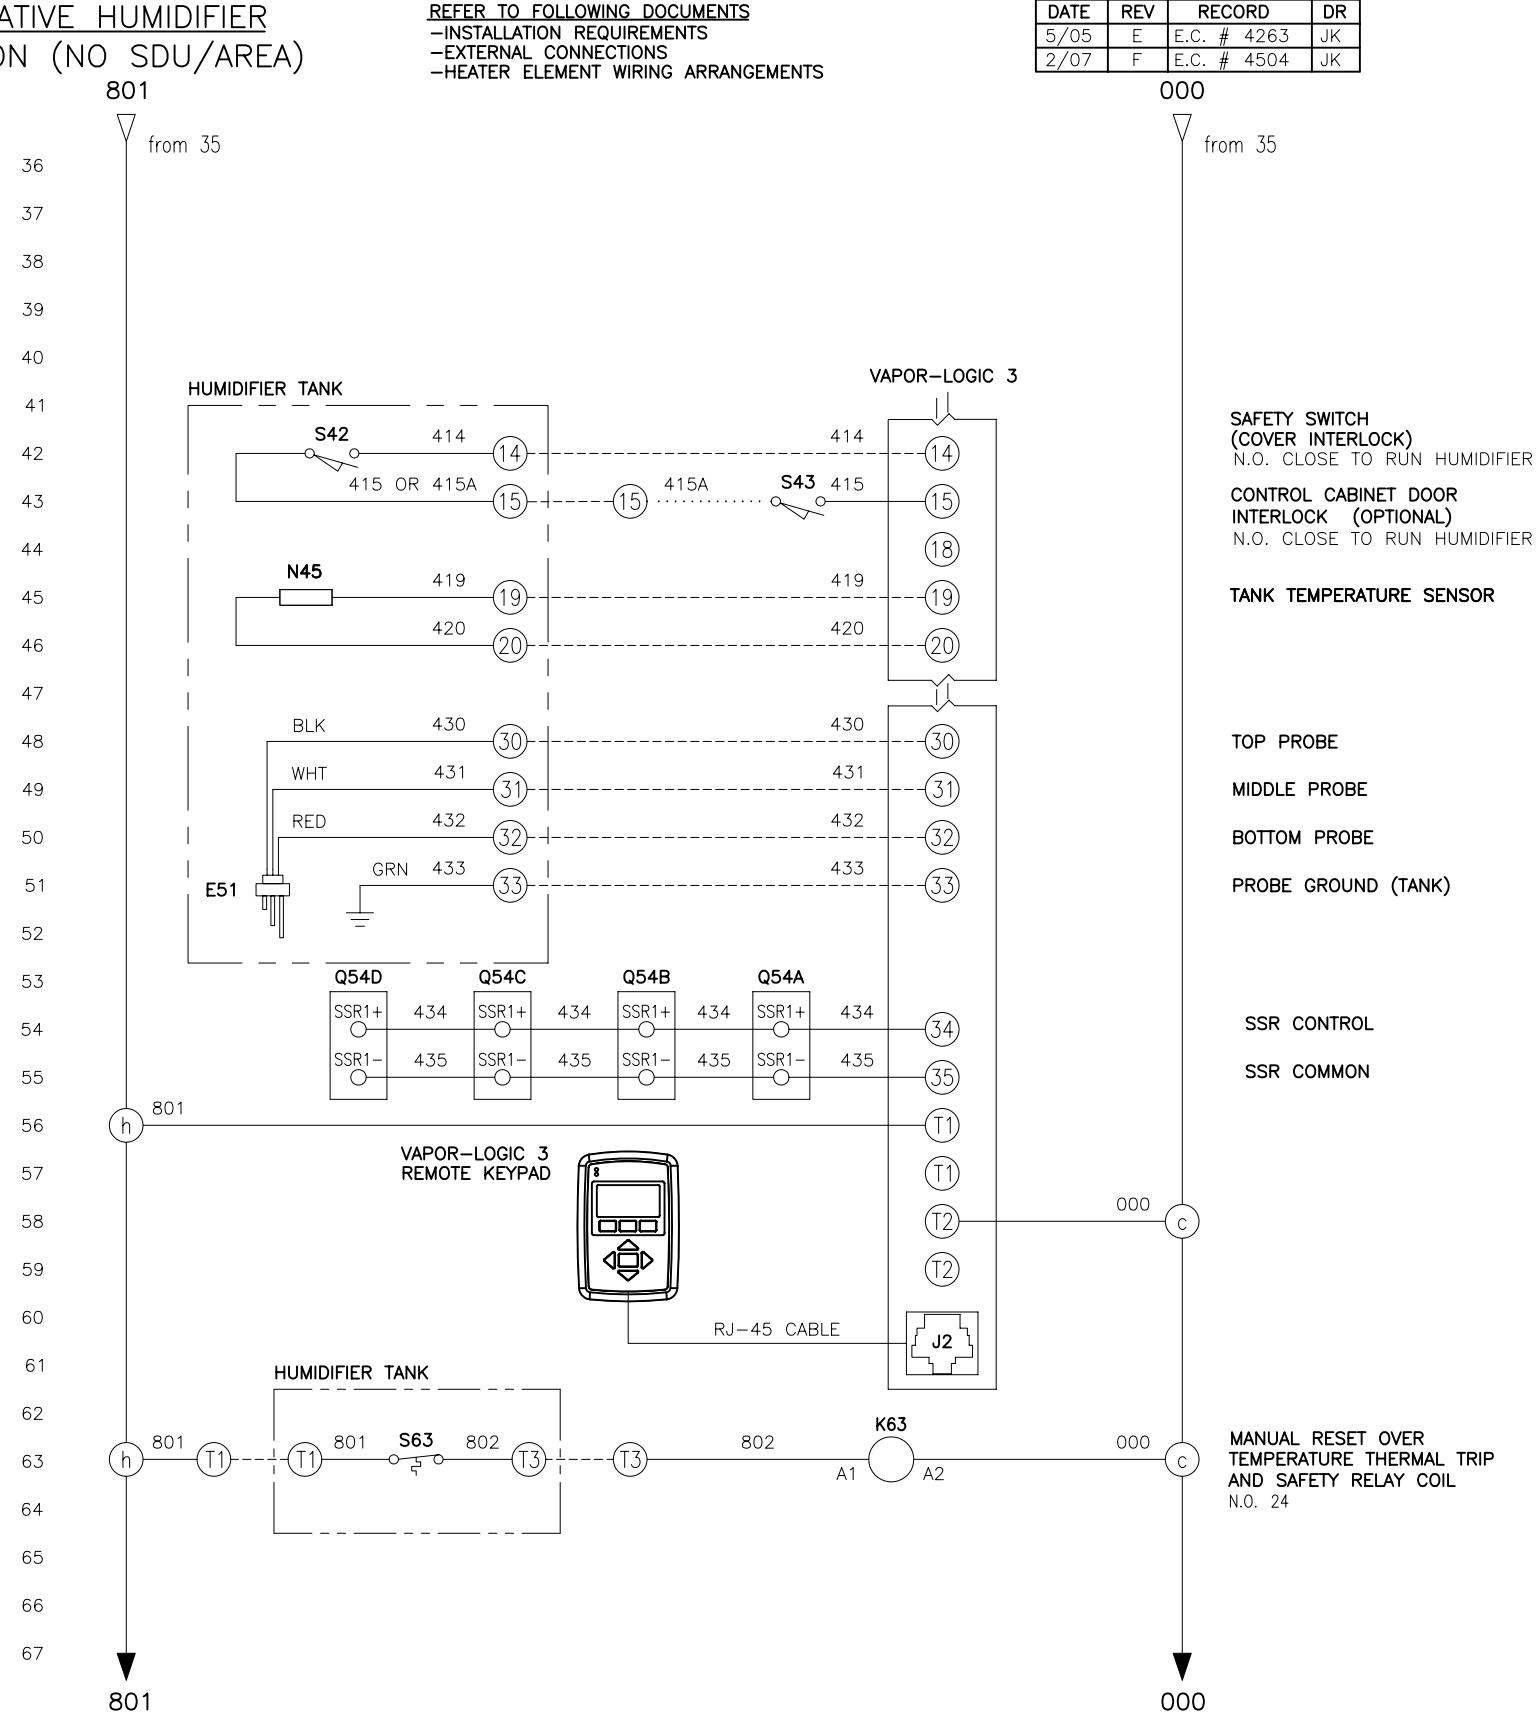

PROGRAM CODE: _____
 MODEL: _____
 ORDER NO: _____
 PRIMARY VOLTAGE: _____ PH: 1 HZ: 60
 TOTAL UNIT AMPS: _____

VLC-VL3-23

DRISTEEM

DOMESTIC VLC, STANDARD WATER, (2) SSR'S DIAGRAM

SCALE: _____ P/N: VLC-VL3-23

DRAWN BY: CH
 DATE: 4/18/01