



DATE	REV	RECORD	DR
11/09	A	E.C.# 4973	JK
6/12	B	E.C.# 5833	JK

VAPORSTREAM® VLDI EVAPORATIVE HUMIDIFIER

100% (SINGLE) SSR MODULATION (NO SDU/AREA)

REFER TO FOLLOWING DOCUMENTS
 -INSTALLATION REQUIREMENTS
 -EXTERNAL CONNECTIONS
 -HEATER ELEMENT WIRING ARRANGEMENTS


000

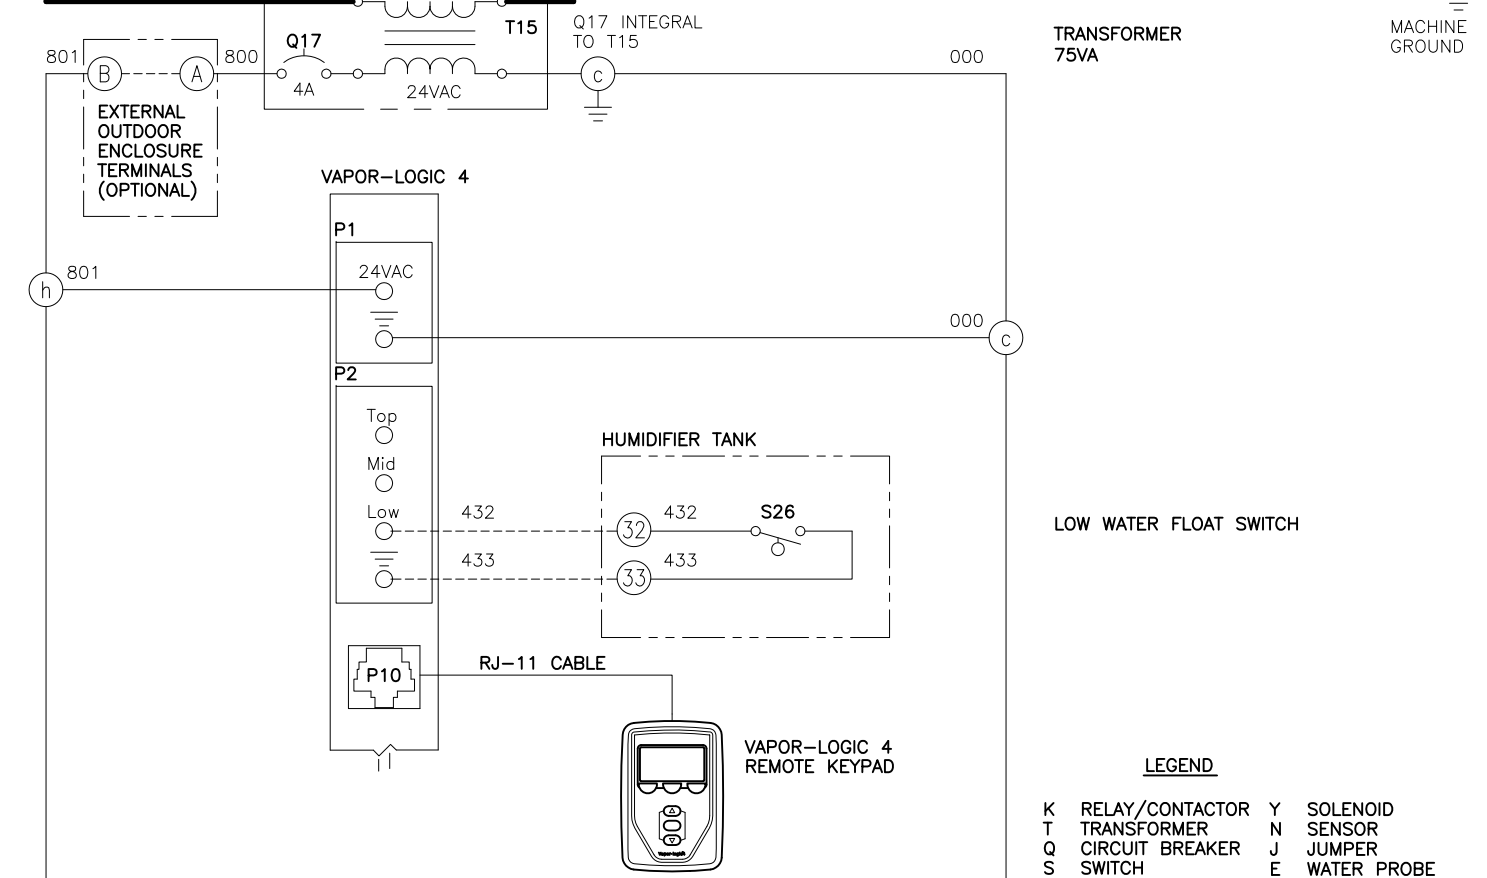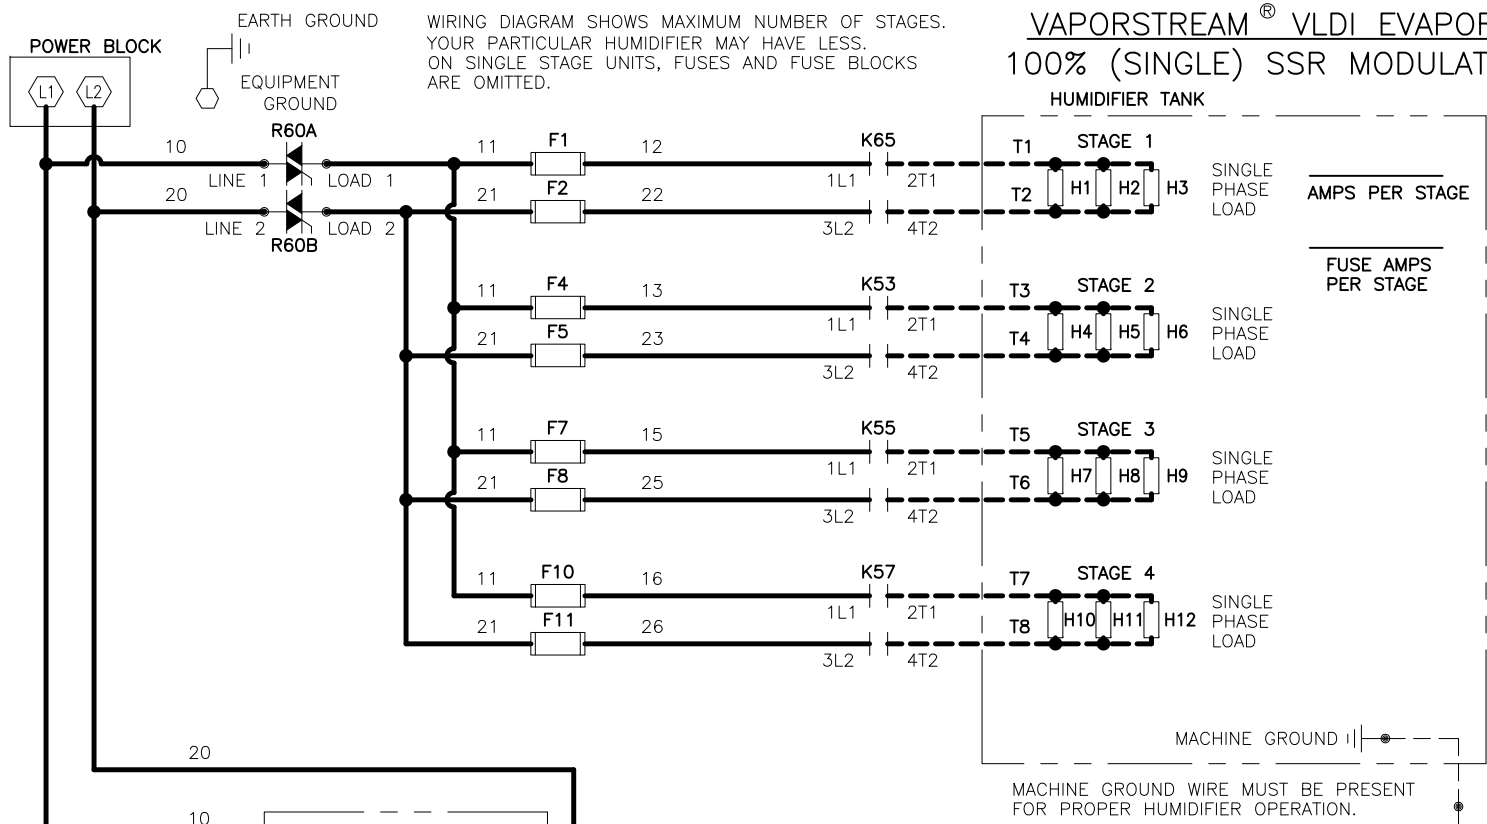

- LEGEND**
- K RELAY/CONTACTOR
 - T TRANSFORMER
 - Q CIRCUIT BREAKER
 - S SWITCH
 - H HEATER
 - F FUSE
 - Y SOLENOID
 - N SENSOR
 - J JUMPER
 - E WATER PROBE
 - M MOTOR/FAN
 - R SOLID STATE RELAY

- NOTES:**
1. WIRING AND BRANCH CIRCUIT PROTECTION PROVIDED BY INSTALLER AS PER NATIONAL ELECTRICAL CODE.
 2. FOR SUPPLY HEATER AND MACHINE GROUND CONNECTIONS, SIZE WIRE USING 75°C WIRE TABLE PER NATIONAL ELECTRICAL CODE.
 3. USE COPPER CONNECTORS RATED FOR 105°C.
4. REFER TO AUXILIARY TRANSFORMER WIRING DIAGRAM FOR ALL MULTIPLE STAGE WITH HIGH VA DRAW, WHEN TWO TRANSFORMERS ARE PRESENT.

POWER WIRING
 CONTROL CIRCUIT WIRING
 FIELD WIRING
 OPTIONAL FACTORY
 OPTIONAL FIELD

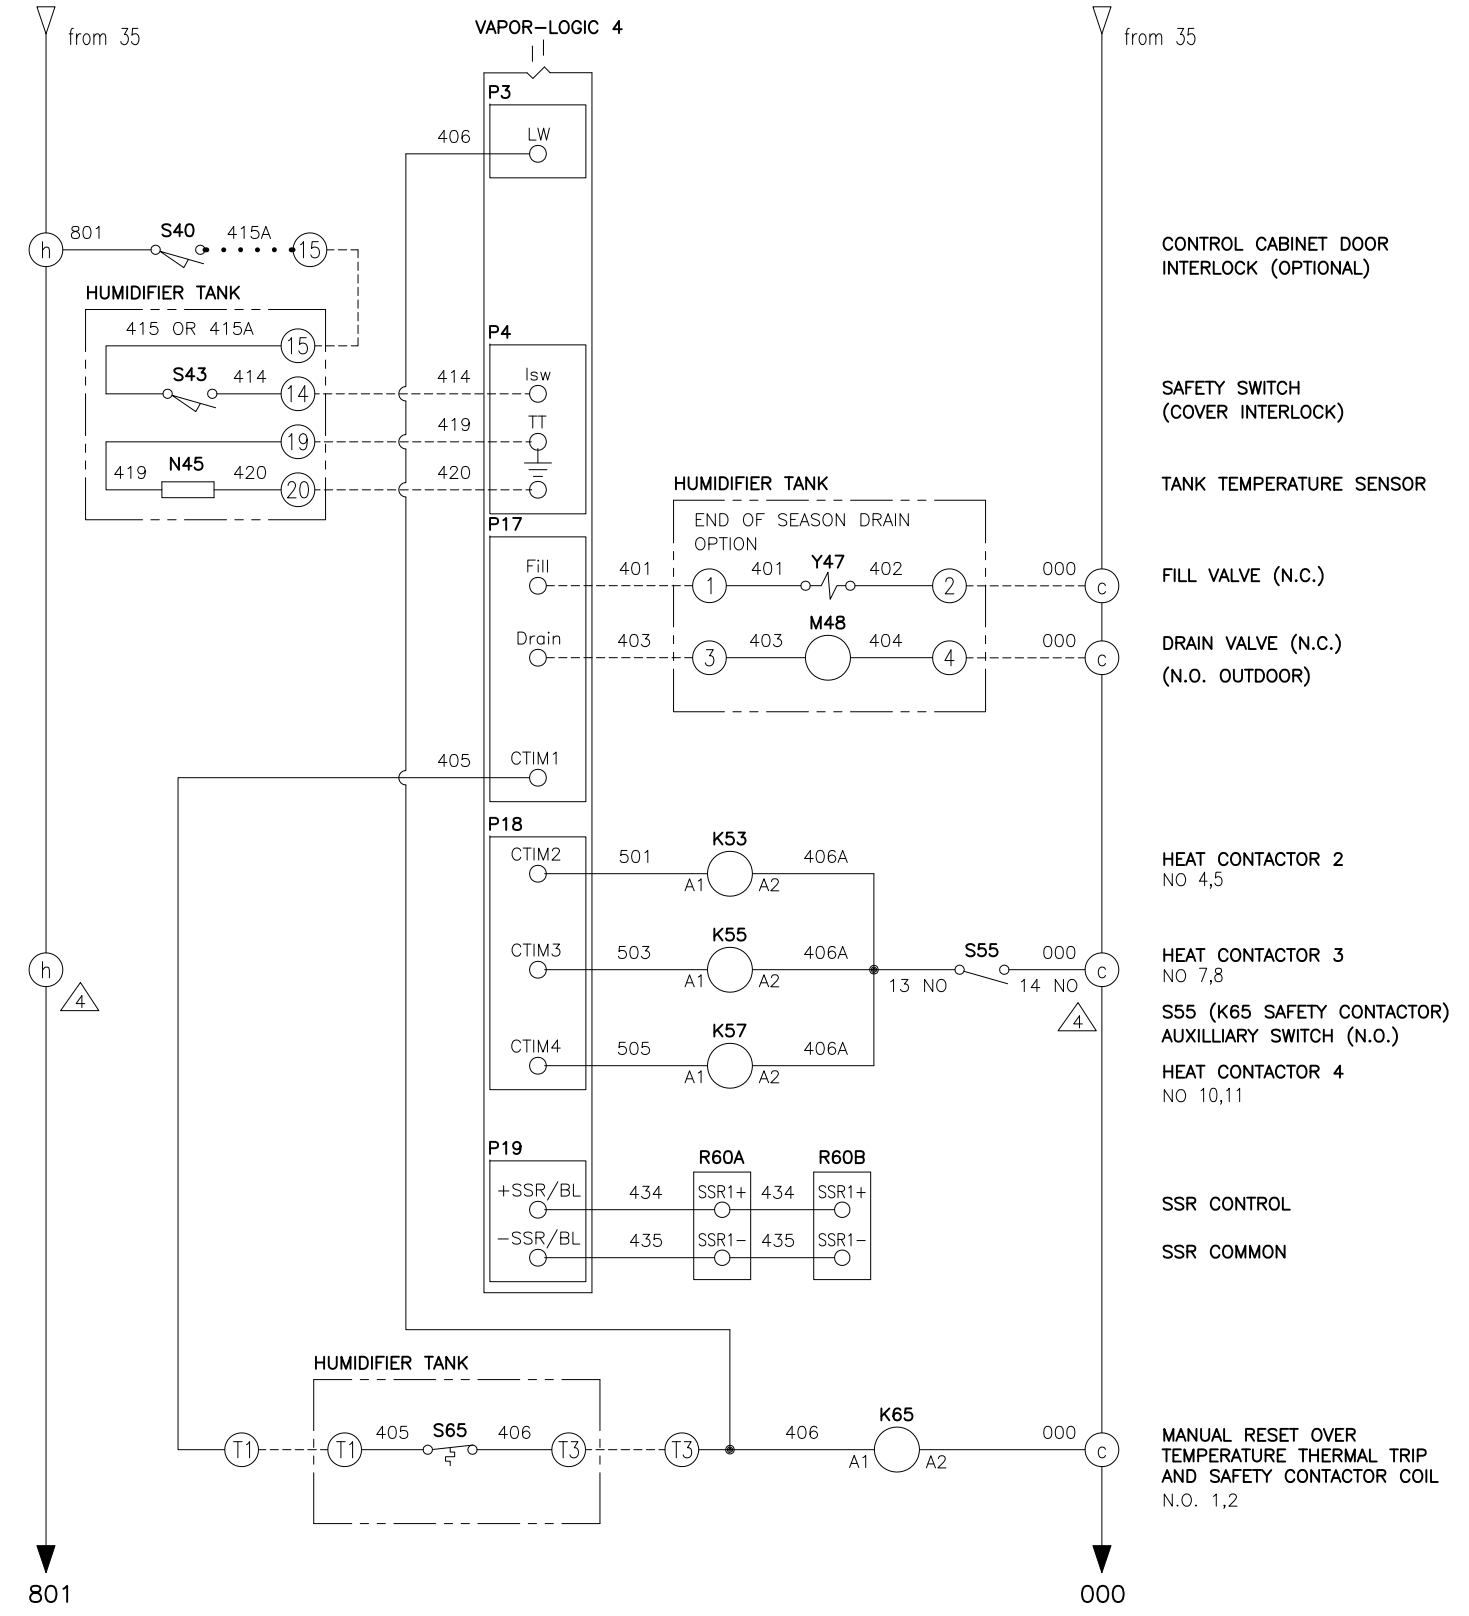

801

000

MODEL: _____
 ORDER NO: _____
 PRIMARY VOLTAGE: _____ PH: 1 HZ: 50/60
 TOTAL UNIT AMPS: _____

DRISTEEM	DOMESTIC VLDI, DI WATER, SSR DIAGRAM	
	MAT'L:	P/N
	SCALE:	VLC-VL4-22
	DRAWN BY: KROG	DATE: 11/24/09