


DATE	REV	RECORD	DR
1/22	A	E.C.# 7049	JK
1/23	B	E.C.# 7128	JK

XTP OUTDOOR ENCLOSURE WIRING DIAGRAM

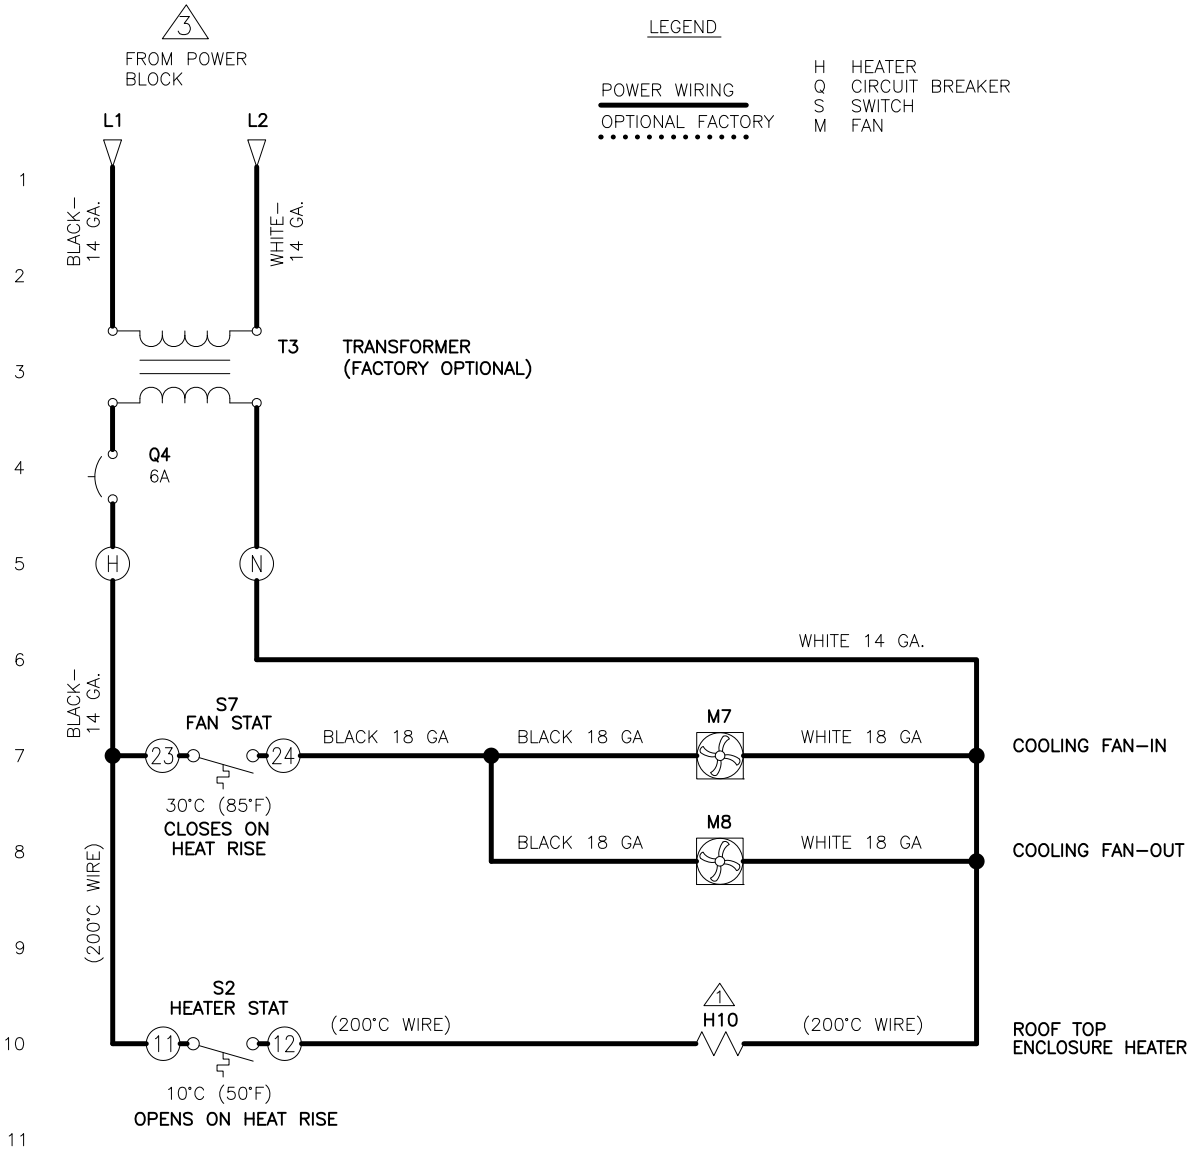

LEGEND

- | | | | | | | | | | |
|---|--|---|--------|---|-----------------|---|--------|---|-----|
| <p>POWER WIRING</p> <p>OPTIONAL FACTORY</p> | <table style="width: 100%; border: none;"> <tr> <td style="width: 10px;">H</td> <td>HEATER</td> </tr> <tr> <td>Q</td> <td>CIRCUIT BREAKER</td> </tr> <tr> <td>S</td> <td>SWITCH</td> </tr> <tr> <td>M</td> <td>FAN</td> </tr> </table> | H | HEATER | Q | CIRCUIT BREAKER | S | SWITCH | M | FAN |
| H | HEATER | | | | | | | | |
| Q | CIRCUIT BREAKER | | | | | | | | |
| S | SWITCH | | | | | | | | |
| M | FAN | | | | | | | | |

1
2
3
4
5
6
7
8
9
10
11

NOTES:

- ① USE UNINSULATED RING TERMINALS FOR TERMINATIONS AT HEATER LUGS.
2. ALL WIRING IS 14 GAUGE UNLESS NOTED OTHERWISE.
- ③ FOR 120/208V USE L1 AND N. SEE POWER BLOCK DETAILS ON XTP SUBPANEL WIRING DIAGRAM.

XTP OUTDOOR ENCLOSURE WIRING DIAGRAM	
MAT'L:	
SCALE:	P/N
DRAWN BY: JK	XTP-OE-1
DATE: 1/5/22	

