


DATE	REV	RECORD	DR
12/25	A	E.C.# 7409	JK

XTP OUTDOOR ENCLOSURE WIRING DIAGRAM

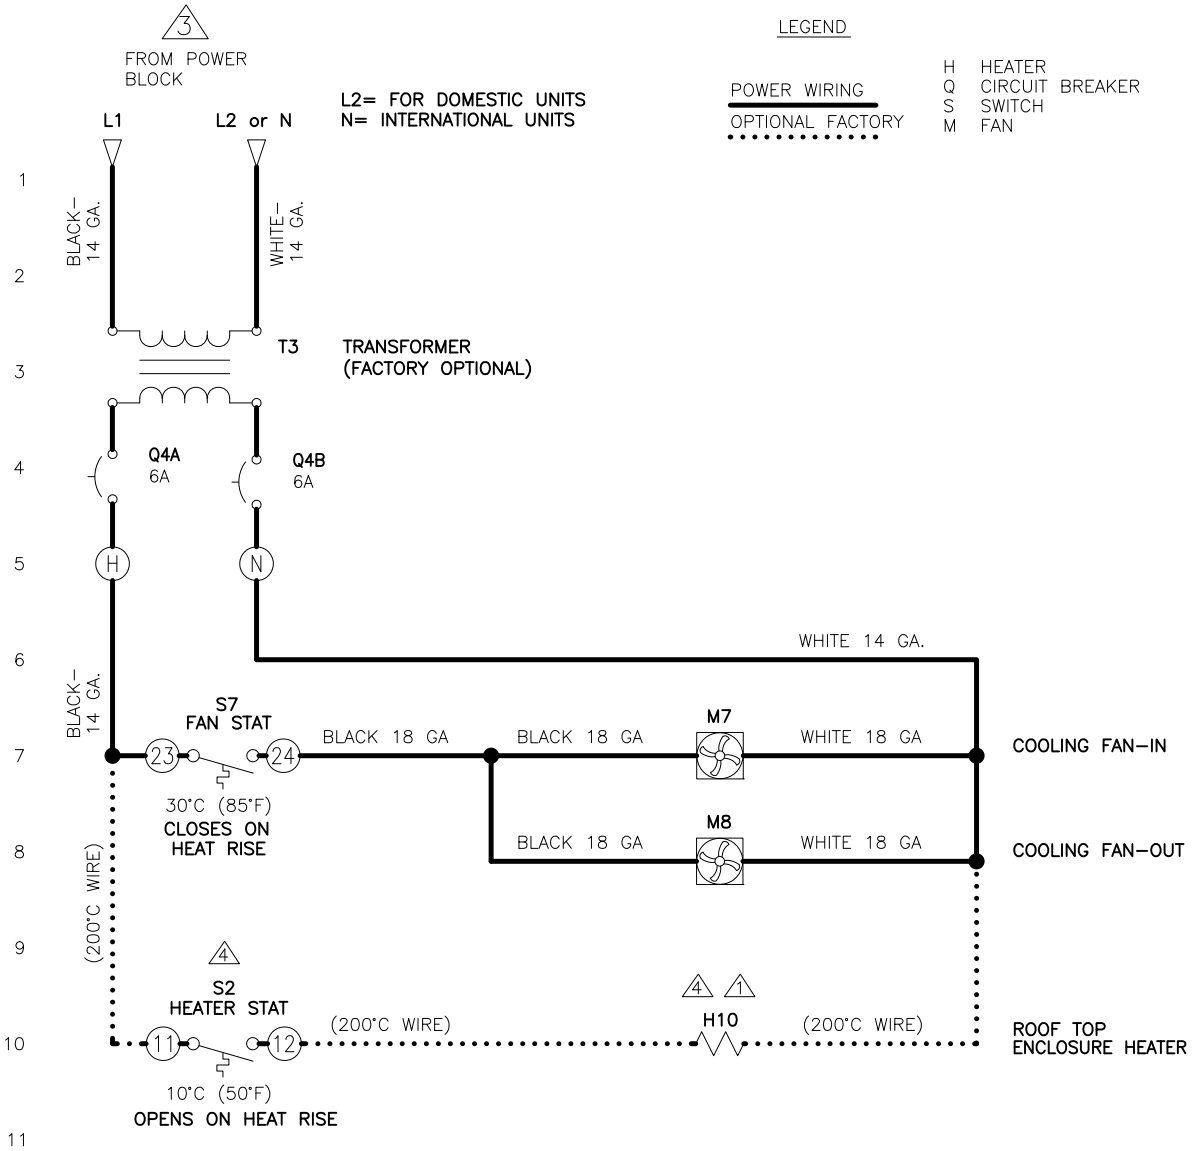

NOTES:

- ① USE UNINSULATED RING TERMINALS FOR TERMINATIONS AT HEATER LUGS.
- 2. ALL WIRING IS 14 GAUGE UNLESS NOTED OTHERWISE.
- ③ FOR 120/208V USE L1 AND N. SEE POWER BLOCK DETAILS ON XTP SUBPANEL WIRING DIAGRAM.
- ④ NOT USED ON MODELS WITHOUT HEATER

XTP OUTDOOR ENCLOSURE WIRING DIAGRAM	
MAT'L:	
SCALE:	P/N
DRAWN BY: JK	XTP-V2-OE-1
DATE: 12/12/25	

