
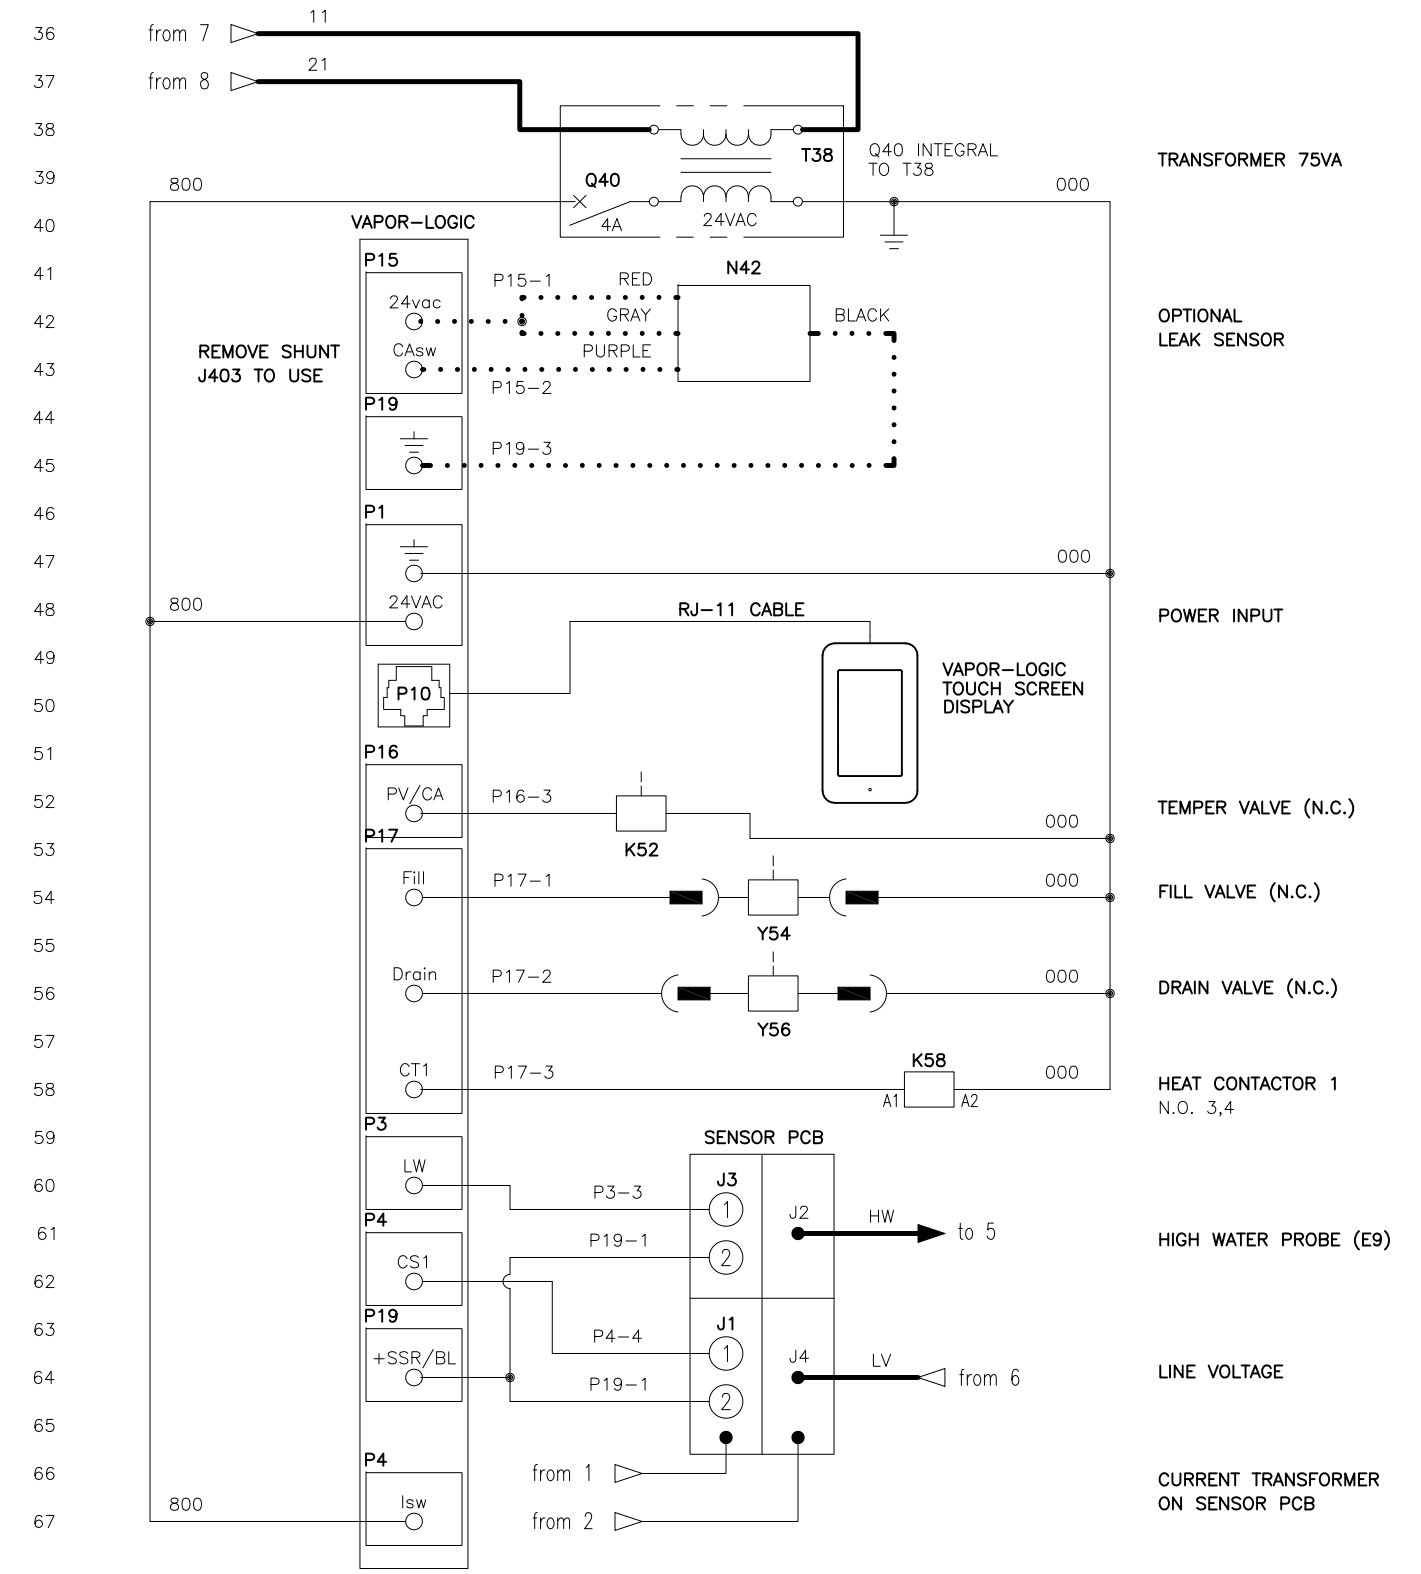


XTP TWO ELECTRODE STEAM HUMIDIFIER

REFER TO FOLLOWING DOCUMENTS
 -INSTALLATION REQUIREMENTS
 -EXTERNAL CONNECTIONS

DATE	REV	RECORD	DR
3/26	A	E.C.# 7409	JK

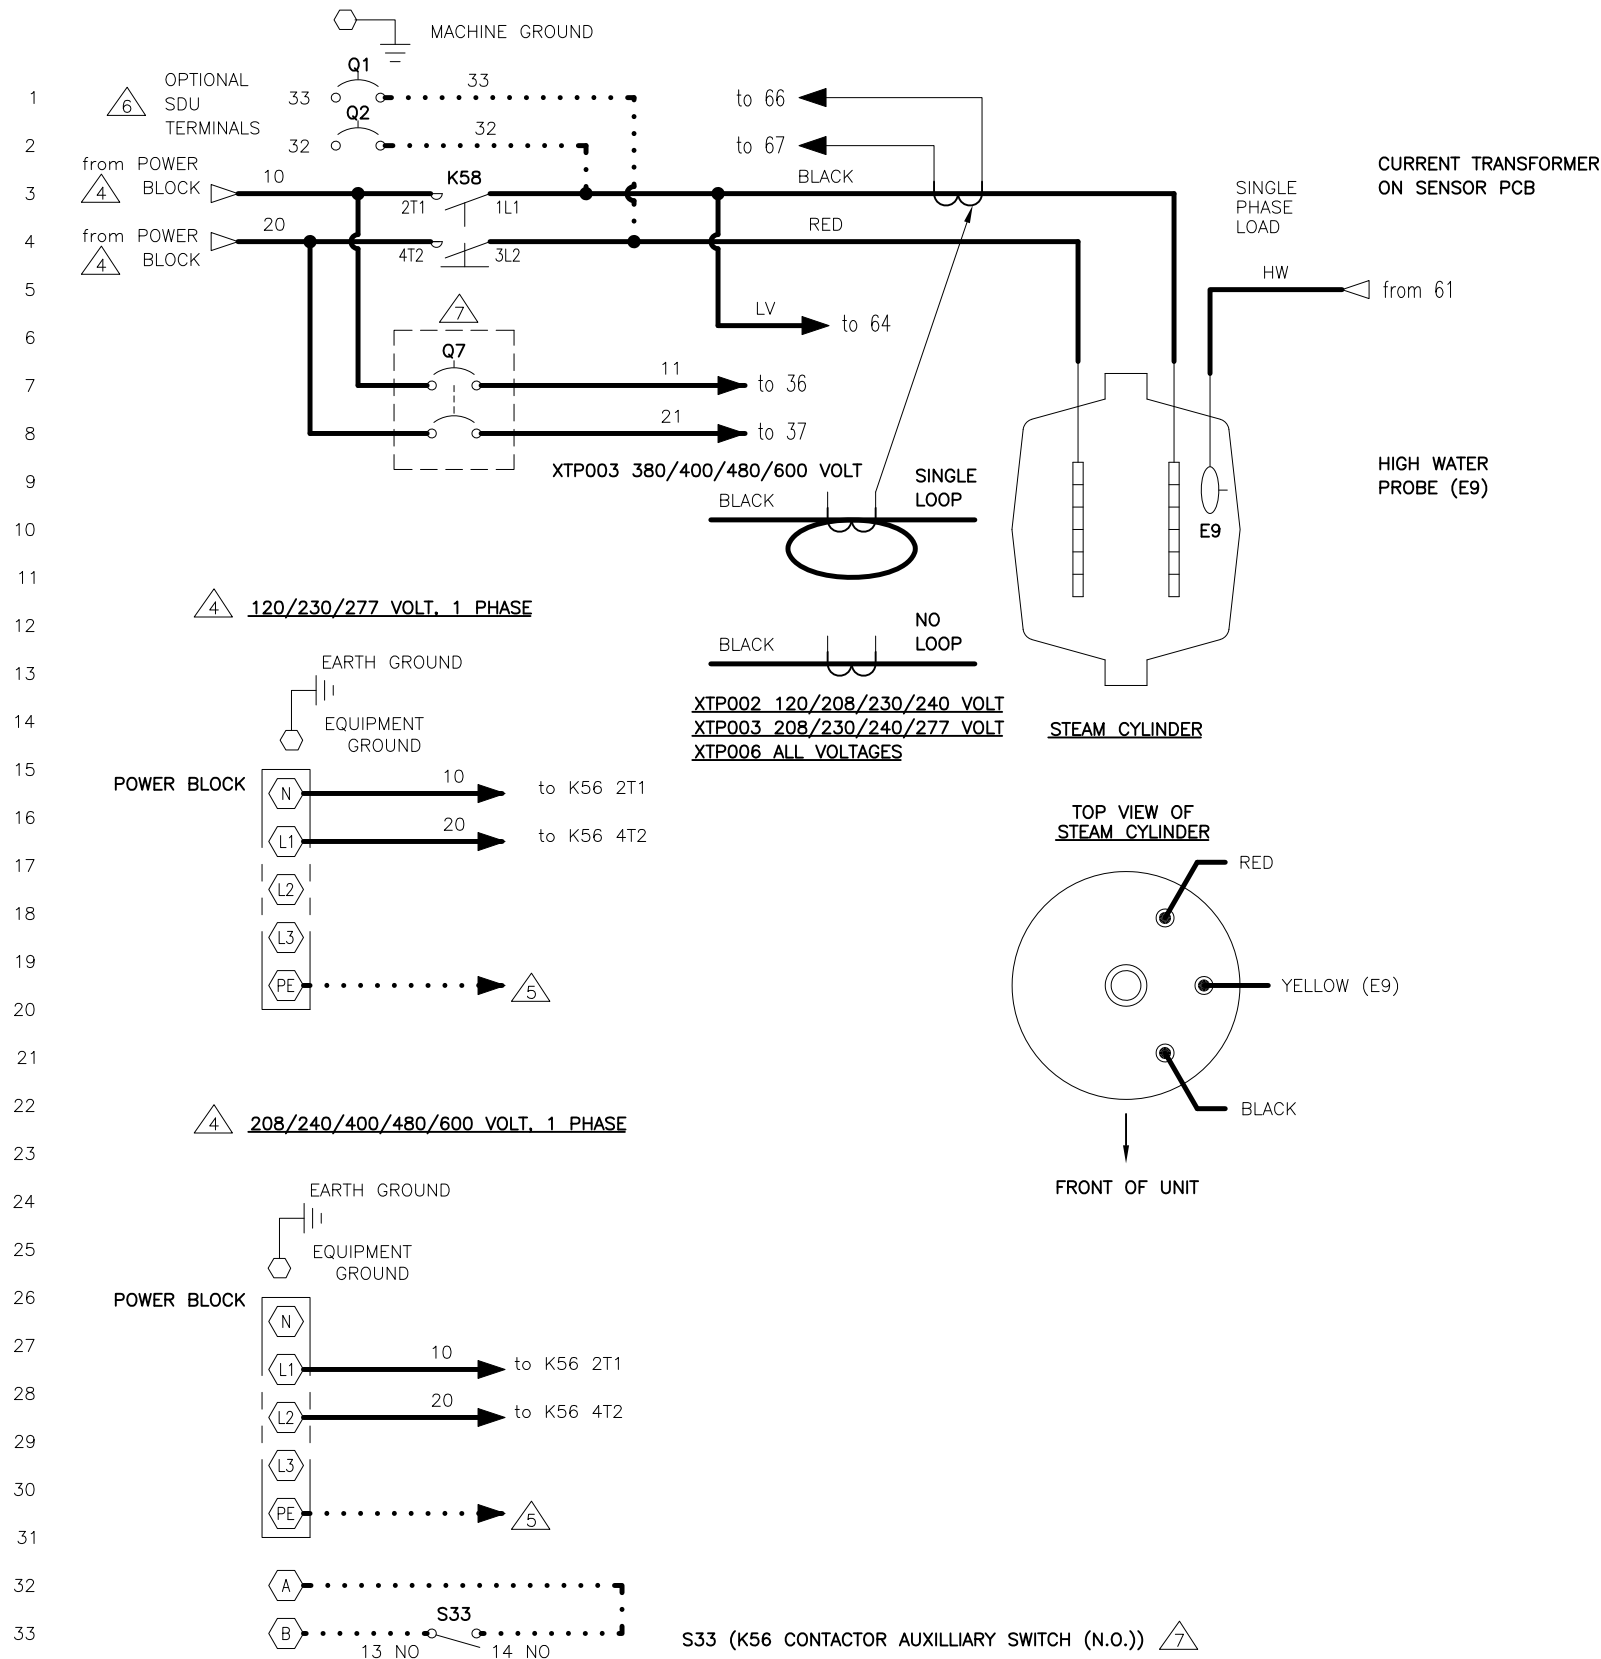

BREAK TO EXTERNAL CONNECTIONS DIAGRAM

POWER WIRING		CONTROL CIRCUIT WIRING		FIELD WIRING		OPTIONAL FACTORY		OPTIONAL FIELD																													
<p>LEGEND</p> <table border="1"> <thead> <tr> <th>Symbol</th> <th>Description</th> <th>Symbol</th> <th>Description</th> </tr> </thead> <tbody> <tr> <td>K</td> <td>RELAY/CONTACTOR</td> <td>Y</td> <td>SOLENOID</td> </tr> <tr> <td>T</td> <td>TRANSFORMER</td> <td>N</td> <td>SENSOR</td> </tr> <tr> <td>Q</td> <td>CIRCUIT BREAKER</td> <td>J</td> <td>JUMPER</td> </tr> <tr> <td>S</td> <td>SWITCH</td> <td>E</td> <td>WATER PROBE</td> </tr> <tr> <td>H</td> <td>HEATER</td> <td>M</td> <td>MOTOR/FAN</td> </tr> <tr> <td>F</td> <td>FUSE</td> <td></td> <td></td> </tr> </tbody> </table>										Symbol	Description	Symbol	Description	K	RELAY/CONTACTOR	Y	SOLENOID	T	TRANSFORMER	N	SENSOR	Q	CIRCUIT BREAKER	J	JUMPER	S	SWITCH	E	WATER PROBE	H	HEATER	M	MOTOR/FAN	F	FUSE		
Symbol	Description	Symbol	Description																																		
K	RELAY/CONTACTOR	Y	SOLENOID																																		
T	TRANSFORMER	N	SENSOR																																		
Q	CIRCUIT BREAKER	J	JUMPER																																		
S	SWITCH	E	WATER PROBE																																		
H	HEATER	M	MOTOR/FAN																																		
F	FUSE																																				
<p>NOTES</p> <ol style="list-style-type: none"> 1. WIRING AND BRANCH CIRCUIT PROTECTION PROVIDED BY INSTALLER AS PER NATIONAL ELECTRICAL CODE. 2. FOR SUPPLY HEATER AND MACHINE GROUND CONNECTIONS, SIZE WIRE USING 75°C WIRE TABLE PER NATIONAL ELECTRICAL CODE. 3. USE COPPER CONNECTORS RATED FOR 105°C. MIN 																																					
<p>REFERENCES</p> <ul style="list-style-type: none"> 4. SEE VOLTAGE SPECIFIC WIRING DETAIL 5. FOR 230 & 400 VOLT 6. WIRES 32 AND 33 -OPTIONAL WITH SDU ONLY 7. FACTORY OPTION 8. REFERENCE OUTDOOR ENCLOSURE DIAGRAM #XTP-V2-OE-1 																																					
<p>POWER BLOCK</p> <p>10 to K56 2T1</p> <p>20 to K56 4T2</p>				<p>POWER BLOCK</p> <p>10 to K56 2T1</p> <p>20 to K56 4T2</p>				<p>LEGEND</p>		<p>NOTES</p>																											
<p>POWER BLOCK</p> <p>10 to K56 2T1</p> <p>20 to K56 4T2</p>				<p>POWER BLOCK</p> <p>10 to K56 2T1</p> <p>20 to K56 4T2</p>				<p>LEGEND</p>		<p>NOTES</p>																											
<p>POWER BLOCK</p> <p>10 to K56 2T1</p> <p>20 to K56 4T2</p>				<p>POWER BLOCK</p> <p>10 to K56 2T1</p> <p>20 to K56 4T2</p>				<p>LEGEND</p>		<p>NOTES</p>																											

		XTP TWO ELECTRODE	
		MAT'L:	P/N XTP-V2-VL-1
SCALE:		DRAWN BY: JK	DATE: 12/9/25