
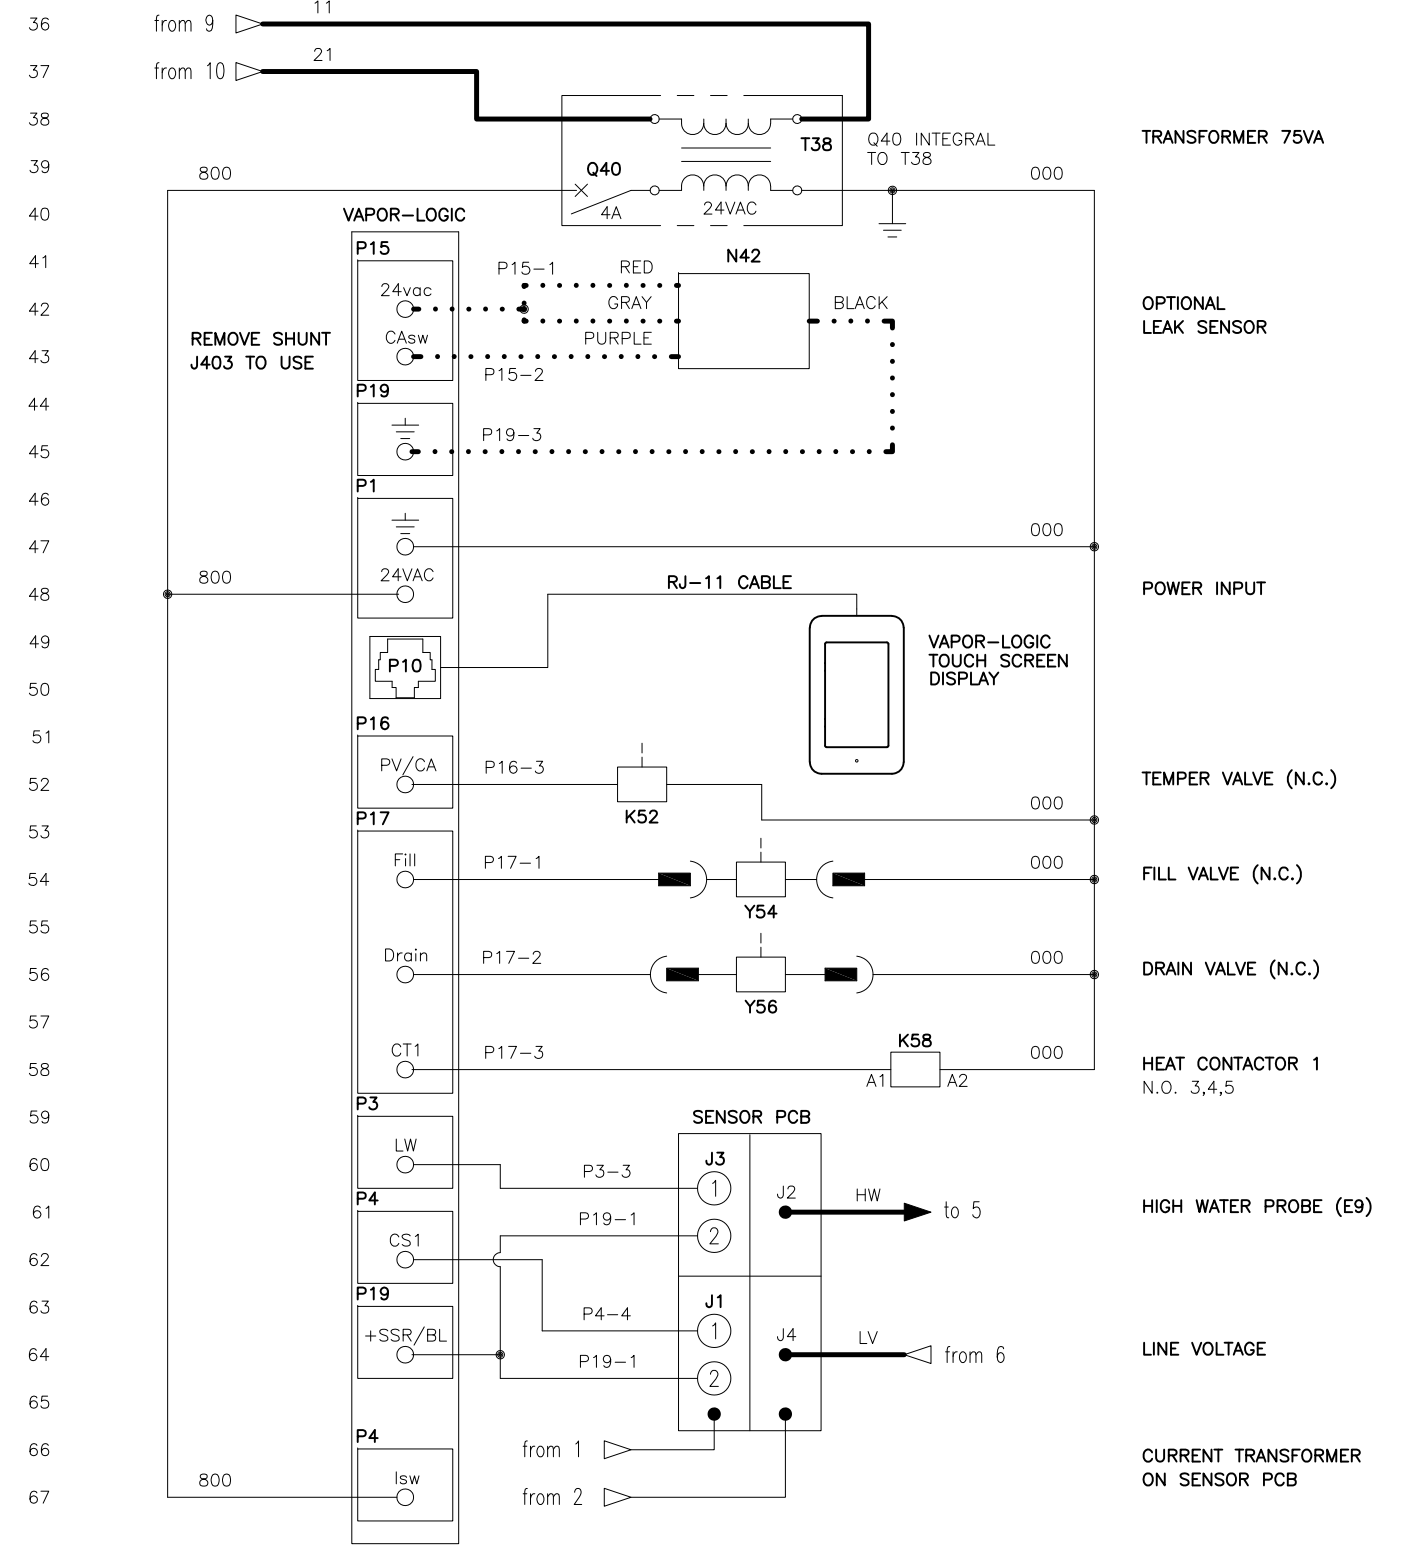


XTP THREE ELECTRODE STEAM HUMIDIFIER

REFER TO FOLLOWING DOCUMENTS
 -INSTALLATION REQUIREMENTS
 -EXTERNAL CONNECTIONS

DATE	REV	RECORD	DR
3/26	A	E.C.# 7409	JK

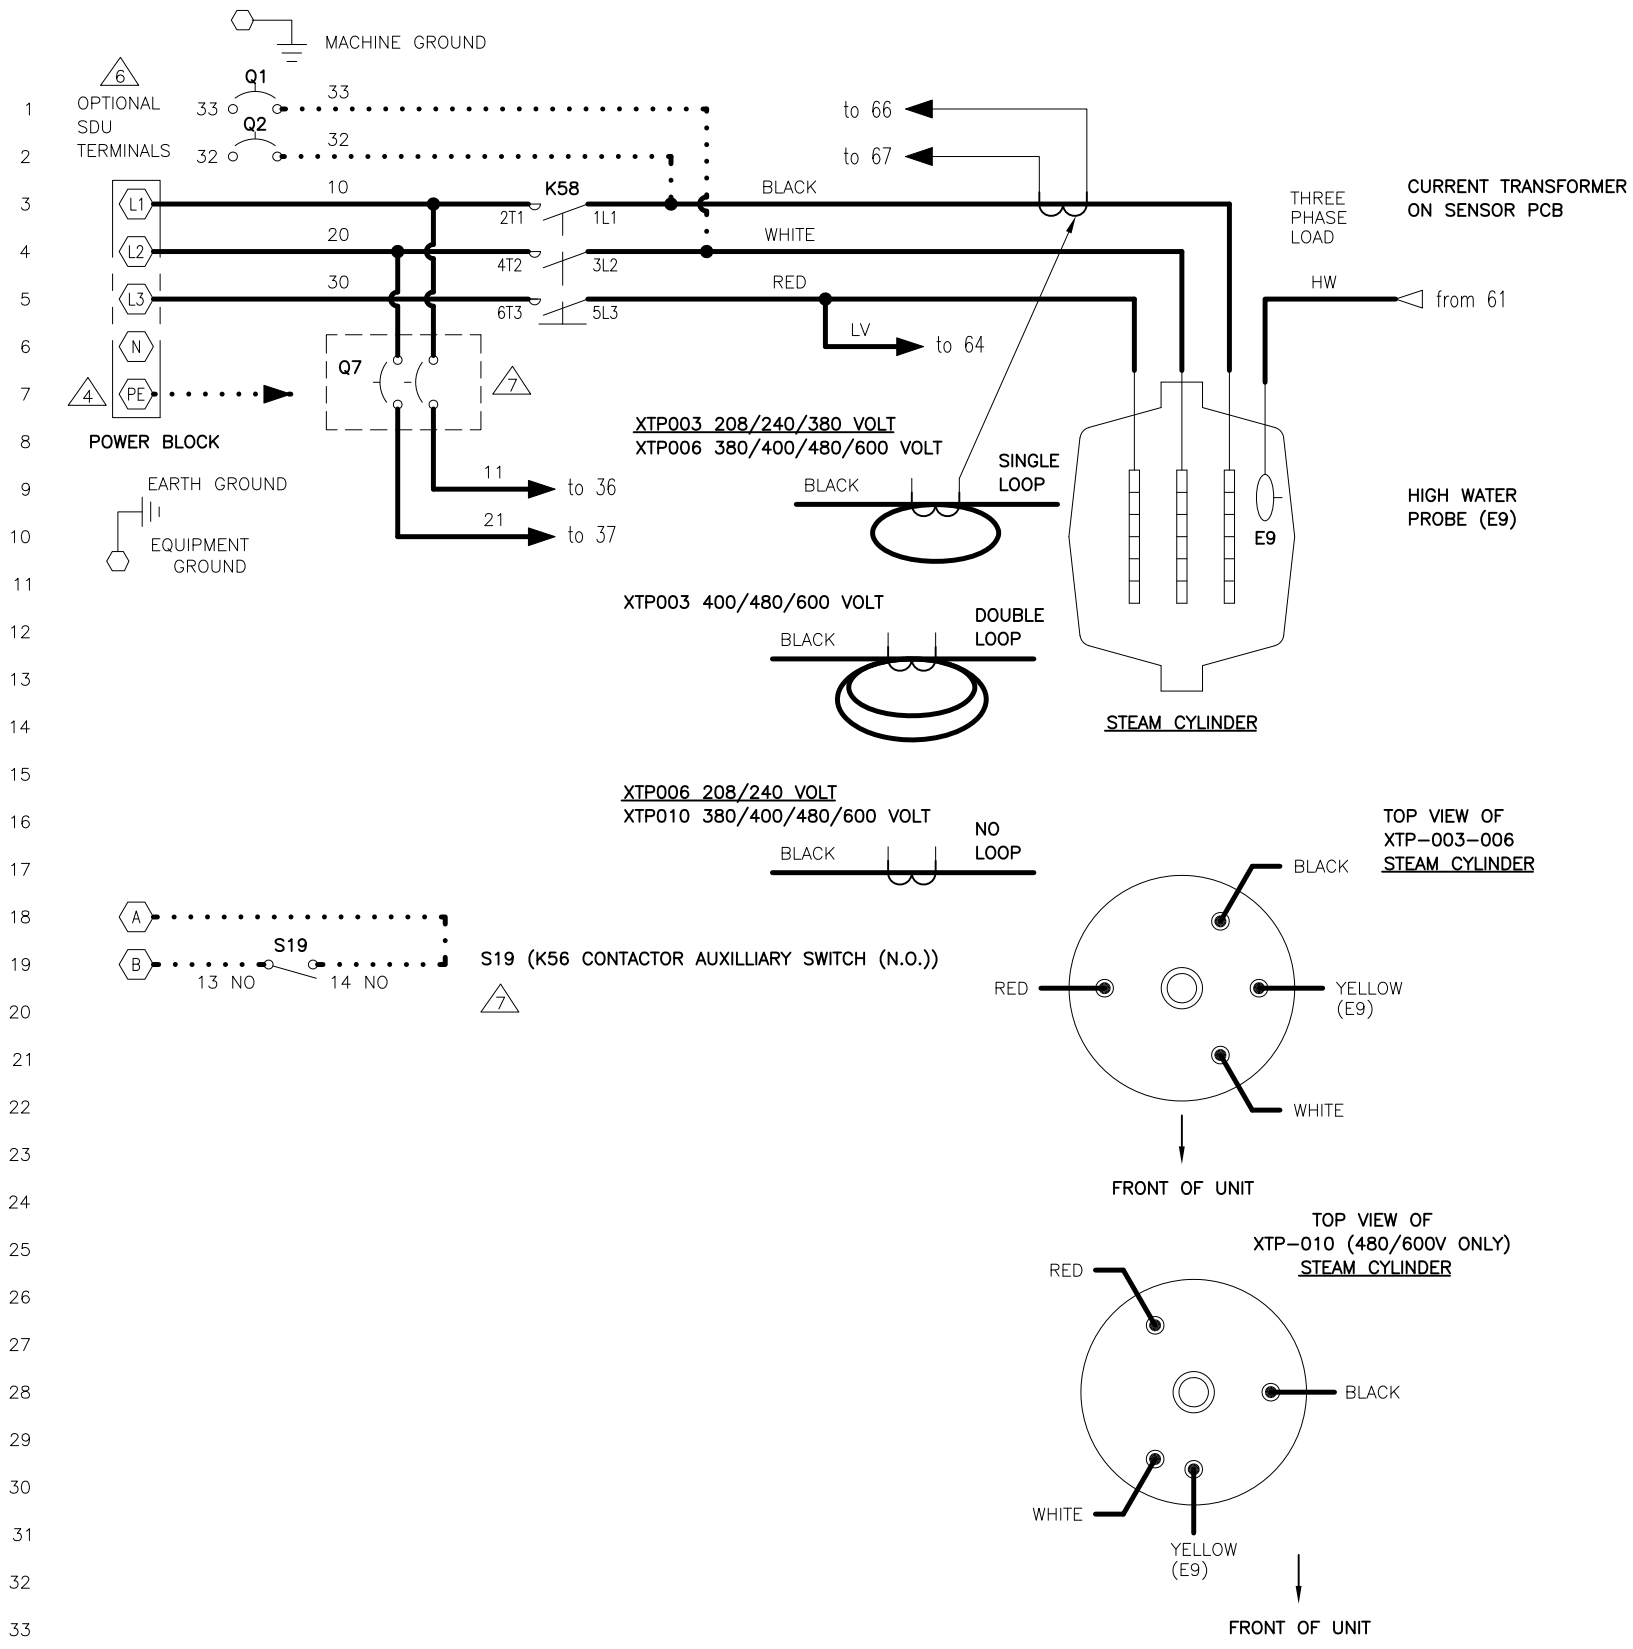

POWER WIRING
 CONTROL CIRCUIT WIRING
 FIELD WIRING
 OPTIONAL FACTORY
 OPTIONAL FIELD

LEGEND

K	RELAY/CONTACTOR	Y	SOLENOID
T	TRANSFORMER	N	SENSOR
Q	CIRCUIT BREAKER	J	JUMPER
S	SWITCH	E	WATER PROBE
H	HEATER	M	MOTOR/FAN
F	FUSE		

- NOTES:**
1. WIRING AND BRANCH CIRCUIT PROTECTION PROVIDED BY INSTALLER AS PER NATIONAL ELECTRICAL CODE.
 2. FOR SUPPLY HEATER AND MACHINE GROUND CONNECTIONS, SIZE WIRE USING 75°C WIRE TABLE PER NATIONAL ELECTRICAL CODE.
 3. USE COPPER CONNECTORS RATED FOR 105°C.

- △ 4 FOR 230 & 400 VOLT
 △ 5 INDOOR ENCLOSURE ONLY
 △ 6 WIRES 32 AND 33 -OPTIONAL WITH SDU ONLY
 △ 7 FACTORY OPTION
 8. REFERENCE OUTDOOR ENCLOSURE DIAGRAM #XTP-V2-OE-1

BREAK TO EXTERNAL CONNECTIONS DIAGRAM

		XTP THREE ELECTRODE	
		MAT'L:	P/N
SCALE:	DATE:	XTP-V2-VL-2	
DRAWN BY: JK	DATE: 12/10/25		