XTP SIX ELECTRODE STEAM HUMIDIFIER

REFER TO FOLLOWING DOCUMENTS
–INSTALLATION REQUIREMENTS
–EXTERNAL CONNECTIONS

DATE	REV	RECORD	DR
2/21	L	EC# 6942	JK
1/22	M	EC# 7049	JK
2/24	N	EC# 7258	JK

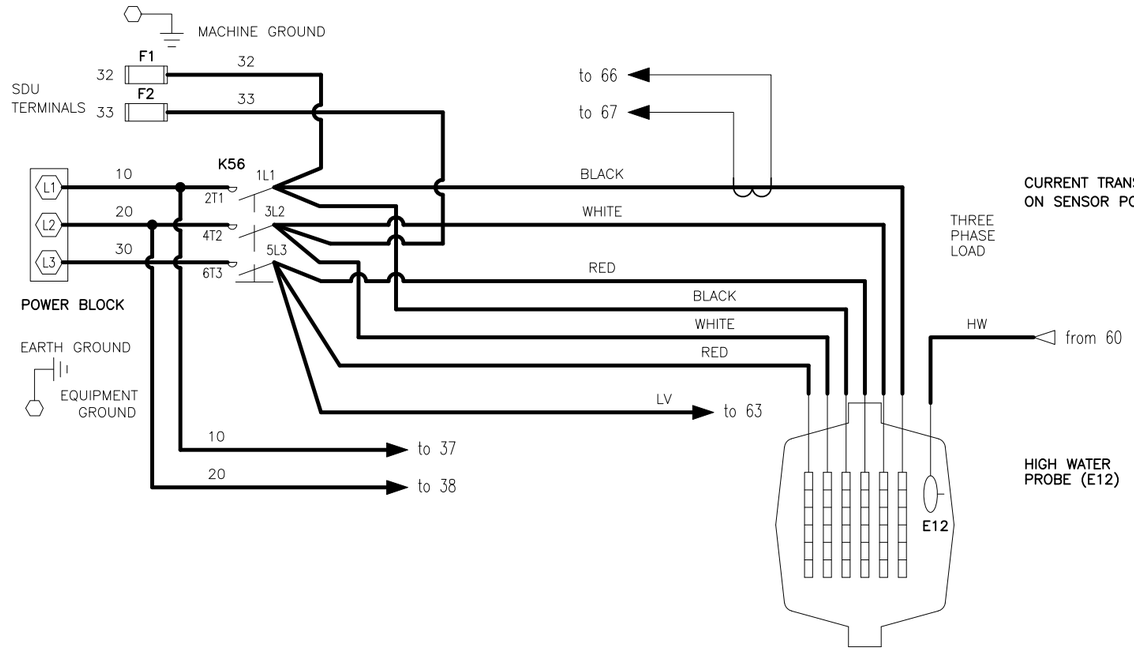

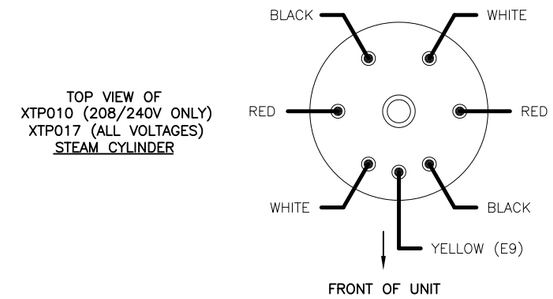

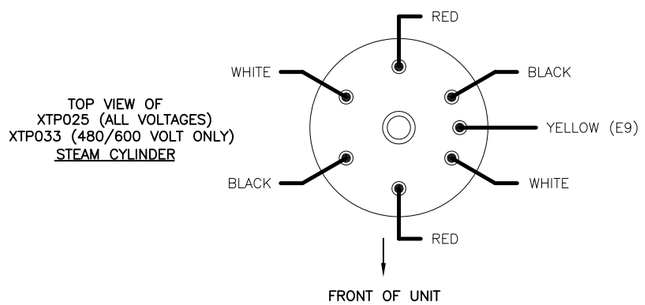

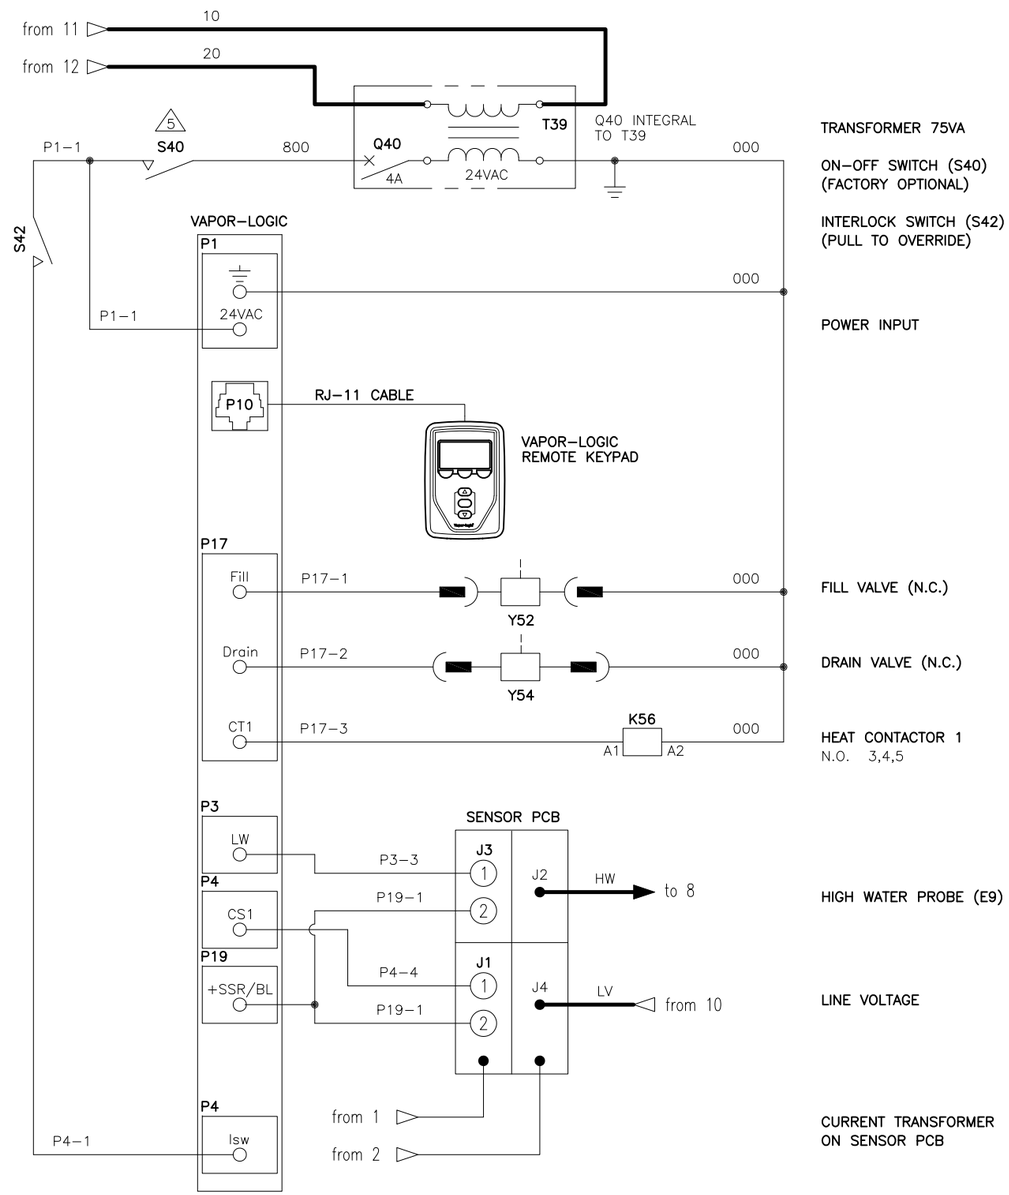

BREAK TO EXTERNAL CONNECTIONS DIAGRAM

POWER WIRING
CONTROL CIRCUIT WIRING
FIELD WIRING
OPTIONAL FACTORY
OPTIONAL FIELD

LEGEND

K	RELAY/CONTACTOR	Y	SOLENOID
T	TRANSFORMER	N	SENSOR
Q	CIRCUIT BREAKER	J	JUMPER
S	SWITCH	E	WATER PROBE
H	HEATER	M	MOTOR/FAN
F	FUSE		

NOTES:

1. WIRING AND BRANCH CIRCUIT PROTECTION PROVIDED BY INSTALLER AS PER NATIONAL ELECTRICAL CODE.
2. FOR SUPPLY HEATER AND MACHINE GROUND CONNECTIONS, SIZE WIRE USING 75°C WIRE TABLE PER NATIONAL ELECTRICAL CODE.
3. USE COPPER CONNECTORS RATED FOR 105°C.
4. REFER TO XTP ELECTRICAL DATA SHEET.

5 INDOOR ENCLOSURE ONLY

	XTP SIX ELECTRODE	
	MAT'L:	
driSteem	SCALE:	P/N
	DRAWN BY: JK	XTP–VL–3
	DATE: 5/19/15	