


DATE	REV	RECORD	DR
1/22	A	E.C.# 7049	JK
1/23	B	E.C.# 7128	JK

XTPE OUTDOOR ENCLOSURE WIRING DIAGRAM

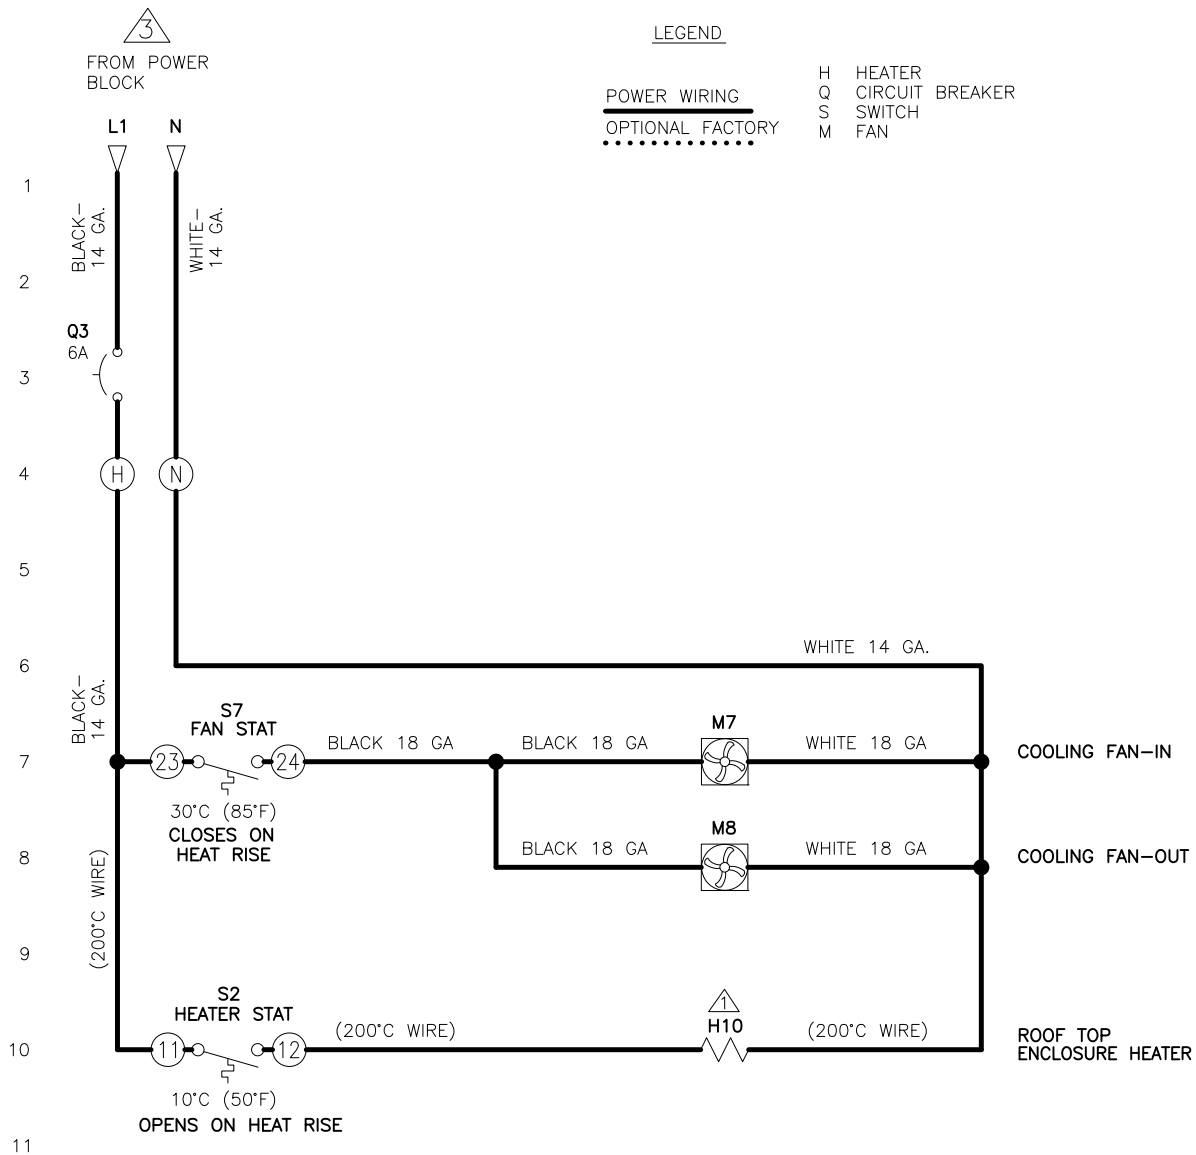

NOTES:

- ① USE UNINSULATED RING TERMINALS FOR TERMINATIONS AT HEATER LUGS.
2. ALL WIRING IS 14 GAUGE UNLESS NOTED OTHERWISE.
- ③ SEE VOLTAGE SPECIFIC DETAILS ON XTPE SUBPANEL WIRING DIAGRAM

		XTPE OUTDOOR ENCLOSURE WIRING DIAGRAM	
MAT'L:		P/N	
SCALE:		XTPE-OE-1	
DRAWN BY: JK		DATE: 1/5/22	