
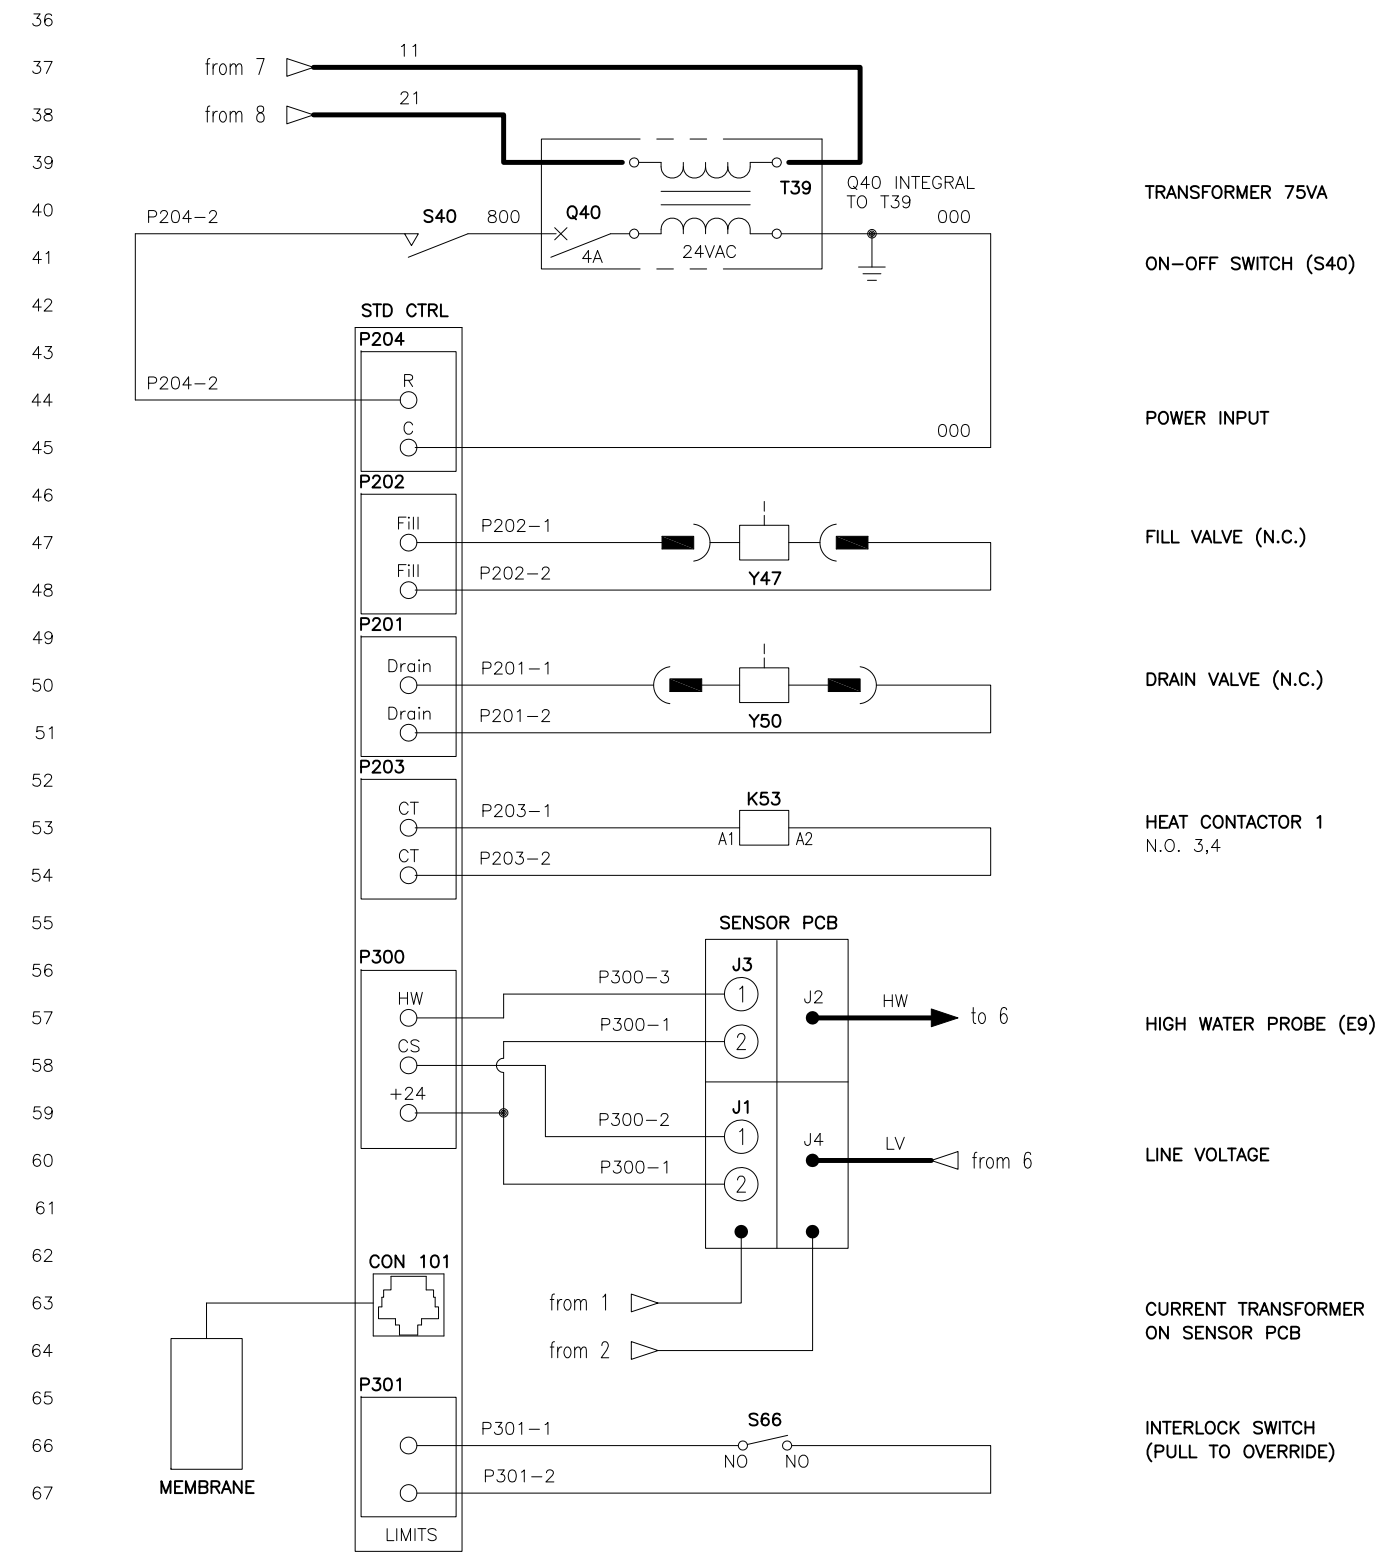
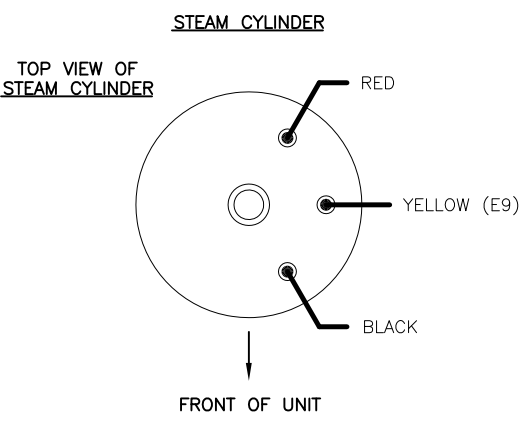
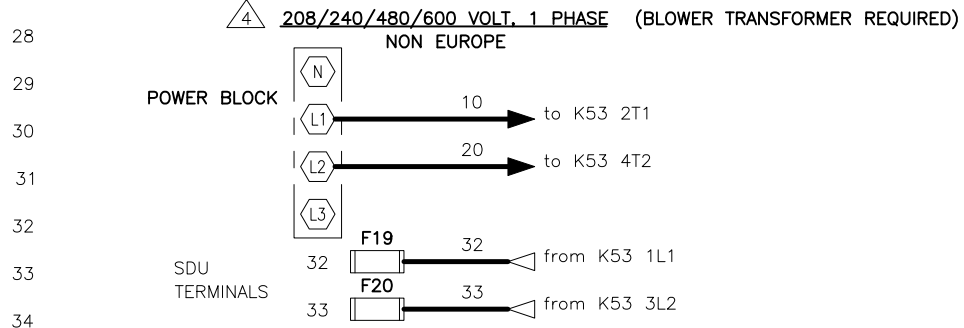
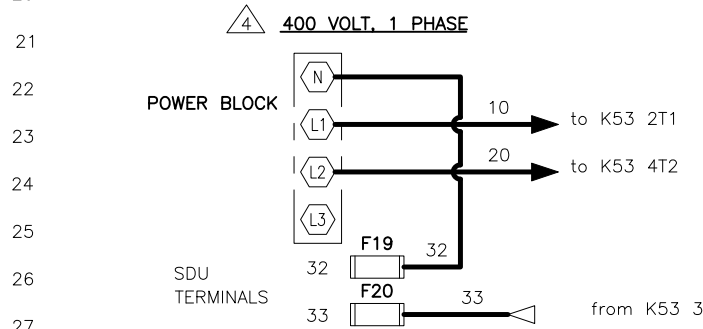
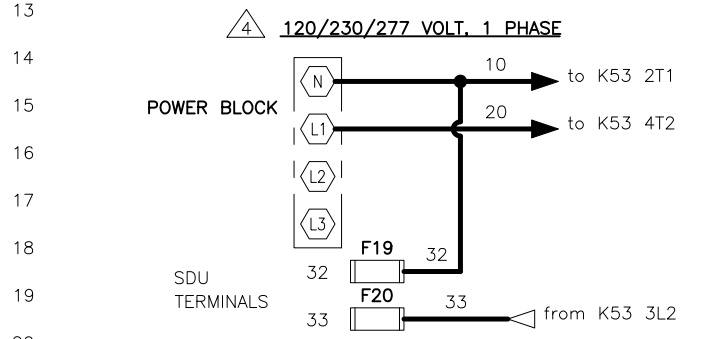


# XTS TWO ELECTRODE STEAM HUMIDIFIER

REFER TO FOLLOWING DOCUMENTS  
 -INSTALLATION REQUIREMENTS  
 -EXTERNAL CONNECTIONS

| DATE | REV | RECORD     | DR |
|------|-----|------------|----|
| 5/15 | J   | E.C.# 6383 | JK |
| 5/17 | K   | E.C.# 6551 | JK |
| 6/17 | L   | E.C.# 6586 | JK |

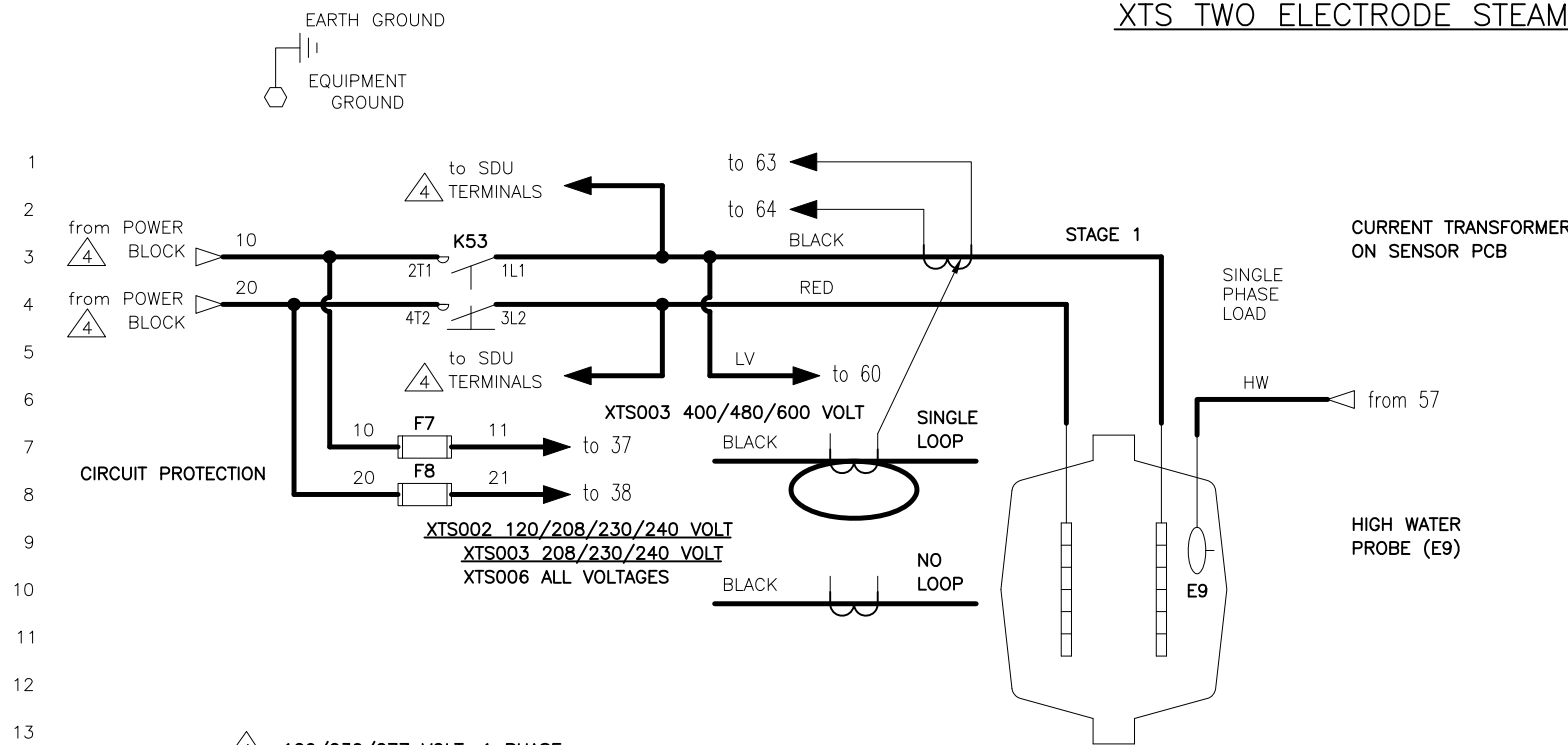

**POWER WIRING**  
 CONTROL CIRCUIT WIRING  
 FIELD WIRING  
 OPTIONAL FACTORY  
 OPTIONAL FIELD

**LEGEND**

|                   |               |
|-------------------|---------------|
| K RELAY/CONTACTOR | Y SOLENOID    |
| T TRANSFORMER     | N SENSOR      |
| Q CIRCUIT BREAKER | J JUMPER      |
| S SWITCH          | E WATER PROBE |
| H HEATER          | M MOTOR/FAN   |
| F FUSE            |               |

- NOTES:**
1. WIRING AND BRANCH CIRCUIT PROTECTION PROVIDED BY INSTALLER AS PER NATIONAL ELECTRICAL CODE.
  2. FOR SUPPLY HEATER AND MACHINE GROUND CONNECTIONS, SIZE WIRE USING 75°C WIRE TABLE PER NATIONAL ELECTRICAL CODE.
  3. USE COPPER CONNECTORS RATED FOR 105°C.

- △ SEE VOLTAGE SPECIFIC WIRING DETAIL.  
 5. REFER TO XTS ELECTRICAL DATA SHEET.

BREAK TO EXTERNAL CONNECTIONS DIAGRAM

|                          |                  |
|--------------------------|------------------|
| <b>XTS TWO ELECTRODE</b> |                  |
| MAT'L:                   |                  |
| SCALE: <b>KROG</b>       | P/N              |
| DRAWN BY: <b>KROG</b>    | <b>XTS-STD-1</b> |
| DATE: 5/9/12             |                  |

