


XTS EXTERNAL CONTROL CONNECTIONS & DIP SWITCH SETTINGS DIAGRAM

DATE	REV	RECORD	DR
1/16	D	E.C.# 6395	JK
1/17	E	E.C.# 6515	AJK
6/17	F	E.C.# 6586	JK

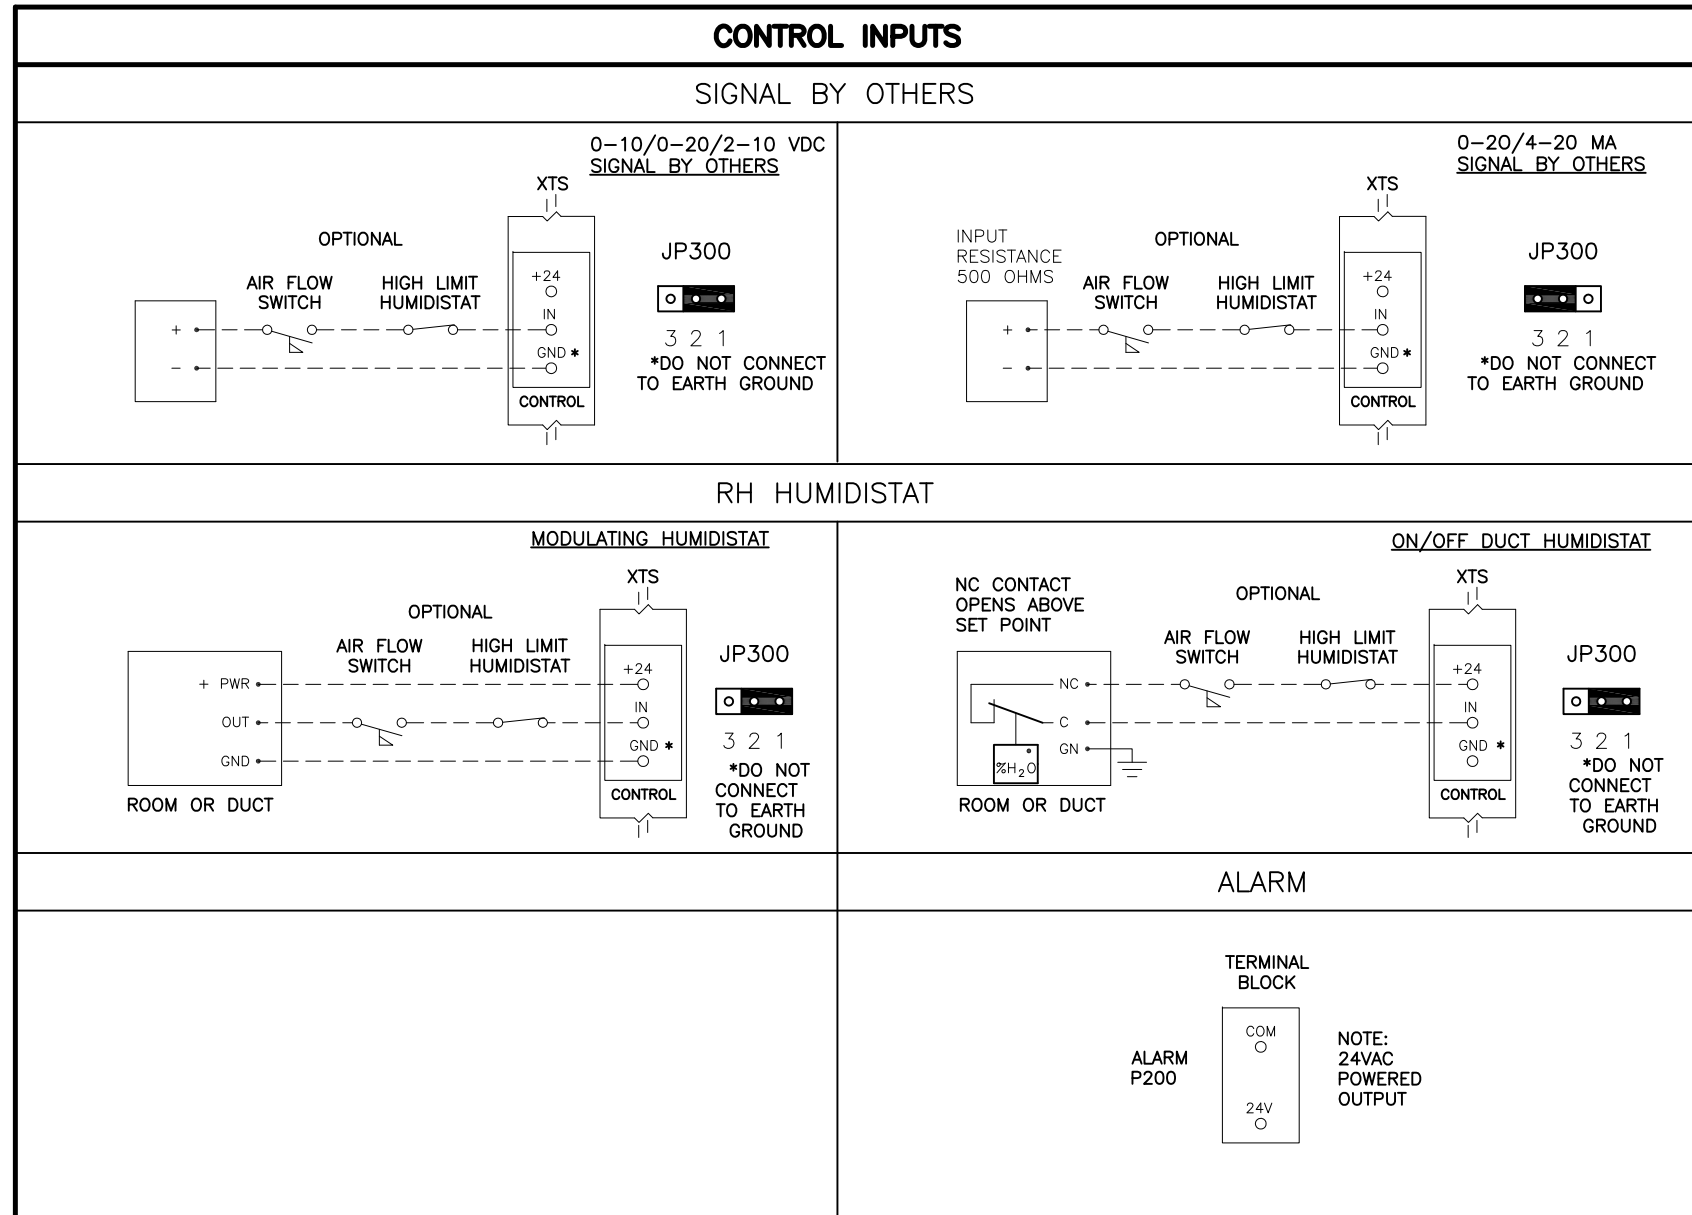

CONTROL CIRCUIT WIRING

FIELD WIRING

OPTIONAL FACTORY

OPTIONAL FIELD



BREAK TO EXTERNAL CONNECTIONS DIAGRAM

CONTROL DIP SWITCH SETTING

DIP 1	DIP 2	SIGNAL TYPE
OFF	OFF	ON/OFF HUMIDISTAT
ON	OFF	0-20 VDC
OFF	ON	0-10 VDC (OR) 0-20MA
ON	ON	2-10 VDC (OR) 4-20MA

CURRENT LIMITATION DIP SWITCH SETTINGS

DIP 9	DIP 10	DIP 11	CURRENT LIMITATION
OFF	OFF	OFF	100% OF NOMINAL
ON	OFF	OFF	90% OF NOMINAL
OFF	ON	OFF	80% OF NOMINAL
ON	ON	OFF	70% OF NOMINAL
OFF	OFF	ON	60% OF NOMINAL
ON	OFF	ON	50% OF NOMINAL
OFF	ON	ON	40% OF NOMINAL
ON	ON	ON	30% OF NOMINAL

DRAIN TEMPERING DIP SWITCH SETTING

DIP 12	DRAIN TEMPERING
OFF	DISABLED
ON	ENABLED

NOTES:

1. CHANGING CONTROL INPUT SIGNAL MAY REQUIRE WIRING CHANGE AND PROGRAM CHANGE. REFER TO VAPOR-LOGIC INSTALLATION AND OPERATION MANUAL (IOM), KEYPAD INPUT SELECTION SUB-MENU.
2. FOR ALL CONTROL DEVICES, EXCEPT WATER LEVEL CONTROLS/PROBE USE: 18 AWG/1.5 mm² PLENUM RATED 2-WIRE SHIELDED CABLE.
3. THIS PRODUCT WAS FACTORY TESTED FOR PROPER OPERATION. FAULTY HANDLING OR WIRING IS NOT COVERED UNDER DriSteem'S WARRANTY.

XTS EXTERNAL CONTROL CONNECTIONS & DIP SWITCH SETTINGS	
MAT'L:	
SCALE:	P/N
DRAWN BY: KROG	XTS-STD-5
DATE: 5/9/12	

